# **HITACHI**

# TECHNICAL CATALOGUE

# INDOOR UNITS SYSTEM FREE SERIES & COMPLEMENTARY SYSTEMS



### **MODELS**

### **SYSTEM FREE**

RCI-FSR

RCIM-FSRE

RCD-FSR

RPC-FSR

RPI(L/H)-FSRE

RPI-FSN6E-EF

RPI-FSN3(P)E(-f)

 $\mathsf{RPK}\text{-}\mathsf{FSR}(\mathsf{H})\mathsf{M}$ 

RPF-FSN2E

RPFI-FSN2E

### **COMPLEMENTARY SYSTEMS**

KPI-(E/X)4E

DX-Interface - EXV-E2

Econofresh - EF-456N1E



Cooling & Heating



Contents **HITACHI** 

### Contents

General information	40
Features and benefits	2
General data	3
System selection procedure	4
Acoustic characteristic curves	5
Working range	6
General dimensions	7
Refrigerant cycle	8
Piping work and refrigerant charge	9
Electrical and control settings	10
Optional functions	11

### **General Index**

1.	General information	1
1.1	General information	2
	1.1.1 Introduction	2
1.2	Applied symbols	3
1.3	Norms and Regulations	3
1.4	Product classification and line-up	4
	1.4.1 Classification of indoor unit models	
	1.4.2 Classification of KPI models	
	1.4.3 Classification of DX-Interface models	4
	1.4.4 Classification of Econofresh models	4
	1.4.5 Product line-up: indoor units	5
	1.4.6 Product line-up: KPI energy recovery unit	
	1.4.7 Product line-up: DX-Interface	
	1.4.8 Product line-up: Econofresh	
	1.4.9 Accessory code list	
	1.4.10 Multi-Kits	
	1.4.11 Individual remote controls	
	1.4.12 Receiver kit for combination with wireless remote control switch	
	1.4.13 Centralised remote controls	
	1.4.14 Building air conditioning controls.	
	1.4.15 Gateways for building management systems (BMS)	
	1.4.17 Control accessories	
	1.1.17 Gold G. Goodge Communication of the Communica	
2.	Features and benefits	19
2.1	Benefits of the choice	21
	2.1.1 Choice range	21
	2.1.2 Remote control range	22
	2.1.3 Flexible system	23
2.2	Installation advantages	
	2.2.1 Easy and flexible communication between units	24
2.3	Start-up benefits	
	2.3.1 Automatic start-up	
	2.3.2 Service verification	27
2.4	Functional benefits	
	2.4.1 Indoor units	
	2.4.2 Improvement of optional functions for fan stop in Thermo-off conditions	
	2.4.3 Improvement of Automatic COOL/HEAT Operation	
	2.4.4 Motion sensor control	
2.5	Maintenance benefits	
	2.5.1 Availability of maintenance tools	
	2.5.2 Simple maintenance	32
2.6	RCI - 4-way cassette	33

	2.6.1 Installation advantages	33
	2.6.1.1 New Air Panel line-up	36
	2.6.2 Functional features	39
2.7	RCIM - 4-way cassette (compact)	43
	2.7.1 Installation advantages	43
	2.7.2 Functional features	45
	2.7.3 Maintenance benefits	47
2.8	RCD - 2-way cassette	48
	2.8.1 Installation advantages	48
	2.8.2 Functional features	
2.9	RPC - Ceiling type	51
	2.9.1 Installation advantages	
	2.9.2 Functional features for RPC-FSR series	
2.10	RPI - Indoor ducted unit	55
	2.10.1 Installation advantages	55
	2.10.2 Functional features	
	2.10.3 Maintenance benefits	63
2.11	RPK - Wall type	66
	2.11.1 Installation advantages	66
	2.11.2 Functional features	
	2.11.3 Using one single remote control switch (wire or wireless)	70
	2.11.4 Maintenance benefits	71
2.12	RPF - Floor type, RPFI - Floor concealed type	72
	2.12.1 Installation advantages	72
2.13	DX-Interface Series 2	73
	2.13.1 Installation facilities	73
2.14	KPI and KPI Active series 4E - Ventilation systems	84
	2.14.1 Active KPI	
2.15	Econofresh air renewal unit	93
3.	General data	99
3.1	General data	100
	3.1.1 RCI-FSR - 4-way cassette	
	3.1.2 RCIM-FSRE - 4-way cassette (compact)	
	3.1.3 RCD-FSR - 2-way cassette	
	3.1.4 RPC-FSR - Ceiling type	
	3.1.5 RPI(L/H)-FSRE - Indoor ducted unit	
	3.1.6 RPI-FSN6E-EF - Indoor ducted unit for Econofresh assembly	
	3.1.8 RPK - Wall type	
	3.1.9 RPF - Floor type and RPFI - Floor concealed type	
	3.1.10 KPI Units	
	3.1.11 Econofresh kit	
	3.1.12 DX-Interface	122
	3.1.13 Adjusted capacities of indoor units	122

3.2	Component data	123
	3.2.1 RCI-FSR - 4-way cassette	123
	3.2.2 RCIM-FSRE - 4-way cassette (compact)	
	3.2.3 RCD-FSR - 2-way cassette	124
	3.2.4 RPC-FSR - Ceiling type	126
	3.2.5 RPI - Indoor ducted unit	127
	3.2.6 RPK - Wall type	
	3.2.7 RPF - Floor type and RPFI - Floor concealed type	
	3.2.8 KPI Units	132
3.3	Electrical data	133
	3.3.1 Considerations	133
	3.3.2 RCI - 4-way cassette	
	3.3.3 RCIM - 4-way cassette (compact)	
	3.3.4 RCD - 2-way cassette	
	3.3.5 RPC - Ceiling type	
	3.3.6 RPI - Indoor ducted unit	
	3.3.7 RPK - Wall type	
	3.3.8 RPF(I) - Floor type	
4.	System selection procedure	137
4.1	System selection procedure	138
4.2	Sensible heat correction factor (SHF)	141
4.3	RPI Fan performance	142
	4.3.1 RPIL-(0.4-1.5)FSRE	142
	4.3.2 RPI-(1.5-6.0)FSRE	
	4.3.3 RPIH-(4.0-6.0)FSRE	
	4.3.4 RPI-(4.0-6.0)FSN6E-EF	
	4.3.5 RPI-(8.0-20.0)FSN3(P)E-(-f)	145
4.4	Temperature distribution diagrams	148
	4.4.1 RCI-(1.0-6.0)FSR - 4-way cassette	148
	4.4.2 RCIM (0.4-2.5)FSRE - 4-way cassette (compact)	150
	4.4.3 RCD-(0.8-6.0)FSR - 2-way cassette	152
	4.4.4 RPC-(1.5-6.0)FSR - Ceiling type	154
	4.4.5 RPK-(0.4-4.0)FSR(H)M - Wall type	155
4.5	Selection procedure for KPI	156
	4.5.1 Selection guide	156
	4.5.2 Calculation of heat exchanger efficiency	157
	4.5.3 KPI energy	158
4.6	Selection procedure for Econofresh	160
	4.6.1 Ducting arrangement	160
	4.6.2 Maximum capacity of the Free Cooling system (Economizer)	162
	4.6.3 Outdoor cooling mode (All Fresh)	162
4.7	Selection procedure for DX-interface	163
	4.7.1 Cycle design evaporating and condensing temperatures	164
	4.7.2 DX-Interface series 2 applications and control mode	164
4.8	Communication network compatibility	165
	VII   TCGB0137 rev.1 - 07/2021	
	VII   100b0137 16V.1 - 07/2021	

5.	Acoustic characteristic curves	167
5.1	Overall sound level	168
5.2	Sound pressure	169
	5.2.1 RCI-(1.0-6.0)FSR - 4-way cassette	
	5.2.2 RCIM-(0.4-2.5)FSRE - 4-way cassette (compact)	
	5.2.3 RCD-(0.8-6.0)FSR - 2-way cassette	
	5.2.4 RPC-(1.5-6.0)FSR - Ceiling type	
	5.2.5 RPI(L/H)-FSRE and RPI-FSN(3/6)(P)E-(-f/EF) - Indoor ducted unit	
	5.2.6 RPK-(0.4-4.0)FSR(H)M - Wall type	184
	5.2.7 RPF-(1.0-2.5)FSN2E - Floor type	188
	5.2.8 RPFI-(1.0-2.5)FSN2E - Floor concealed type	189
	5.2.9 KPI	
	5.2.9.1 KPI energy recovery series	
	5.2.9.2 KPI Active series	192
5.3	Sound power	193
	5.3.1 RPI(L/H)-FSRE and RPI-FSN(3/6)(P)E-(-f/EF) - Indoor ducted unit	193
6.	Working range	199
6.1	Working range	200
0.1		
	6.1.1 Power supply	
	6.1.3 Relative Humidity limit	
	6.1.4 DX Interface working range	
7.	General dimensions	203
7.1	Dimensions	204
	7.1.1 RCI-(1.0-6.0)FSR - 4 way cassette	
	7.1.2 RCIM-(0.4-2.5)FSRE - 4-way cassette (compact)	
	7.1.3 RCD-(0.8-6.0)FSR - 2-way cassette	
	7.1.4 RPC-(1.5-6.0)FSR - Ceiling type	
	7.1.5 RPI(L/H)-(0.4-6.0)FSRE - Indoor ducted unit	
	7.1.6 RPI-(4.0-6.0)FSN6E-EF - Indoor ducted unit for Econofresh assembly	219
	7.1.7 RPI-(8.0-20.0)FSN3(P)E(-f) - Indoor ducted unit for Econofresh assembly	220
	7.1.8 RPK-(0.4-4.0)FSRM / RPK-(0.4/1.5)FSRHM with expansion valve kit EV-1.5N1- Wall type	222
	7.1.9 RPF-(1.0-2.5)FSN2E - Floor type	
	7.1.10 RPFI-(1.0-2.5)FSN2E - Floor concealed type	
	7.1.11 KPI-(252-2002)(E/X)4E - Energy recovery and active energy recovery ventilation units	
	7.1.12 DX-Interface	
	7.1.13 Econofresh Kit	238
7.2	Operation and service space	239
	7.2.1 RCI-(1.0-6.0)FSR - 4-way cassette	239
	7.2.2 RCIM-(0.4-2.5)FSRE - 4-way cassette	
	7.2.3 RCD-(0.8-6.0)FSR - 2-way cassette	
	7.2.4 RPC-(1.5-6.0)FSR - Ceiling type	
	7.2.5 RPI(L/H)-(0.4-6.0)FSRE - Indoor ducted unit	
	7.2.6 RPI-(4.0-6.0)FSN6E-EF - Indoor ducted unit for Econofresh assembly	
	7.2.7 RPI-(8.0-20.0)FSN3(P)E(-f) - Indoor ducted unit	
	7.2.8 RPK-(0.4-4.0)FSR(H)M - Wall type	∠ეგ

	7.2.9 RPF-(1.0-2.5)FSN2E - Floor type	260
	7.2.10 RPFI-(1.0-2.5)FSN2E - Floor concealed type	
	7.2.11 KPI-(252-2002)(E/X)4E - Energy recovery and active energy recovery ventilation units	
	7.2.12 DX-Interface	
	7.2.13 Econofresh kit	262
8.	Refrigerant cycle	263
8.1	All models except RPK-FSRHM	264
8.2	RPK-FSRHM only	264
9.	Piping work and refrigerant charge	265
9.1	Refrigerant	266
	9.1.1 Refrigerant charge	266
9.2	Refrigerant piping selection	266
9.3	Multikits and distributors	267
	9.3.1 For Heat Pump system (2 pipes) - Line branch	267
	9.3.2 For Heat Pump system (2 pipes) - Header branch	269
	9.3.3 For Heat recovery system (3 pipes) - Line Branch	
	9.3.4 For Heat recovery system (3 pipes) - Header branch	
9.4	Copper pipes, sizes, connection and insulation	
	9.4.1 Copper pipes and sizes	
	9.4.2 Pipe connection	
	9.4.3 Insulation of the Multi-Kits and/or branches	
9.5	Precautions in the event of gas refrigerant leaks	
	9.5.1 General notes R32 refrigerant	
0.0	9.5.2 General notes R410A refrigerant	
9.6	General remarks for drain pipe connection	
9.7	DX-Interface refrigerant charge and piping length limits	277
10.	Electrical and control settings	281
10.1	General instructions	282
10.2	DIP switches settings and functions	283
	10.2.1 Considerations	283
	10.2.2 Indoor units	283
	10.2.3 KPI units	
	10.2.4 DX-Interface settings	288
10.3	Setting of remote control switch for RPI-(16.0/20.0)FSN3PE(-f)	291
10.4	Outdoor and indoor units wiring	291
	10.4.1 Outdoor and Indoor units layouts for UTOPIA	
	10.4.2 Outdoor and Indoor units layouts for SET FREE	
	10.4.3 Connection diagram of SET FREE and RPI-(16.0/20.0)FSN3PE(-f) Indoor Unit	295
10.5	Power circuit sizing	296

	10.5.1 Minimum requirements of the wiring size and protection devices	296
10.6	DX-Interface electrical wiring	297
	10.6.1 Control box terminal board	297
	10.6.2 Expansion valve box terminal board	298
	10.6.3 Terminal board connections and remarks	298
	10.6.4 Remote temperature thermistor (THM-R2AE) for DX-Interface	300
	10.6.5 Installation of the remote controller (PC-ARFP1E)	300
10.7	Econofresh electrical wiring connection	301
	10.7.1 Input signal ports	301
	10.7.2 Optional sensor connection	301
	10.7.3 RPI-(4.0-6.0)FSN6E-EF Printed circuit board details	
	10.7.4 Sensors position	303
10.8	Motion Sensor control conditions	304
	10.8.1 Motion sensor setting through PC-ARFP1E Remote Control switch	305
	10.8.2 Descriptions of Motion Sensor Control Condition	306
	10.8.3 Detecting Area for Human Activity	
	10.8.4 Restrictions on the Connection of Motion Sensor and Indoor Units	
	10.8.5 Restrictions on the Connection of Motion Sensor and Remote Control Switch	309
10.9	System Control	310
	10.9.1 Individual Operation	310
	10.9.2 Simultaneous Operation	311
	10.9.3 Different Refrigerant Cycles control	
	10.9.4 Wiring Examples	312
11.	Optional functions	313
11.1	Main optional functions on indoor units	314
11.2	Main optional functions on KPI	315
11.3	Main optional functions on DX-Interface series 2	316
	11.3.1 DX-Interface series 2 - Input / Output signals	
	11.3.2 Thermo - On / Off control option	317
11.4	Optional remote control functions	318
11.5	Econofresh signal control logic	338
	11.5.1 Econofresh enthalpy sensor – E2	338
	11.5.2 CO <sub>2</sub> gas sensor – E4	338
	11.5.3 Compatibilities between optional signals	338
11.6	Optional functions in the PSC-A64S central control	339

### **1.** General information

### Index

1.1	General information	2
	1.1.1 Introduction	2
1.2	Applied symbols	3
1.3	Norms and Regulations	3
1.4	Product classification and line-up	4
	1.4.1 Classification of indoor unit models	4
	1.4.2 Classification of KPI models	4
	1.4.3 Classification of DX-Interface models	4
	1.4.4 Classification of Econofresh models	4
	1.4.5 Product line-up: indoor units	5
	1.4.6 Product line-up: KPI energy recovery unit	10
	1.4.7 Product line-up: DX-Interface	10
	1.4.8 Product line-up: Econofresh	10
	1.4.9 Accessory code list	11
	1.4.10 Multi-Kits	13
	1.4.11 Individual remote controls	13
	1.4.12 Receiver kit for combination with wireless remote control switch	14
	1.4.13 Centralised remote controls	
	1.4.14 Building air conditioning controls	15
	1.4.15 Gateways for building management systems (BMS)	
	1.4.16 Control support devices	17
	1.4.17 Control accessories	17

### 1.1 General information

© Copyright 2021 Johnson Controls-Hitachi Air Conditioning Spain, S.A.U. - All rights reserved.

No part of this publication may be reproduced, copied, filmed or transmitted in any shape or form without the permission of Johnson Controls-Hitachi Air Conditioning Spain, S.A.U.

Within the policy of continuous improvement of its products, Johnson Controls-Hitachi Air Conditioning Spain, S.A.U. reserves the right to make changes at any time without prior notification and without being compelled to introduce them into products previously sold. This document may therefore have been subject to amendments during the life of the product.

Hitachi makes every effort to offer correct, up-to-date documentation. Despite this, printing errors cannot be controlled by Hitachi and are not its responsibility.

As a result, some of the images or data used to illustrate this document may not refer to specific models. No claims will be accepted based on the data, illustrations and descriptions included in this manual.

No type of modification must be made to the equipment without prior, written authorization from the manufacturer.

### 1.1.1 Introduction

Hitachi offers the SYSTEM FREE range of indoor units, the main advantage of which is that they can be combined with UTOPIA and SET FREE series outdoor units.

This eliminates the need to duplicate models of indoor units and reduces stock.

SYSTEM FREE Line up of Indoor Units	Complementary systems
RCI-FSR RCIM-FSRE RCD-FSR RPC-FSR RPIL-FSRE RPI-FSRE RPIH-FSRE RPI-FSN6E-EF RPI-FSN3(P)E(-f) RPK-FSR(H)M RPF-FSN2E RPFI-FSN2E	KPI-(E/X)4E DX-Interface EXV-E2 Econofresh EF-456N1E

### 1.2 Applied symbols

During normal heat pump system design work or unit installation, greater attention must be paid in certain situations requiring particular care in order to avoid damage to the unit, the installation or the building or property.

Situations that pose a risk to the safety of those in the surrounding area or to the unit itself are clearly indicated in this manual.

A series of special symbols are used to clearly identify these situations.

Pay close attention to these symbols and to the messages following them, as your safety and that of others depends on it.



### DANGER

- The text following this symbol contains information and instructions relating directly to your safety, in addition to hazards or unsafe practices which could result in severe personal injuries or death.
- Not taking these instructions into account could lead to serious, very serious or even fatal injuries to you and others in the proximities of the unit.

In the texts following the danger symbol you can also find information on safe procedures during unit installation.



- The text following this symbol contains information and instructions relating directly to your safety, in addition to hazards or unsafe practices which could result in minor personal injury or product or property damage
- Not taking these instructions into account could lead to minor injuries to you and others in the proximities of the unit.
- Not taking these instructions into account could lead to unit damage.

In the texts following the caution symbol you can also find information on safe procedures during unit installation.



- The text following this symbol contains information or instructions that may be of use or that require a more thorough explanation.
- Instructions regarding inspections to be made on unit parts or systems may also be included.

### 1.3 Norms and Regulations

Following Regulation EU Nº 517/2014 on Certain Fluorinated Greenhouse gases, it is mandatory to fill in the label attached to the unit with the total amount of refrigerant charged on the installation.

Do not vent R32 into the atmosphere: R32 is fluorinated greenhouse gas covered by the Kyoto protocol global warming potential (GWP) R32 = 675.

Do not vent R410A into the atmosphere: R410A are fluorinated greenhouse gases covered by the Kyoto protocol global warming potential (GWP) R410A = 2088.

Tn of CO<sub>2</sub> equivalent of fluorinated greenhouse gases contained is calculated by indicated GWP \* Total Charge (in kg) indicated in the product label and divided by 1000.

### Appropriate refrigerant

The refrigerant used in each unit is identified on the specification label and manuals of the unit. Hitachi shall not be held liable for any failure, trouble, malfunction or accident caused by units illegally charged with refrigerants other than the specified one.

#### Consequences of charging non-specified refrigerant

It may cause mechanical failure, malfunction and other accidents.

It may cause operational failure of protection and safety devices of air conditioners.

It may also cause lubrication failure of the sliding part of the compressor due to deterioration of refrigerant oil.

In particular, hydrocarbon refrigerants (such as propane, R441A, R443A, GF-08, etc.) are not allowed, since these are combustible and may cause major accidents such as fire and explosion in case of improper handling.

Once a non-specified refrigerant has been charged, no further servicing (including draining of refrigerant) shall be performed, even in case of malfunction. Improper handling of refrigerant may be a cause of fire and explosion, and servicing in such cases may be considered an illegal act.

End clients and costumers shall be informed that servicing is not approved, and the installer who charged the nonspecified refrigerant shall be asked to fix the unit.

Hitachi will accept no responsibility for units that have been charged with non-specified refrigerant once.

### 1.4 Product classification and line-up

### 1.4.1 Classification of indoor unit models

```
Unit type (indoor unit): RCI, RCIM, RCD, RPC, RPIL, RPI, RPIH, RPK, RPF, RPFI
           Position-separating hyphen (fixed)
               Capacity (HP): 0.4, 0.6, 0.8, 1.0, 1.5, 2.0, 2.5, 3.0, 4.0, 5.0, 6.0, 8.0, 10.0, 16.0, 20.0
                     FS = SYSTEM FREE
                          R = R32 / R410A refrigerant
                          N = R410A refrigerant
                                 H = Hotel (RPK-(0.4-1.5) only)
                                       2/3/6 = series
                                             P= Pair
                                                   E = Made in Europe
                                                   M = Made in Malaysia
                                                   - = Made in Japan or China
                                                         (-f) = Non-flammable insulation (RPI-(8.0-20.0)FSN3(P)E-f only)
                                                         (-EF) = Ducted indoor unit for econofresh assembly (RPI-(4.0-6.0)FSN6E-EF only)
               X.X FS
                                 (H)
                                       Χ
                                             (P) (X) (X)
                          (X)
```

### 1.4.2 Classification of KPI models

```
KPI- Ventilation system
        Position-separating hyphen (fixed)
               Capacity (m3/h): 250, 500, 800, 1000, 1500, 2000
                       2 = 1~ 230V 50Hz
                               E = Energy recovery
                               X = Active (Energy recovery + R410A DX section)
                                      4 = series
                                              E = Made in Europe
 KPI
                         2
```

### 1.4.3 Classification of DX-Interface models

```
DX-Interface type
        Position-separating hyphen (fixed)
                Capacity (HP): 2.0, 2.5, 3.0, 4.0, 5.0, 6.0, 8.0, 10.0
                        E = Made in Europe
                                2 = series
EXV
                 X.X
                                  2
```

### 1.4.4 Classification of Econofresh models

```
Econofresh unit type
        Position-separating hyphen (fixed)
                Capacity (HP): 4.0, 5.0, 6.0
                       N: R410A refrigerant
                               1 = series
                                       E = Made in Europe
                                         Ε
                 456
```

### 1.4.5 Product line-up: indoor units



- The indoor unit models and codes are the last updated at time of publication; other previous models and coming developments could be available for combination with the outdoor unit series.
- Check the exact classification for each unit (model, type, power and series) in "1.4.1 Classification of indoor unit models".

### **RCI and RCIM indoor units**

RCI ( R32 / R410A )		RCIM ( R32 / R410A )		
*		*		
4-way c	assette	4-way casset	te (compact)	
Unit	Code	Unit	Code	
		RCIM-0.4FSRE (*1)	7E414148	
		RCIM-0.6FSRE (*2)	7E414137	
		RCIM-0.8FSRE	7E414100	
RCI-1.0FSR	70405301	RCIM-1.0FSRE	7E414101	
RCI-1.5FSR	70405302	RCIM-1.5FSRE	7E414102	
RCI-2.0FSR	70405303	RCIM-2.0FSRE	7E414103	
RCI-2.5FSR	70405304	RCIM-2.5FSRE	7E414104	
RCI-3.0FSR	70405305			
RCI-4.0FSR	70405307			
RCI-5.0FSR	70405308			
RCI-6.0FSR	70405309			
Pa	nel	Panel		
P-N23NA2 (without Motion Sensor)	70532000	P-AP56NAM (without Motion Sensor)	70533000	
P-AP160KA3 (Standard panel without Motion Sensor, black)	60279337	P-AP56NAMS (Motion Sensor embedded)	70533100	
P-GP160NAP (Iconic panel, white)	60297331	P-AP56NAMR (Receiver kit embedded)	70533500	
P-GP160KAP (Iconic panel, black)	60297334			
P-GP160NAPU (Iconic panel, with elevating grille)	60297339			

### i NOTE

- The RCI and RCIM models must be used in combination with the indicated panels.
- (\*1): Follow the detailed information about the combinability and restrictions for 0.4 HP Indoor Units, which can only be used in combination with current SET FREE Mini (RAS-(4-6)FS(V)NME, RAS-(8-12)FSXNME) and SET FREE (RAS-FSXNSE, RAS-FSXNPE).
- (\*2): 0.6 HP Indoor Units can only be used in combination with SET FREE Mini (RAS-(4-6)FS(V)NME, RAS-(8-12)FSXNME) and SET FREE (RAS-FSXNSE, RAS-FSXNPE).

### **♦ RCD and RPC indoor units**





- The RCD models must be used in combination with the indicated panels.
- (\*): 1 indoor unit combinations with UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium series not allowed.

#### ♠ RPI indoor units





- (\*1): Follow the detailed information about the combinability and restrictions for 0.4 HP Indoor Units, which can only be used in combination with current SET FREE RAS-FSXNSE, RAS-FSXNPE and SIDE FLOW RAS-FS(X)NME.
- (\*2) 0.6 HP Indoor Units can only be used in combination with SET FREE RAS-FSXNSE and RAS-FSXNPE series and SIDE FLOW RAS-FS(X)NME.
- (\*3): In combination with UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium series: 1 indoor unit system only.
- (\*4): RPI-FSN3PE(-f) can only be used in combination with SET FREE FSXNSE, FSXNPE series.



### **♦ RPK, RPF and RPFI indoor units**


RPK ( R32 / R410A )		RPF ( R410A ) RPFI ( R410A )		R410A)	
		*	*		
	1 ~				
Wall ty	ре	Floor	type	Floor conce	ealed type
Unit	Code	Unit	Code	Unit	Code
RPK-0.4FSRM (*1)	60279204				
RPK-0.4FSRHM (*1)	60279221				
RPK-0.6FSRM (*2)	60279205				
RPK-0.6FSRHM (*2)	60279222				
RPK-0.8FSRM	60279206				
RPK-0.8FSRHM	60279223				
RPK-1.0FSRM	60279207				
RPK-1.0FSRHM	60279224	RPF-1.0FSN2E	7E450001	RPFI-1.0FSN2E	7E460001
RPK-1.5FSRM	60279208				
RPK-1.5FSRHM	60279225	RPF-1.5FSN2E	7E450002	RPFI-1.5FSN2E	7E460002
RPK-2.0FSRM	60279209	RPF-2.0FSN2E (*3)	7E450003	RPFI-2.0FSN2E (*3)	7E460003
RPK-2.5FSRM	60279210	RPF-2.5FSN2E (*3)	7E450004	RPFI-2.5FSN2E (*3)	7E460004
RPK-3.0FSRM	60279211				
RPK-4.0FSRM	60279212				
Expansion valve kit (*4)					
EV-1.5N1 (*4)	60921792				

- (\*1): Follow the detailed information about the combinability and restrictions for 0.4 HP Indoor Units, which can only be used in combination with current SET FREE Mini (RAS-(4-6)FS(V)NME, RAS-(8-12)FSXNME) and SET FREE (RAS-FSXNSE, RAS-FSXNPE).
- (\*2): 0.6 HP Indoor Units can only be used in combination with SET FREE Mini (RAS-(4-6)FS(V)NME, RAS-(8-12)FSXNME) and SET FREE (RAS-FSXNSE, RAS-FSXNPE).
- (\*3) 1 indoor unit combinations with UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium series not allowed.
- (\*4) For RPK-(0.4-1.5)FSRHM models only.

### 1.4.6 Product line-up: KPI energy recovery unit



### 1.4.7 Product line-up: DX-Interface

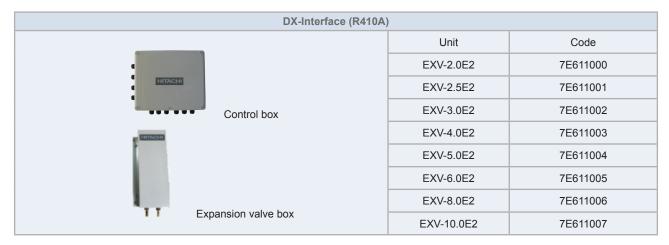

### 1.4.8 Product line-up: Econofresh





The EF-456N1E unit can only be installed in combination with the following units:

- RPI-4.0FSN6E-EF (7E426027)
- RPI-5.0FSN6E-EF (7E426028)
- RPI-6.0FSN6E-EF (7E426029)

### 1.4.9 Accessory code list

Hitachi has a wide range of accessories and remote control systems that can be used with the SET FREE and UTOPIA outdoor units. Consult the Technical Catalogue for controls and for the corresponding outdoor units.

Name	Unit reference	Description	Code	Figure
PD-75A	RCI-FSR		60291763	
PD-75C	RCIM-FSRE	Duct adapter for fresh outdoor air intake kit	60292014	
PD-150D	RCD-FSR		60292064	
OACI-160K2	RCI-FSR	Fresh outdoor air intake kit	60291761	
TKCI-160K	RCI-FSR	T-shaped duct connection kit for fresh outdoor air intake kit	60291762	
PDF-71C1	RCI-(1.0-2.5)FSR	Duct connecting flange for indoor air	60299436	
PDF-160C1	RCI-(3.0-6.0)FSR	outlet	60299437	
PI-160LS1	RCI-FSR	3-way outlet parts set	60291756	
B-160H2	RCI-FSR	Filter Box (Adapter for deodorising filter)	60291759	
F-71L-D1	RCI-(1.0-2.5)FSR	Doodoront oir filter	60291757	
F-160L-D1	RCI-(3.0-6.0)FSR	Deodorant air filter (installation on the Filter Box B-160H2)	60291758	
B-90HD	RCD-(0.8-3.0)FSR	Filter Box	60292061	
B-160HD	RCD-(4.0-6.0)FSR	(Adapter for antibacterial long life air filter)	60292062	
F-90MD-K1	RCD-(0.8-3.0)FSR	Antibacterial long life air filter high performance filter (installation on the filter box F-90MD-K1→B-90HD	60292058	
F-160MD-K1	RCD-(4.0-6.0)FSR	F-160MD-K1→B-160HD)	60292059	
F-56LPC1	RPC-(1.5-2.0)FSR		60299279	
F-90LPC1	RPC-(2.5-3.0)FSR	Long life filter (Installation on the indoor unit)	60299280	
F-160LPC1	RPC-(4.0-6.0)FSR	(otaliation on the macor anit)	60299281	
DUPC-63K1	RPC-1.5FSR		60291935	A
DUPC-71K1	RPC-2.0FSR	Drain-up Mechanism	60291936	
DUPC-160K1	RPC-(2.5-6.0)FSR		60291937	

Name	Unit reference	Description	Code	Figure	
SOR-MSK	RPI-FSRE RCI-FSR		70590912	THOM	
PS-MSK2	RCI-FSR		70590903		
SOR-NEP	RPC-FSR	Motion sensor kit	60291825		
SOR-NEC	RCIM-FSRE		70590904		
SOR-NED	RCD-FSR		60292055		
SLT-30- 200-L600	KPI-502(X/E)4E		70550200	-	
SLT-30- 250-L600	KPI-802(X/E)4E		70550201		
SLT-30- 300-L600	KPI-1002(X/E)4E	Noise damper	70550202	WW.	
SLT-30- 355-L600	KPI-(1502-2002)E4E		70550203		
HEF-252			70552201	mile.	
HEF-502			70552202		
HEF-802	KPI	High efficiency filter	70552203		
HEF-1002	KFI	riigh emclency iller	70552204		
HEF-1502	]		70552205		
HEF-2002			70552206		
D-ICA15R	RPIL-(0.4-1.5)FSRE		7E590912	-	
D-ICA20R	RPI-(1.5-2.0)FSRE	Inlet change accessory	7E590913	-	
D-ICA30R	RPI-(2.5-3.0)FSRE		7E590914	-	
D-ICA60R	RPI-(4.0-6.0)FSRE		7E590915	-	
D-DGK15R	RPIL-(0.4-1.5)FSRE	Drain gravity kit	7E590916	-	

### 1.4.10 Multi-Kits

Name	Description	Code	Figure
E-102SN4		70524201	
E-162SN4		70524202	
E-242SN3		70524104	
E-302SN3		70524105	
MW-NP2682A3		60292295	
E-52XN3	Line Branch	70525100	
E-102XN3		70525101	
E-162XN3		70525102	
E-202XN3		70525103	
E-242XN3		70525104	
E-322XN3		70525106	
MH-84AN1		70522009	
MH-108AN	Header Branch	70522008	2444444
MH-108XN		70523108	

### 1.4.11 Individual remote controls

Name	Description	Code	Figure
PC-ARFP1E	Remote control with timer	70510003	191004    0
PC-ARH1E	Simplified remote control	70510004	**************************************
PC-AWR	Wireless remote control	60291969	

### 1.4.12 Receiver kit for combination with wireless remote control switch

Receiver kit name	Indoor unit application	Compatible wireless remote control	Code	Figure		
on the panel						
PC-ALH3	RCI-FSR	PC-AWR	60291767	• 50		
PC-ALHC1	RCIM-FSRE	PC-AWR	70590906			
PC-ALHD1	RCD-FSR	PC-AWR	60292053	000		
PC-ALHP1	RPC-FSR	PC-AWR	60291823	HITACHI  ONE AND ON A D  ON O		
		on the wall				
PC-ALHZ1	RPI(L/H)-FSRE(-EF) RPI-FSN(3/6)(P)E(-f) RPF(I)-FSN2E RCI-FSR RCIM-FSRE RCD-FSR RPK-FSR(H)M RPC-FSR	PC-AWR	60292245	PLAN © INCOCO DEF © (INCOCO) PLIDE (INCOCO) TRACE (INCOCO)		

### 1.4.13 Centralised remote controls

Name	Description	Code	Figure
PSC-A64GT	Touch screen central station	60291730	HENCH EN S
PSC-A32MN	Touch screen central station mini	60291966	HTMOH TO T
PSC-A64S	Centralised remote control	60291479	NATACHI GUG
PSC-A16RS	Centralised ON/OFF control	60291484	Tentral Distriction

### 1.4.14 Building air conditioning controls

Name	Description	Code	Figure
CSNET Manager 2 T10	Centralised control with a touch interface of 10 inches which runs CSNET Manager 2 software to control the indoor units.	7E512203	
CSNET Manager 2 T15	Centralised control with a touch interface of 15 inches which runs CSNET Manager 2 software to control the indoor units.	7E512206	THE CONTRACTOR OF THE CONTRACT
CSNET Manager 2 SL	Centralised control interface screen-less which runs CSNET Manager 2 software to control the indoor units.	7E512204	
CSNET Lite	Centralised control which runs CSNET Lite software to control the indoor units in a small installations.	7E512205	T A STATE OF THE S
HC-A64NET	H-LINK gateway used by CSNET Manager Screens to communicate with indoor units (Max. 64 indoor units)	7E512200	Name of the second

### 1.4.15 Gateways for building management systems (BMS)

Name	Description	Code	Figure	
HC-A16MB	Integration with installation with intelligent control (Building Management System) Gateway Interface to MODBUS systems (Max. 16 indoor units).	7E513210		
HC-A64MB	Integration with installation with intelligent control (Building Management System) Gateway Interface to MODBUS systems (Max. 64 indoor units).	7E513205	Miles	
KNX001	Integration with installations with intelligent control (BMS) through CSNET WEB. Gateway Interface to KNX systems.	7E5121000	MACH SER	
HI-AC-KNX-16	Integration with installations with intelligent control (BMS) through CSNET Manager 2 and CSNET Lite. Gateway Interface to KNX systems.	70513303	Mill mades	
HI-AC-KNX-64	Integration with installations with intelligent control (BMS) through CSNET Manager 2 and CSNET Lite. Gateway Interface to KNX systems.	70513304	= = = = = = = = = = = = = = = = = = =	
HARC-BX E (A)	Integration with installation with intelligent control (Building Management System) Gateway Interface to LONWORKS systems. (H-LINK I communication) (Max. 64 units with 8 parameters)	60290874		
HARC-BX E (B)	Integration with installation with intelligent control (Building Management System) Gateway Interface to LONWORKS systems. (H-LINK I communication) (Max. 32 units with 16 parameters)	60290875		
HI-AC-BAC-16	BACnet gateway connectable to HC-A16MB	70513100		
HI-AC-BAC-64	BACnet gateway connectable to HC-A64MB	70513101		

### 1.4.16 Control support devices

Name	Description	Code	Figure
PSC-A1T	Programmable timer	60291482	HTYACHI schwarza sowwarzi
PSC-6RAD	H-LINK RAC Adapter	60063017	
PC-A1IO	Integration of external equipment into H-LINK	7E519000	
PSC-5HR	H-LINK Relay	60291105	CONTRACTOR
PC-AMTB	Connection board for multitenant buildings	7E519200	in the second
THM-R2AE	Remote temperature sensor (THM4)	7E299907	.9

### 1.4.17 Control accessories

Name	Description	Code	Figure
Wall support 2	Wall mounted support (for both CSNET Manager 2 T10 / T15)	7E512302	
Stand support	Stand mounted support (for both CSNET Manager 2 T10 / T15)	7E512301	
Din rail	Standard din rail for CSNET Lite	7E512303	1 00 1
PCC-1A	Optional function connector	70590901	
PRC-10E1	2P-Extension cord (10 metres)	7E790211	
PRC-15E1	2P-Extension cord (15 metres)	7E790212	
PRC-20E1	2P-Extension cord (20 metres)	7E790213	
PRC-30E1	2P-Extension cord (30 metres)	7E790214	
Net Configuration Kit	Net configuration kit for HC-A(8/64)MB and HC-A64NET	7E512306	THE PARTY OF THE P

## Features and benefits

### Index

2.1	Benefits of the choice	21
	2.1.1 Choice range	21
	2.1.2 Remote control range	22
	2.1.3 Flexible system	23
2.2	Installation advantages	24
	2.2.1 Easy and flexible communication between units	24
2.3	Start-up benefits	26
	2.3.1 Automatic start-up	26
	2.3.2 Service verification	27
2.4	Functional benefits	28
	2.4.1 Indoor units	28
	2.4.2 Improvement of optional functions for fan stop in Thermo-off conditions	28
	2.4.3 Improvement of Automatic COOL/HEAT Operation	29
	2.4.4 Motion sensor control	30
2.5	Maintenance benefits	32
	2.5.1 Availability of maintenance tools	32
	2.5.2 Simple maintenance	32
2.6	RCI - 4-way cassette	33
	2.6.1 Installation advantages	33
	2.6.1.1 New Air Panel line-up	36
	2.6.2 Functional features	39
2.7	RCIM - 4-way cassette (compact)	43
	2.7.1 Installation advantages	43
	2.7.2 Functional features	45
	2.7.3 Maintenance benefits	47
2.8	RCD - 2-way cassette	48
	2.8.1 Installation advantages	48
	2.8.2 Functional features	49
2.9	RPC - Ceiling type	51
	2.9.1 Installation advantages	51
	2.9.2 Functional features for RPC-FSR series	52

RPI - Indoor ducted unit	55
2.10.1 Installation advantages	55
2.10.2 Functional features	61
2.10.3 Maintenance benefits	63
RPK - Wall type	66
2.11.1 Installation advantages	66
2.11.2 Functional features	67
2.11.3 Using one single remote control switch (wire or wireless)	70
2.11.4 Maintenance benefits	71
RPF - Floor type, RPFI - Floor concealed type	72
2.12.1 Installation advantages	72
DX-Interface Series 2	73
2.13.1 Installation facilities	73
KPI and KPI Active series 4E - Ventilation systems	84
2.14.1 Active KPI	92
Econofresh air renewal unit	93
	2.10.1 Installation advantages.  2.10.2 Functional features.  2.10.3 Maintenance benefits.  RPK - Wall type  2.11.1 Installation advantages.  2.11.2 Functional features.  2.11.3 Using one single remote control switch (wire or wireless).  2.11.4 Maintenance benefits.  RPF - Floor type, RPFI - Floor concealed type.  2.12.1 Installation advantages.  DX-Interface Series 2.  2.13.1 Installation facilities.  KPI and KPI Active series 4E - Ventilation systems.  2.14.1 Active KPI.

### 2.1 Benefits of the choice

### 2.1.1 Choice range

### Wide range of indoor units

Hitachi indoor units have a wide range of capacities from 0.4 to 20.0 HP.

The capacity of each indoor unit is flexible; they are set to the maximum possible capacity by default, and can be easily adjusted to precise lower values in line with installation requirements (depending on the model).

SYSTEM FREE																				
Model			Capacity (HP)  0.4   0.6   0.8   1.0   1.3   1.5   1.8   2.0   2.3   2.5   3.0   4.0   5.0   6.0   8.0   10.0   16.0   20.0																	
	Model		0.4 (*2)	0.6 (*1)	0.8	1.0	1.3	1.5	1.8	2.0	2.3	2.5	3.0	4.0	5.0	6.0	8.0	10.0	16.0	20.0
	RCI-FSR 4-way cassette					•	•		•		•		•	•	•	•				
	RCIM-FSRE 4-way cassette (compact)		•	•	•	•	•		•		•									
	RCD-FSR 2-way cassette				•	•	•		•		•			•	•	•				
	RPC-FSR Ceiling type						•		•		•			•	•	•				
	RPIL-FSRE Indoor ducted unit (Low external static pressure)		•	•	•	•		•												
	RPI-FSRE Indoor ducted unit (Medium external static pressure)							•		•		•	•	•	•	•				
	RPIH-FSRE Indoor ducted unit (High external static pressure)												•	•	•	•				
	RPI-FSN6E-EF Indoor ducted unit for Econofresh												•	•	•	•				
	RPI-FSN3E Indoor ducted unit (High external static pressure)																•	•		
	RPI-FSN3PE Indoor ducted unit (High external static pressure)																		(**)	(**)
	RPK-FSR(H)M Wall type		•	•			•		•		•		•							
	RPF-FSN2E Floor type						•		•		•									
	RPFI-FSN2E Floor concealed type						•		•		•									

- Constant capacity unit.
- Unit whose capacity can be set one step lower, marked with , using the DIP switch.
- Unit whose capacity can be set one step higher, marked with , using the DIP switch.

### i NOTE

- (\*1): 0.6 HP Indoor Units can only be used in combination with SET FREE Mini (RAS-(4-6)FS(V)NME, RAS-(8-12)FSXNME) and SET FREE (RAS-FSXNSE, RAS-FSXNPE).
- (\*2): Follow the detailed information about the combinability and restrictions for 0.4 HP Indoor Units, which can only be used in combination with current SET FREE Mini (RAS-(4-6)FS(V)NME, RAS-(8-12)FSXNME) and SET FREE (RAS-FSXNSE, RAS-FSXNPE).
- (\*\*) RPI-FSN3PE can only be used in combination with RAS-FSXNSE and RAS-FSXNPE series.

### 2.1.2 Remote control range

Hitachi has a range of remote control systems classified according to the type of management and the number of units being managed:

- Individual remote control systems.
- Centralised remote control systems.
- Building air conditioning systems.
- Building management systems BMS (Building Management System).

### **Individual remote control systems**

The individual remote control systems, whether they are wireless or connected directly by cable, have a wide range of functions for easier unit management, the programming of specific settings or the identification of incidents. Recommended for managing a small number of units.

### Remote controls and wireless receiver kits

Wire remote control switch PC-ARFP1E



Wireless remote control



Wireless Receiver Kit

on the wall

on the panel





### i NOTE

- 1 RCI-FSR, RCIM-FSRE, RCD-FSR and RPC-FSR: Wireless remote controller can be used only with the addition, easily, the properly receiver kit in the Indoor Units.
- 2 Wireless Receiver Kit on the wall needs a switch box.
- 3 RPK-FSR(H)M

The built-in receiver can be used only for a single operation and individual operations. However, it cannot be used for the following

- Operation with 2 Remote Control Switches (wireless and wired remote control switch PC-ARFP1E). This is because the switch "SW2" on the dip switch PCB must be set "WIRED" when using PC-ARFP1E.
- · Simultaneous Operation of Multiple Units.
- 4 When using the wireless remote control switch for simultaneous operation, the receiver kit (on the wall) is required (sold separately as an option). SW2 must be set "WIRED".

### **Centralised remote control systems**

The centralised remote control systems combine the functions of the remote controls and extend the management and setting possibilities for several air conditioning systems distributed around the entire floor of a building.



### **Computerised remote control systems**

Computerised remote control systems multiply management and setting possibilities, allowing these to be carried out from any point of the local communications network via a two-core, non-polarity cable or even over the internet.

Recommended for managing more than two floors of a building independently.



### Building Management System (BMS)

Integration into installations with intelligent management. Gateway interface with Lonworks BMS, KNX, MODBUS BMS and BACnet BMS systems.




### 2.1.3 Flexible system

#### ♦ Combination of different units

The indoor units of the SYSTEM FREE series can be combined as appropriate in both UTOPIA and SET FREE systems to create the most appropriate air conditioning system for each room.

The variety of capacities and mounting accessories largely facilitate installation design. Furthermore, unit management through any of the remote control systems available means that the total performance of the system is optimised.



### **◆** Adapting the capacity of each unit using the DIP switches

In some situations, it is handy to be able to adjust the capacity of the indoor units to adapt them to actual installation requirements (as show the table in section: "Wide range of indoor units").

The power of each indoor unit in the SYSTEM FREE range can be set precisely using a DIP switch located on the circuit board.

The DIP switch allows for more precise on-site adjustments to be made to the installation after mounting is complete, during start-up or at any time, optimising the total performance of the system.

### Unit management through the range of remote controls

As well as the normal functions available on remote controls, the Hitachi range of SYSTEM FREE indoor units includes simultaneous management functions for groups of units.

- It is possible to use one remote control for each indoor unit or just one remote control, arranging the indoor units in control groups (e.g. from 1 to 16 units in each group).
- The built-in safety functions keep the timer running in the event of problems with the power supply (including power cuts lasting several weeks).

The management functions also include the solving of any incident that may arise.

- Automatic check for incident solving that provides real-time information through an alarm code.
- Incident codes displayed on the remote control screen where an operating anomaly arises. Detailed information is also displayed on these codes.

### 2.2 Installation advantages

### Installation work optimisation

The Hitachi installation system is one of the most flexible and easy to install in the market, providing substantial savings in costs of installation, start up and throughout its working life, including maintenance work.

The different members of the SYSTEM FREE group of indoor units include commonly installed parts, thus making installation work simpler and requirements for material less.

### **♦ Reduction and standardising of installation pipe diameters**

During the design process of the SYSTEM FREE indoor units, the necessary connection pipe diameters have been standardised wherever possible. Therefore, most indoor units use connection pipes of similar diameters for the entire installation, thus making installation work easier.

Depending on system configuration and components used, it is possible to configure the entire installation of an air conditioning system using a maximum of two or three different pipe diameters.

### Longer pipes between outdoor and indoor units

The distance between units is no longer a determining factor and has become a factor that favours freedom of design in air conditioning installations. The design of the outdoor units means that indoor units can be installed at a greater distance.

The possibility of installing indoor units further away offers greater decision-making autonomy and means that the most favourable location can be chosen. Depending on the model, the distance between both units may be up to 165 metres.

Nor is it necessary to install connection pipes between outdoor units of the same system, thus simplifying installation work.

### 2.2.1 Easy and flexible communication between units

### Complete communication

The indoor units maintain active communications between them, with the outdoor units and with the control systems over a communication line (bus) called H-LINK II. Thus, the performance of each unit, among other aspects, is adapted to the circumstances at all times and remains the most appropriate in each situation.

### ♦ H-LINK II bus

### **Easy connection**

The communication bus is formed by a pair of small-diameter cores with no specific polarity. Given that no multi-way communication cables are used, the installation is simple, fast and effective. The connections cannot be confused.

The two-core non-polarity communication bus provides significant savings in terms of materials and installation, as the same cable is used for all the units and is quickly and simply connected directly to them.

#### **Long distance**

The total length of the communication bus between all the units can reach 1000 m. If the communication line must be longer (e.g. to expand the air conditioning system or to manage the units from a unified station in the building), the total distance can be extended to 5000 m by using the accessories available.

### **Auto-configuration of system units**

The air conditioning system control systems are auto-configuring. They recognise the type of unit they are connected to, along with the type of indoor unit and its capacity. The installation is started quickly and efficiently.


It is also possible to configure all units manually to adjust the installation in line with personalised parameters.

### Up to 160 units connected together in a single H-LINK II bus line

It is possible to connect up to 160 indoor units and up to 64 refrigerant cycles from the SYSTEM FREE range in a single H-LINK II bus line. To expand the installation or increase the bus lines available, simply add a new line.

All units are managed as one through the control systems installed.

Example of the H-LINK II system:



Specifications							
Transmission cable:	2 conductors						
Transmission cable polarity:	No polarity						
Maximum number of outdoor units connected:	64 units per H-LINK II system						
Maximum number of indoor units connected:	160 units per H-LINK II system						
Maximum number of devices:	200						
Maximum wiring length:	Total 1000 m (5000 m (*))						
Recommended cable:	Shielded twisted pair cable over 0.75 mm <sup>2</sup> (equivalent to KPEV-S)						
Voltage:	5 V DC						



- When the H-LINK II bus is used, the DIP switches must be adjusted. Otherwise, or if incorrectly adjusted, a transmission problem may
- The H-LINK II system offers great flexibility for the design of air conditioning systems, as installation is simple and the total cost affordable. Furthermore, centralised management is possible by connecting the CSNET Manager 2 system to the H-LINK II network cables.
- Additionally, it is possible to manage the installation over the internet using the CSNET Manager 2.
- (\*) Using 4 H-LINK relays PSC-5HR (sold separately as an option).

### **Fast connection of new units**

Extending the air conditioning system is now even easier. To add new units to the communication bus, simply connect its two cores to the communication terminals.

The new units added to the bus line are recognised by the control system and are automatically configured.

### Remote controller switch application

One indoor unit can be controlled separately by two wired remote control switches (sold separately as an option).

One remote control switch (sold separately as an option) can start/stop up to 16 indoor units.


### No need for remote control relay wiring in UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium systems in simultaneous operation

In the case of UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium systems comprising several indoor units (up to 4 indoor units), the indoor units set to simultaneous operation can be controlled from a single remote controller, without the need to link them up with dedicated remote control relay wiring.

A: Service cable.

B: Dedicated cable for remote control relay, not required when units are set to simultaneous operation.

The indoor units must be H-LINK II-compatible models.



### 2.3 Start-up benefits

### 2.3.1 Automatic start-up

The installation is started up automatically, therefore considerably reducing the time required for the process.

There are three types of start-up:

- Test run and identification of the units forming the system.
- Test run from the remote control.
- Test run from the outdoor unit.


### Test run and identification of the system units

The test run can be carried out from either the rotating DIP switches on the outdoor unit or from the remote control for the indoor unit.

The seven-segment indicator on the outdoor unit provides all of the information required to check the system is operating properly.

The units forming part of the system are identified separately for the outdoor and indoor units:

- Outdoor units: the remote control can be use to allocate the series to which the operational outdoor units belong (e.g. single or multiple series).
- Indoor units: using the rotating DIP switch on each unit.



#### Test run from the remote control

Three operations for the test run are possible from the remote control:

- 1 Auto-diagnostic: quick check of the operating conditions of the indoor units and outdoor unit.
- 2 Data memory guery: in the event of an alarm, the remote control saves all the operating parameters of the unit at that particular time and the screen displays the corresponding fault code. The air conditioning system diagnostic is simple and effective.
- 3 Optional function setting: the remote control is able to make settings on up to 29 possible options, such as the four-degree offset in heating mode or the increase in fan speed. It is possible to set several indoor units at the same time and to modify the unit configuration once installation is complete.



### Test run from the outdoor unit

The seven-segment indicator on the outdoor unit displays parameters relating to its working order.

Any incident arising during start-up or normal operation can be diagnosed from the indicator.

#### 2.3.2 Service verification


#### System operation control

The working order of the system is continuously monitored through the control system. All operating parameters that the system uses to manage the outdoor and indoor units are continuously supervised.

#### Assisted-management air conditioning system

The air conditioning system can be conveniently managed using the Hitachi Service Tools assisted-management software.

This software allows for a laptop, for example, to be connected to the air conditioning system via an interface connected to the H-LINK II bus. Through different menus, the software effectively manages all of the systems connected and obtains data for optimised system performance.



All of the data obtained using Hitachi Service Tools is collected in different formats and monitored in several ways. The software user can configure the processing of the data to monitor the parameters of most interest in each installation and allows reporting of the logged data, exporting each of its screens in different ways.

The data reports can be used to continuously check the correct working order of the system. Any deviation in the ranges of foreseen values is immediately detected.

Additionally, Service Tools adds the option to control the units remotely, helping the user to evolve its test without moving away of his computer and it is possible to configure its optional functions from Service Tools without the need to perform further setup on each unit.

Service Tools can be updated online using an internet connection. If properly configured and registered, Service Tools will check for new updates and advise the user to download them.

# 2.4 Functional benefits

#### 2.4.1 Indoor units

The design of the fans in the SYSTEM FREE range of indoor units reduces the friction of the air forced by the blades. The aim is to improve the air discharge and its flowing over the supply blades. The result is a reduction in consumption and in noise emissions from the electric fan motors.

#### 2.4.2 Improvement of optional functions for fan stop in Thermo-off conditions

#### Heating mode. Fan stop in Thermo-OFF conditions

Existing optional functions E8 and CE for fan stop in Thermo-OFF conditions are improved.


#### **Optional Function setting:**

- "E8=01": Fan stop operation in Thermo-OFF conditions when using THM-R2AE (connected to the THM4 port on the IU PCB)
- "CE=01": Fan stop operation in Thermo-OFF conditions when using the PC-ARFP1E sensor ("C8=01" must be set in this case)

# Previous behaviour of the unit with "E8/CE=01"

With the previous software, when the indoor unit was started (ON operation in heating mode) being already in Thermo-OFF conditions, the fan was turned on and kept running all the time, even if these optional functions were set.


The fan was stopped only once the unit was in a shifting sequence from Thermo-ON to Thermo-OFF.

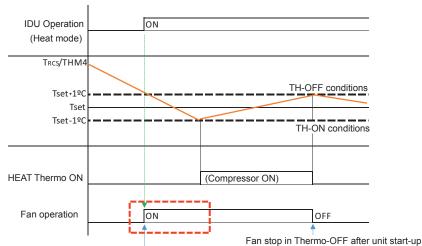

Fan operation even Thermo-OFF because initial unit start-up

# Behaviour of the unit with "E8/CE=01"

Now the fan will not be turned on when the indoor unit is switched on in Thermo-OFF conditions.

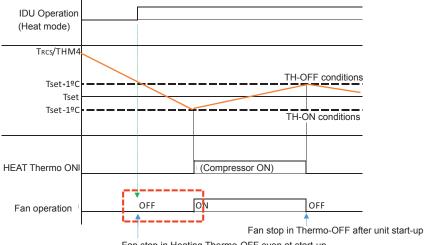

Fan stop in Heating Thermo-OFF even at start-up




- These functions are only available when using the remote control sensor (in PC-ARFP1E) or the remote sensor (THM-R2AE).
- Note: When using CE function:
  - "C8=00": this setting is not permitted.
  - "C8=02": this setting is not recommended since it may cause that comfort conditions are never reached (C8 set at 02 means that unit control is carried out with the average value of the remote control sensor and the air inlet sensor of the indoor unit).
- In case that Automatic louver is set, the louver will keep operating in both Thermo-ON and Thermo-OFF conditions.

# **Cooling mode. Fan stop in Thermo-OFF conditions**

This optional function keeps the fan stopped when the indoor unit is in Thermo-OFF conditions, even upon start-up.

# **Optional Function setting:**

"Cd=01": Fan stop operation in Thermo-OFF conditions when using the additional remote temperature sensor THM-R2AE (connected to THM4) or PC-ARFP1E temperature sensor ("C8=01" setting is recommended in this case).

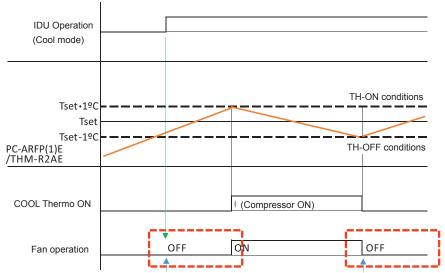

Fan stop in Cooling Thermo-OFF even at start-up



It is advised to pay attention to the following points:

- Do not set this function if no remote control sensor (in PC-ARFP1E) or remote sensor (THM-R2AE) are installed; otherwise, comfort conditions may never be reached.
- Do not set "Cd" function when indoor unit temperature control is based on:
  - "C8=00": Temperature control with the air inlet sensor of the indoor unit.
  - "C8=02": Temperature control with the average value of the remote control sensor and the air inlet sensor of the indoor unit. In these cases, comfort conditions may never be reached.
- In case that Automatic louver is set, the louver will keep operating in both Thermo-ON and Thermo-OFF conditions.


# 2.4.3 Improvement of Automatic COOL/HEAT Operation

By improving differential temperature for automatic COOL/HEAT operation, it is possible to perform polite and responsive operation and more comfortable air conditioned environment is realized.

Differential Temperature (T)	2°C
------------------------------	-----

(T): Temperature difference between "SET TEMP" and "Room Air TEMP".

#### Control Flow of AUTO Mode

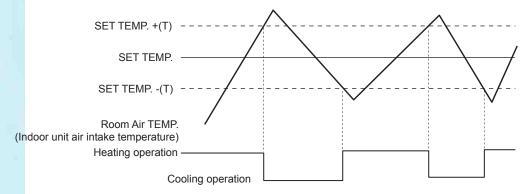

This function allows the system to be switched automatically to COOL/HEAT mode based on the difference between the temperature setting and the temperature of the suction air. If the intake air exceeds the temperature setting by 2°C, the system will switch to COOL mode and, if it is 2°C less than the temperature setting, the system will switch to HEAT mode.

#### 2.4.4 Motion sensor control

The air conditioning capacity is saved automatically depending on a situation and detecting amount of human activity by adopting the motion sensor on the corner of the air panel.

The energy-saving can be improved more with the individual operating function. In addition, the operation can be stopped automatically if the absent situation continues for more than 30 minutes (1).

The motion sensor allows maintaining the comfortable indoor environment and eliminating the unnecessary operation (2).

The motion sensor control adjusts automatically the following items depending on a situation:

- Setting temperature: is adjusted 1°C or 2°C for energy saving.
- · Air flow volume: is adjusted to lower one volume or to "Slo" (except during the dry operation).
- · Air flow directions: is adjusted to horizontal.

# **i** NOTE

- (1): The default setting is "30 minutes". However, the setting is changeable.
- (2): The default setting is "Running Operation". However "Automatic Stop" can be selected by setting from the remote control switch.

The following indoor units can adopt the Motion Sensor function:

RCI-FSR		
RCIM-FSRE(*)	Using Motion Sensor Kit (sold separately as an option)	Wire remote control PC-ARFP1E (Required, sold separately as an option)
RPC-FSR		
RCD-FSR	(Sold Separately as an option)	(required, sold separately as all option)
RPI-FSRE		



(\*) Air panel with embeded motion sensor (P-AP56NAMS) is available for RCIM-FSRE units.

The motion sensor kit is only combinable with UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium, Centrifugal VRF and SET FREE FSXNSE and FSXNPE and SET FREE Mini series.

# **◆ Effect of Energy-Saving by Motion Sensor**


In the case of the motion sensor being set as "ON" by the remote control switch and comparing with the temperature setting before adjusting the operation as shown below (at cooling mode):

- The power consumption can be reduced max 7% by adjusting 1°C increased.
- The power consumption can be reduced max 14% by adjusting 2°C increased.

#### **Sequence of Detection by Motion Sensor**

Detect the infrared variation by the sensor element Generate the analog voltage to the appropriate infrared variation Convert the analog voltage to the digital signal by the threshold

#### **Sequence of Controlling Motion Sensor at Indoor Unit**

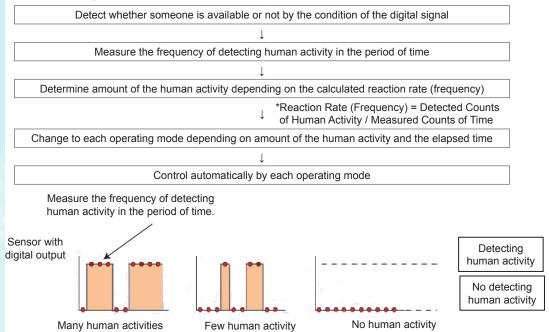

#### 2.5 Maintenance benefits

# 2.5.1 Availability of maintenance tools

#### ♦ Hitachi Service Tools

All of the functions of the Hitachi Service Tools software can also be used for unit maintenance (preventive or corrective). Any incident can be quickly detected and solved in a shorter time.

The CSNET WEB system is also a powerful tool that is extremely useful for maintenance work.

Hitachi has a range of different remote control systems that can be used with the SET FREE and UTOPIA outdoor units. Consult the corresponding Technical Catalogue for controls.



#### Monitoring the system and simplifying maintenance work

The Hitachi Service Tools software is a very powerful tool for the control and management of air conditioning installations. To do so, it supervises the working order of the entire system and displays data that allows for potential incidents to be detected.

Management via software improves the advanced scheduling of planned technical stoppages and means that any unit can be inspected without altering the operation of the air conditioning system. The data obtained is processed and interpreted directly by the software, without the need to waste time or personnel on data reading or on-site checks.

# Decrease in operation costs

Monitored operation allows for real-time observation of the performance of the entire air conditioning system. The control system is responsible for ensuring all parts work according to the foreseen conditions, with the maximum performance and efficiency at all times. In this situation, the utmost benefit is obtained from the entire installation at minimum operation costs.

Any range of values tending to be outside that foreseen is an indication of a situation that must be corrected as quickly as possible. The management software clearly displays situations of this type and, therefore, is an interesting ally for reducing costs generated by extraordinary maintenance stoppages.

The more in-depth analysis of the tendencies offers a starting point for realistic maintenance schedules, adapted to the operating conditions of each system.

#### 2.5.2 Simple maintenance

#### Optimised design to simplify maintenance

The components of the indoor units of the entire range have a strong, long-lasting design bearing in mind the demanding requirements of the market insofar as maintenance cost reduction.

The interior structure of the units and the layout of the internal parts make any removal and assembly operations easier where technical work is required for some reason.

#### ♦ Minimum or zero maintenance

All units and components of the SYSTEM FREE range of indoor units have been designed for simple, easy maintenance operations.

#### Absence of replacement consumable

Parts subject to inspection are practically inexistent throughout the range. On some specific models, only the regular long-term replacement of the air and deodorising filters is required. Consumable or replacement parts are not required.

# **♦ Loyal to the Hitachi philosophy**

The indoor units of the SYSTEM FREE range have been designed in line with Hitachi philosophy to guarantee the highest reliability and reduce maintenance work to an essential minimum.

# 2.6 RCI - 4-way cassette






Hitachi recommends PC-ARFP1E remote control (sold separately as an option) in order to obtain the maximum RCI-(1.0-6.0)FSR

#### 2.6.1 Installation advantages

These compact units featuring a low height are suitable for installation in narrow spaces behind false ceilings: the units measure only 248 mm (1.0-2.5 HP) and 298 mm (3.0-6.0 HP) in height, which places them among the smallest in the market.



Flexibility of installation to high ceiling: The availability of four fan speeds ("HIGH 2", "HIGH", "MED" and "LOW) allows to obtain a proper airflow from units installed in high ceilings, even without the need to set up the optional high speed mode (C5).

Different ceiling heights can be effectively covered by selecting the appropriate fan speed in the remote controller:

Supported ceiling height (With PC-ARFP1E or PC-AWR remote control switch)				
High Speed Mode (C5) Air Flow Volume Mode 1 to 3HP 4 and 5HP				
Standard	HIGH	2.7m	3.2m	
(00)	HIGH 2	3.5m	4.2m	

Additionally, the "High Speed Mode (C5)" setting allows to fix different airflow volumes for each fan speed, making use of the five different airflow volume modes (HH2, HH1, Hi, Me and Lo) handled internally by the 4-way cassette units.

The High Speed Mode is selected thought the optional functions C5 from the remote control switch. If the High Speed Mode (C5) is set as High Speed 2 (setting 02), the air flow volume of "HIGH 2" and "HIGH" will be equaled as shown in the table, because the air flow volume, "HIGH 2" and "HIGH" are used as "HH2" in high speed 2 setting.

	Air flow volume mode selected by remote controller			
High Speed Mode (C5)	HIGH 2 HIGH MED LOW			
Standard (00)	HH2	Hi	Me	Lo
High Speed 1 (01)	HH2	HH1	Hi	Me
High Speed 2 (02)	HH2	HH2	HH1	Hi

In the case of using the sold separately as an option filter (except the long life filter), the high speed mode setting is required.

Less need for housing space in ceilings for new installations and renewed units: the size of the opening required in the ceiling has been modified from the usual 910 mm to a range of between 860 and 910 mm, which means a smaller hole is required in the ceiling.





The minimum installation space is 860 mm. A 910 mm hole should be made for easier installation.

- Flexible unit installation: Installation is notably easier thanks to the unit mounting system. The distance between its suspension points at each corner of the unit is 760 mm.
- The direction in which the unit is installed can be easily modified to adapt to the pipe run, the positions of the unit fixing points do not have to be modified.
- The simple design, even for continuous installations, means that refrigerating pipes and drain hoses can be run along different corners for easier distribution and improved installation efficiency.
- The space between the drain pipe connection and the refrigerant pipe connections improves access during installation work.
- Equipped with a drain pump to force condensates up to 850 mm in height in relation to the unit. The pump is automatically enabled when the accumulated water level is too high.

 $A: \le 300 \text{ mm } (A + B + C \le 1100 \text{ mm}).$ 


Standard panel size: the size of the panels has been standardised to 950 mm in width to make them easy to swap with other, different capacity models.






A: refrigerant pipe connection

B: drain pipe connection

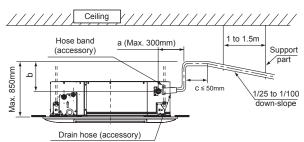



Unit height easily adjustable from each corner: each of the four corners of the air panel includes access for easy adjustment of the height of the unit without having to remove the panel.

A: unit cabinet.


B: air panel.


C: access for height adjustment.



The unit can be precisely lined up with the ceiling -arrow by moving the structure up or down using the set screws accessible on the four corners.

The electrical connection for the air panel is located inside the air inlet grille on the unit. The electrical box cover does not have to be opened to connect the



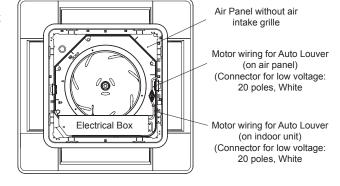

# 2.6.1.1 New Air Panel line-up

There is available a new Air Panel line up with 5 options (sold separately as an option)

Air Panel Model	Additional Information	Picture
P-N23NA2	Without Motion sensor	
P-AP160KA3	Standard panel without Motion Sensor, black	
P-AP160NAP	Iconic panel, white	
P-AP160KAP	Iconic panel, black	
P-GP160NAPU	Iconic panel with elevating grille	

All panel are suitable to install for the entire RCI-FSR indoor unit line-up.

# ◆ Iconic panel P-GP160NAPU with elevating grille

When combining PC-ARFP1E or later wired controller, the elevating setting is automatically set by connecting the wiring of the elevating grille.

It is possible to switch the descent distance of the air inlet grille in 7 steps up to 4 m, that can be set through d7 function:


d7	Descent distance
01	1.0 m
02	1.5 m
03	2.0 m
04	2.5 m
05	3.0 m
06	3.5 m
07	4.0 m



- In case of 2 controllers, the elevating grille batch setting can be set only from the main controller.
- Make sure that the unit operation is stopped before using the elevating grille. The elevating grille function is not available when the unit is operated.


# **Elevating grille operation**

Select "Elevating Grille" from the "Menu" and press "OK".

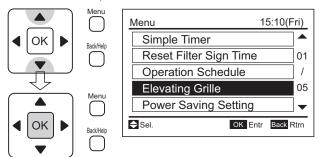

If the number of indoor unit connected with the controller is 1, step 3 will be displayed after the procedure (1).

2 Select the indoor unit by pressing " $\triangle$ ", " $\nabla$ ", " $\triangleleft$ " or " $\triangleright$ ". Press "OK".




3 Press "∇". The elevating grille starts lowering.

Once " $\nabla$ " is pressed, the elevating grille lowers to the specified height.


If " $\nabla$ " is pressed once again, the elevating grille lowers by 50cm from the present height. (When " $\nabla$ " is pressed each time, the elevating grille lowers respectively by 50cm.)

To stop the elevating grille, press " $\triangle$ ".



When the cleaning is finished, press " $\triangle$ ".


The elevating grille starts rising. The grille will be set inside the air panel and stopped moving after 3 seconds. (If the air inlet grille is inclined at this time, press "△" again. An inclination may be corrected.)




5 Press "Back/Help". The screen will return to (2). (If necessary, set the elevating grille for other indoor units.)

To finish the setting, press "Back/Help" again. The screen will return to the menu.

If "Back/Help" is pressed once again, the screen will return to the normal mode.








- If the number of indoor unit connected with the controller is 1 (one), the screen will return to the normal mode after "Back/Help" is
- It is possible to raise or lower the grille through an input signal. An output signal is available to indicate when the grille goes up and down.


#### 2.6.2 Functional features


The conditioned air is evenly distributed in all directions thanks to the widening effect achieved by the optimized design of the fan and the air panel. In addition, individual control of each louver allows a precise control of the orientation of the discharge air flow.



Intelligent louver closure system

When the unit is stopped, the louvers return to their horizontal position and the air outlet closes to avoid the accumulation of dust or particles of dirt. The louvers closed horizontally give the unit an elegant image when it is switched off.







Silent running

The low sound pressure level, 27 dB(A) on RCI(1.0-2.0) HP models at low speed is achieved through the use of a DC motor (1) for the fan and a new vibration-proof structure on the turbo fan shaft (2). Both parts protect the turbo fan from generating and emitting abnormal noise.

The following table shows the sound pressure levels, expressed in dB(A).





Sound pressure level - Standard operation dB(A)				
Fan speed setting				
Model	High 2	High	Medium	Low
RCI-1.0FSR	33	30	28	27
RCI-1.5FSR	35	31	30	27
RCI-2.0FSR	37	32	30	27
RCI-2.5FSR	42	36	32	28
RCI-3.0FSR	42	36	32	28
RCI-4.0FSR	48	43	39	33
RCI-5.0FSR	48	45	40	35
RCI-6.0FSR	48	46	41	37

#### Drive motors with PWM management

The electric motors in the SYSTEM FREE indoor units are the main beneficiaries of the functional and construction studies carried out. The technologies applied to each type of unit are, of the entire range of possibilities, the most suitable in each case. For example, application of DC motors with PWM ( Pulse Width Modulation) management on the supply fans of the RCI(M) models reduces energy consumption by half. In this case, where the range of working hours of the air supply motors is relatively high, a considerable amount of energy is saved.


Furthermore, there is a significant improvement in noise comfort, as the electronic management allows for very precise setting values for each situation.

A: electricity.

B: current.

C: voltage.

T: time.



Reduced current consumption thanks to the use of DC motors


A: motor efficiency (%).

DC: direct current motor.

AC: alternating current motor.

In comparison with conventional products that use an AC motor, the DC fan motor significantly improves operating efficiency. Furthermore, DC motor rotation speed management means that the formation of gusts in the forced air are reduced.

The motor is fitted with a rotor with a ferrite magnetic surface, a centralised coil and a split core to reduce electricity consumption. All aspects of motor efficiency have been improved: it is 50% smaller and lighter than the motors used in conventional units.




# Energy Saving

Adopting High Performance Heat Exchanger, High Efficient Turbo Fan, DC Drain Pump and Motion sensor.

#### Adopting high performance heat exchanger

The high energy-saving operation is realized to adopt a high performance high efficiency heat exchanger with a smaller pipe diameter (Ø5 mm) and an innovative fin design has been adopted. This, together with the 3D twisted blade turbo fan and the electrical power saving, DC motor driven drain pump, results in a remarkable improvement in energy-saving operation.





# Adopting a high efficient turbo fan

High efficiency turbo-fan is adopted. By improving 3D twisted blade of turbo-fan and air outlet, the fan efficiency is improved and the low noise performance is achieved.

# **Adopting a DC Drain Pump**


Lower electrical power drain pump with DC motor is equipped in these indoor units as standard.

#### **Adopting Motion Sensor Function**

Improvement of Energy-Saving Operation by adopting Air Panel with Motion Sensor


The motion sensor function can adjust the setting temperature according to the human activity, and it controls the air flow volume and the air flow direction.

The energy-saving is improved by combining the motion sensor function and the individual operating function comparing with the standard operation.

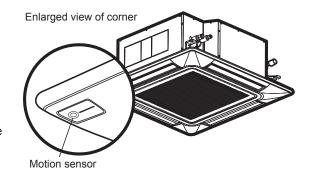


# **Easy Motion sensor kit installation**

The motion sensor comes mounted on a corner pocket that can be attached to any of the corners of the panel. The user can freely choose the place of attachment of the sensor, where it better fits specific needs. The installation of the motion sensor is completed by just connecting the relay wire to CN10 in the electrical box.




# **Louver structure**

A louver structure has been adopted to avoid vertical air flow and soften the discomfort by the temperature irregularity and the cold draft.




# Individual control setting for each louver

The individual control setting for each louver is available through the PC-ARFP1E remote control menu, allowing to select easily the louver direction for each ones of the four louvers. Refer to the PC-ARFP1E Installation and Operation Manual.




# Reduction of pressure loss at the discharge outlet. Improvement of the shape of the discharge

The shape of the discharge outlet has been reviewed to restrain the occurrence of unnecessary swirls, thus reducing pressure loss. In the picture can see the distribution of the air floe in a section view of the discharge outlet.

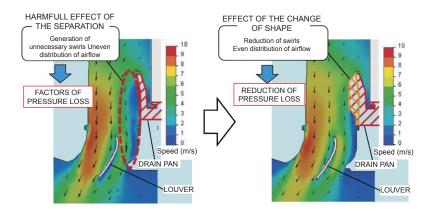

# **Improved coanda effect**

The renewed design of the panel louvers and the shape of air outlets improves the Coanda effect, resulting in better comfort for the users, since the direct incidence of cold airflow is avoided.



# Wide Range Air Flow Volume Setting

The air flow volume 4 taps setting is adopted in order to have a more comfortable installation.

RCI	
4 Taps	
HIGH 2(*)	
HIGH	
MED	
LOW	

(\*) Available through the PC-ARFP1E or PC-AWR remote control switch without additional setting.

# **♦ Larger diameter of drain plug**

The maintainability is improved because the VP25 drain plug diameter is adopted. (outer diameter ø32 mm)

# 2.7 RCIM - 4-way cassette (compact)





Hitachi recommends PC-ARFP1E remote control (sold separately as an option) in order to obtain the maximum RCIM-(0.4-2.5)FSRE performance.


# 2.7.1 Installation advantages


- The mini version of the RCIM series keeps the reduced height of the larger models, which makes them fit for installation in narrow spaces behind false ceilings; with just 295 mm in height, these are among the smallest units available in their class.
- Adaptable to high ceilings: this model has been adapted for installations in high ceilings of up to 3.5 m.

Domata control actions	Ceiling height (m)		
Remote control setting	(0.4-1.5) HP	(2.0 - 2.5) HP	
Standard	Below 2.5	Below 2.7	
Speed increase 1	2.5 to 2.9	2.7 to 3.1	
Speed increase 2	2.9 to 3.2	3.1 to 3.5	


Suitable for being installed in a narrow space, like powder room, between ceiling lights, in a grid ceiling with a 600mm x 600mm opening without cutting the grid.







- Standard panel size: the size of the panels has been standardised to 620 mm in width.
- The unit measurements (570 x 570 mm) mean that standard European panels measuring 600 x 600 mm can be used.



#### New Air Panel line-up


There is available a new Air Panel line up with 3 options (sold separately as an option)

Panel		
P-AP56NAM (Without Motion Sensor)		
P-AP56NAMS (Motion Sensor embedded)		
P-AP56NAMR (Receiver kit embedded)		

All panel are suitable to install for the entire RCIM-FSRE indoor unit line-up

#### Light-weight Unit

Compared with the standard 4-Way Cassette Type indoor unit, the weight of this compact model has been reduced approximately 4kg. This makes the transportation and installation much easier.





RCIM-(0.4-2.5)FSRE

RCI-(1.0-2.5)FSR

#### Adjustable Grille Direction

As the grille size is also small, the grille direction can easily be adjusted even after the unit installation. The grille direction can be changed by 90 degrees.






- The simple design, even for continuous installations, means that refrigerating pipes and drain hoses can be run along different corners for easier distribution and improved installation efficiency.
- The space between the drain pipe connection and the refrigerant pipe connections improves access during installation work.


A: refrigerant pipe connection.


B: drain pipe connection.



These indoor units come equipped with a High-lift DC drainup mechanism as standard. High-lift pump makes it possible to raise the drain pipe straight up, up to 850mm from the false ceiling surface.





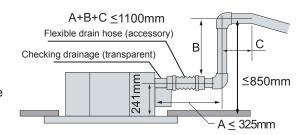

#### Easier Height Adjustment

Unit height easily adjustable from each corner: each of the 4 corners of the air panel includes access for easy adjustment of the height of the unit without having to remove the panel.


A: unit cabinet.

B: air panel.

C: access for height adjustment.



The unit can be precisely lined up with the ceiling -arrow- by moving the structure up or down using the set screws accessible on the four




#### 2.7.2 Functional features

#### ◆ Improvement of Energy-Saving

The energy-saving is improved by developed the a high performance heat exchanger, the high efficient turbo fan, the DC drain pump and motion sensor are adopted.

# **Adopting High Performance Heat Exchanger**

High performance & high efficiency heat exchanger (Ø5 mm pipe tubes + advanced design fins)



#### **DC Drain Pump**

Lower electrical power drain pump with DC motor is adopted.

#### **Improvement of Energy-Saving Operation by Adopting Motion Sensor**

The motion sensor function can adjust the setting temperature according to the human activity and it controls the air flow volume and the air flow direction.

The energy-saving is improved by combining the motion sensor function and the individual operating function comparing with the standard operation.



#### **Louver structure**

A structured silky flow louver that softens the discomfort by temperature irregularity and cold draft is adopted.

# ◆ Flexibility of Installation to High Ceiling

The air flow volume "HIGH 2" is added which is larger than "HIGH".

#### **Drain Pan**

Adopting the Antibacterial Agent and Larger Diameter of Drain Plug which inhibit the generation of slime, and the maintainability is improved.


# ♦ Low Noise (Top-class Sound Pressure Level) and High Efficient Turbo Fan

The adoption of the high efficiency turbo-fan and the improvement of 3D twisted blade of turbo-fan and air outlet, the fan efficiency is improved and the low noise performance is achieved.

The low sound pressure level, at low speed, is achieved through the use of a DC motor for the fan and a vibration-proof structure on the turbo fan shaft. Both parts protect the turbo fan from generating and emitting abnormal noise.


# **♦ Highly Compact Size**

Compact RCIM-4-way cassete and their panel have been designed for a reduced size that allows the installation into a narrow space.

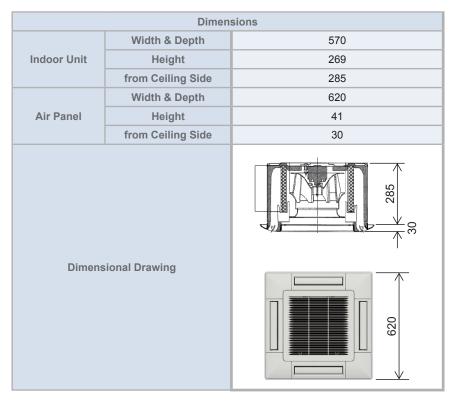

# **New Design & High Specification Air Panel**

- Simple and Stylish design
- 4-way individual louver
- Full closed
- The panel, simple and stylish design, has 4 way individual louver setting. The renewed design of the panel louvers and the shape of air outlets improves the Coanda effect, resulting in better comfort for the users, since direct incidence of cold air flow is avoided.



Horizontal air outlet flow

# **♦ Wide Range Air Flow Volume Setting**

The air flow volume 4 taps setting is adopted in order to have a more comfortable installation.

RCIM
4 Taps
HIGH 2(*)
HIGH
MED
LOW


(\*) Available through the PC-ARFP1E or PC-AWR remote control switch without additional setting.

# 2.7.3 Maintenance benefits

#### **Easy cleaning**

The even distribution of air is guaranteed thanks to the design of the wide supply louvers that also prevent dirt from accumulating on the surface of the ceiling, avoiding unpleasant stains on the air outlets.

The flat surface of the louvers is stain-resistant and very easy to clean.



#### **RCIM Stain-Resistance Louver**

Cleaning of the louvers has become easier thanks to the adoption of a design without non-woven fabric at the rear side.

Dirt and smudge adhered to the louver can be easily wiped off.

# Simple maintenance

You do not have to remove the entire air inlet panel to check the drainage system or carry out an emergency drain. Simply open the air inlet grille.

# **Mould protection**

The condensate drain pan has mould protection, which is applied during the manufacturing process.



The mould protection lasts for approximately one to two years. An additional mould protection product must be applied after this time.

# 2.8 RCD - 2-way cassette






Hitachi recommends PC-ARFP1E remote control (sold separately as an option) in order to obtain the maximum RCD-(0.8-6.0)FSR


# 2.8.1 Installation advantages

The 2-way version of ceiling cassette is also suitable for installation behind false ceilings with narrow spaces.




Improvement of Drain Pump

High-lift DC drain pump makes it possible to raise the drain pipe straight up, up to 850mm from the false ceiling surface.

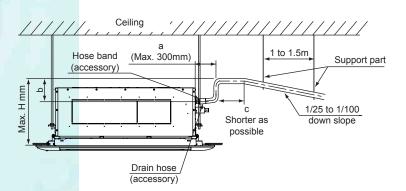


Max. Lift Height (H)	850
Max. Length (a+b+c)	1100

Perfect adaptation of the air panels in any ceiling. The panels protrude by just 30 mm to blend in perfectly with the ceiling. Furthermore, an additional space is provided to adapt to panel ceilings.



Easier Height Adjustment. The unit height can be adjusted from 4 corner pockets, with the air panel attached to the unit. Height adjustment from the corner pockets is suitable for fine adjustment. To keep the unit level, avoid significant height adjustment.



#### 2.8.2 Functional features


#### **♦ Improvement of Energy-Saving**

The high performance heat exchanger and reduction of airflow loss, high efficient turbo fan & DC fan motor are adopted. Additionally the energy-saving is improved by adopting the motion sensor.

The energy-saving is improved by the development of the heat exchanger and reducing of airflow loss and the turbo fan, and adopting the motion sensor.

The motion sensor function can adjust the setting temperature according to the human activity and it controls the air flow volume and the air flow direction.

The energy-saving is improved by combining the motion sensor function and the individual operating function comparing with the standard operation.

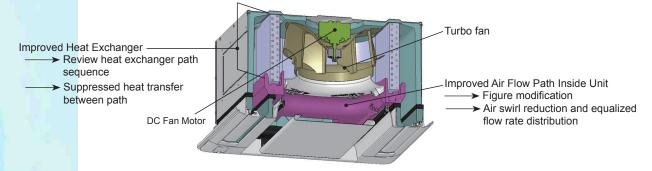



# **♦ High Performance and brand design Air Panel**

Simple stylish design yet applicable for air inlet flat grille. Can be used as shutter at the time of OFF the operation.

# ◆ 2-way Individual Louver

Adjustable the angle of 2 louvers individually by newly equipped individual louver setting function.





# ◆ Wide Range Air Flow Volume Setting

The air flow volume 4 taps setting is adopted in order to have a more comfortable installation.

RCD	
4 Taps	
HIGH 2(*)	
HIGH	
MED	
LOW	

(\*) Available through the PC-ARFP1E or PC-AWR remote control switch without additional setting

# ◆ Flexibility of Installation to High Ceiling

The air flow volume "HIGH 2" is added which is larger than "HIGH".


# **♦ Low Noise (Top-class Sound Pressure Level)**

A developed high efficiency turbo-fan is adopted. The fan efficiency is improved and the low noise performance is achieved.


Sound pressure level				
Model	Standard operation dB(A)			
	High 2	High	Medium	Low
RCD-0.8FSR	30	29	28	27
RCD-1.0FSR	31	29	28	27
RCD-1.5FSR	37	34	31	30
RCD-2.0FSR	39	36	33	30
RCD-2.5FSR	42	39	36	33
RCD-3.0FSR	45	42	38	33
RCD-4.0FSR	43	40	37	34
RCD-5.0FSR	47	44	41	35
RCD-6.0FSR	48	45	42	39

# Easy cleaning and maintenance

The flat surface of the air panel louvers (sold separately as an option) is stain-resistant and very easy to clean.



The air inlet panel grille is designed to prevent the entry of dust or dirt. Furthermore, the air outlet flow is designed to prevent dirt from accumulating on the ceiling -A- and on the air outlet panel -B-.



# **◆ Air quality improvement filters**

Optional filters can be installed to improve the air quality:

- Long-lasting anti-bacteria filters.
- Deodorising filters.

These filters are especially recommended in places where the presence of bacteria must particularly be controlled, such as in hospitals, clinics, etc.

The optional anti-bacteria filter can control the most common types of bacteria and prevent them from spreading thanks to its organic and inorganic agents.

The optional deodorising filter can effectively eliminate tobacco or body odours thanks to a special chemical fibre. This filter is reusable. When the deodorising effect decreases, simply expose it to sunlight for one day for it to recover its efficiency.

# 2.9 RPC - Ceiling type






# 2.9.1 Installation advantages


Versatile installation: to increase installation and positioning options, a second valve has been added for easier drain system installation.

A: drain pipes

B: rear side


The piping connection for the RPC-FSR series can be performed from 3 directions: Rear, right and upper side.



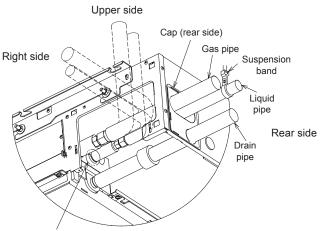


If the liquid pipe contacts strongly to the plate, noise caused by refrigerant flowing may increase. Suspend the local liquid pipe by suspension band to prevent dangling.

The hanging of the unit for the RPC-FSR series can do with suspension brackets or directly to the suspension bolt.



Adjustable mounting brackets: the adjustable mounting brackets make unit height adjustment easier so that it sits flush to the ceiling -A-.



# 2.9.2 Functional features for RPC-FSR series

# **♦ Improvement of Energy-Saving**

High efficiency is achieved due to the improved design performace of the fan runner, fan motor and the heat exchanger.

# Improvement of Energy-Saving Operation by Motion Sensor

The motion sensor function can adjust the setting temperature according to the human activity, and it controls the air flow volume and the air flow direction.

The energy-saving is improved by combining the motion sensor function and the individual operating function comparing with the standard operation.




# ◆ Fan Runner with a high efficiency and Low Noise

The fan runner is designed improving shapes of L-shaped fins and air outlet, the fan efficiency is improved and the low noise performance is achieved.



Fan Runner



L-Shaped Fin



Fan Casing

Air Outlet Diffuser


#### **♦ Louver Design**

Design with a large-sized amenity auto louver softens the discomfort by temperature irregularity and cold draft.


The auto louver as a shutter during the operation stoppage improves design.

# Adopting Amenity Auto Louver

Large-sized amenity auto louver with the same colour as indoor unit body is adopted. It softens the discomfort by temperature irregularity and cold draft. The auto louver as a shutter during the operation stoppage improves design.

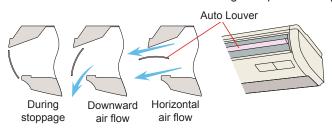

The comfortable heating air is widespread to whole room, mainly around floor, during the heating operation.

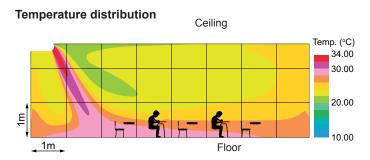

# ◆ Flexibility of Installation to High Ceiling

The 4 steps air flow volume setting function is adopted. As a result, high speed mode setting by the remote control switch is not required in the case of high ceiling.

RPC	
4 Taps	
HIGH 2 (*)	
HIGH	
MED	
LOW	

(\*) Available through the PC-ARFP1E or PC-AWR remote control switch without additional setting

# Supported Ceiling Height

High Speed Mode (C5)	Air Flow Volume Mode	(1.5- 3.0)HP	(4.0-6.0)HP
Standard (00)	HIGH 2	3.5m	4.3m

Additionally, the "High Speed Mode (C5)" setting allows to fix different airflow volumes for each fan speed, making use of the five different airflow volume modes (HH2, HH1, Hi, Me and Lo) handled internally by the 4-way cassette units.

The High Speed Mode is selected thought the optional functions C5 from the remote control switch. If the High Speed Mode (C5) is set as High Speed 2 (setting 02), the air flow volume of "HIGH 2" and "HIGH" will be equaled as shown in the table, because the air flow volume, "HIGH 2" and "HIGH" are used as "HH2" in high speed 2 setting.

4					
	High Speed Mode (CE)	Air flow volume mode selected by remote controller			
High Speed Mode (C5)	HIGH 2	HIGH	MED	LOW	
	Standard (00)	HH2	Hi	Me	Lo
	High Speed 1 (01)	HH2	HH1	Hi	Me
	High Speed 2 (02)	HH2	HH2	HH1	Hi

In the case of using the optional filter (except the long life filter), the high speed mode setting is required.

# Optional Receiver Kit (sold separately as an option)

By using the wired remote control switch together, it can be connected to the motion sensor kit.


Optional receiver Kit (PC-ALHP1) allows the use of the wireless remote control switch (PC-AWR). "HIGH 2" control is available from the wireless remote control switch (PC-AWR).

Adopting the motion sensor kit (SOR-NEP) allow that the air conditioning saves capacity automatically depending on a situation and detecting amount of human activity. In addition, the operation can be stopped automatically if the absent situation continues for more than 30 minutes \*1). The motion sensor allows maintaining the comfortable indoor environment and eliminating the unnecessary operation\*2).



- \*1):The default setting is "30 minutes". However, the setting is changeable.
- \*2):The default setting is "Running Operation". However, "Automatic Stop" can be selected by setting from the remote control switch.

To use the wired remote control switch together with wireless remote control switch, the wired remote control shall be connected to the motion sensor kit. The motion sensor can be set and controlled only from the wired remote control switch.

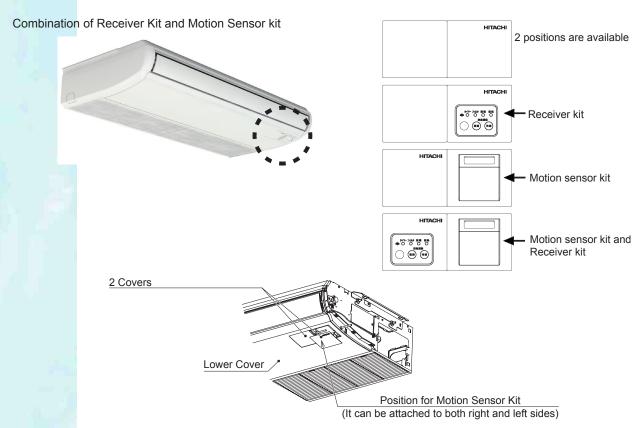


# Drain-up mechanism for RPC-FSR (optional part sold separately model DUPC-(63/71/160)K1)

The drain-up kit (1) allows to lift the drain-up to 600 mm from the upper side of the indoor unit.



For Drain-up Mechanism, the piping work shall be performed from upper side only. When it is installed, the service space shall be maintained more than 300mm between the upper surface and the ceiling.



# 2.10 RPI - Indoor ducted unit

# 2.10.1 Installation advantages

#### **♦** FSRE series



The RPI ducted units have been redesigned, with the most outstanding improvements being:

- Increased static pressure in all models
  - New fan assembly
- New plates
  - For downsizing in the RPI(L)-FSRE models (100 and 150Pa)
  - New heat exchanger
  - Front outlet of the refrigerant piping in the RPIL-FSRE (100Pa)
  - New servicing access to the filter
  - Availability to changing the air inlet from the back side to the bottom side with an additional accessory.
- Removable e-box for a more adaptative installation
- New and disconnectable drain pump for RPIL
- New isolation
- Insulation sleeves for drain piping and piping connections supplied on factory

#### Static pressure


New specification for every range means new implementations in terms of fan motor and fan casing design.

- 100 Pa: Its fan motor power has been increased to 150 W (as a reference, RPI FSN5E Low Profile mounted a 60W fan motor) in order to achieve the new static pressure of 100 Pa. The fan casing remains the same as Low Profile FSN5E
- 150 Pa: The new height of the unit has forced us to design a new fan casing that could fit on 240 mm instead of the 275 mm from FSN5E. This has lead us to modify the height of the fan casing but we wanted to maintain the same runner performance maintaining the same Ø180 mm runner. Also, taking account this countermeasure, we have increased all of our 150 Pa fan motor power to 250 W.
- 200 Pa: The amount of space this unit has got permits to conserve the current FSN5E fan casing and runner designed but now is powered by a new 250 W fan motor with extra refrigeration that allows the fan to improve its performance.

#### **New plates for downsizing**

The new plates makes it possible to reduce the compact size of the new machines, facilitating their installation.

- 35 mm height reduction vs FSN5E in the RPI-FSRE models (150Pa)
- 334 mm width reduction vs FSN5E in the most RPI(L)-FSRE models (100 and 150Pa)

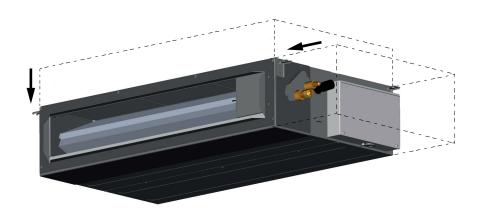

#### RPIL (Low static pressure, up to 100 Pa)

From 0.4 to 1.5 HP, RPIL is the best solution for narrow spaces. Taking as a reference the previous FSN5E low profile cabinet and RPIM, we have mixed both designs to obtain a reduced ducted unit maintaining the same capacity with the advantage of getting the refrigerant installation and all the piping connections in the rear side of the unit. This allows us to fit the units in the narrowest spaces as for example the hall of hotel rooms. Furthermore, the drain pump is disconnectable for a gravity drainage installation.

#### RPI (Medium static pressure, up to 150 Pa)

Our successful FSN5E series is upgraded with a new V-shape Ø5mm HEX: more exchange surface in less unit volume. This lower dimensions opens the RPI market to new narrow spaces making the RPI a flexible and easy installable unit.

#### RPIH (High static pressure, up to 200 Pa)

Increasing the unit height and redefining the heat exchanger (reducing its depth in order to gain static pressure), RPIH is the perfect unit for long range installations.

#### **New heat exchanger**

#### RPIL (Low static pressure, up to 100 Pa)

Heat exchanger has evolved to a new reduced tube diameter of 5 mm. This new tube dimensions makes possible to have the same capacity with reduced dimensions compared with previous 7 mm diameter RPI. The tube change is directly related to the fin change, this new fin is currently applied in RCIM and RCI with really good heat exchange.

#### RPI (Medium static pressure, up to 150 Pa)

As well as 100 Pa version, the HEX pipes has been reduced to 5 mm diameter. In order to decrease the height of the unit and to necessarily maintain the capacity and performance for each model, the HEX shape has been transformed from straight to V-Shape.


#### RPIH (High static pressure, up to 200 Pa)

The heat exchanger has been increased in terms of height maintaining the width of the 4-6HP FSN5E units. With this change, the depth of the heat exchanger has been reduced by one row permitting the air to pass through the fins and tubes with less pressure loss. This is one of the main features of this unit that allows us to achieve more static pressure.


#### Removable e-box


The design of the new electrical box allows it to be separated from the RPIL-(0.4-1.5)FSRE and RPI-(1.5-2.0)FSRE for independent installation. The electrical box is located on the left side, but it can be moved to the right side and even fixed directly to the wall. In this way, it is easier to take advantage of the spaces available for mounting the system and facilitate maintenance and possible operations.

# From left side to right side

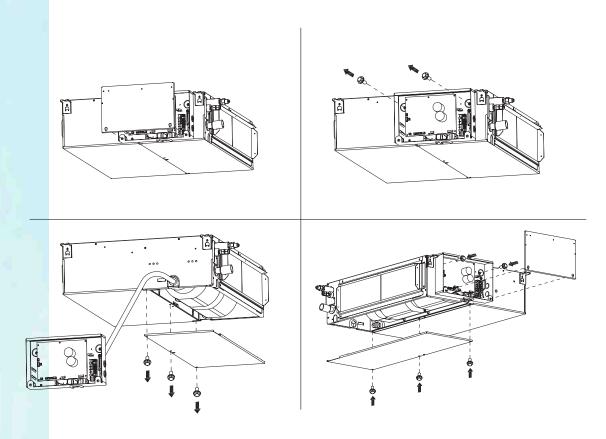


# Wall fixing






# Disconnectable drain pump (only RPIL)


On RPIL models, it is optionally possible to change the drainage system by disabling the drainage pump and installing a gravity drainage kit (accessory).

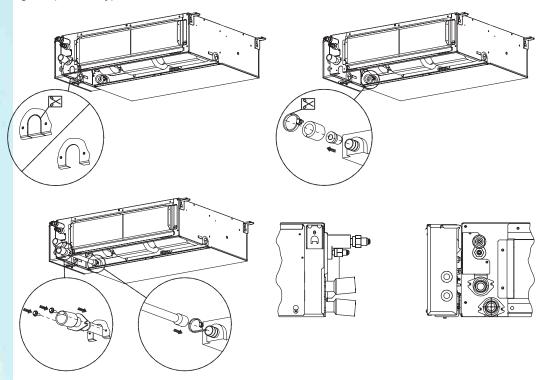

Example of both possible drainage connections: with Drain Pump option and Gravity drain kit:

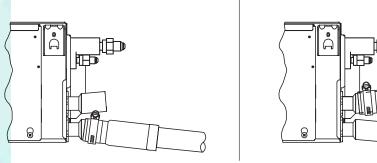


Gravity drain connection



Drain pump connection

After installation of the gravity kit is necessary to disconnect CN36 connector from PCB to disable the drainage pump.

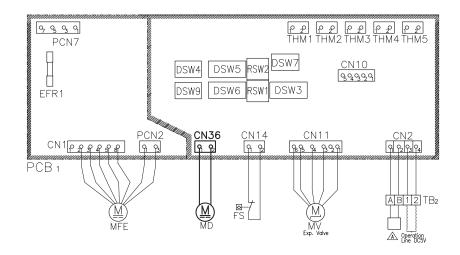


#### **New isolation**

New, previously uninsulated parts of the machine have been insulated with non-flammable material, covering a larger area. The thickness of the insulation has been increased for better overall insulation, reducing internal condensation and the level of noise emitted.

The new non-flammable insulating material is certificated with a grade of Flammability Class "M1" (based on French standard NF P 92-507: 2004) or equivalent "B s3 d1" (based on European standard EN 13501-1+1: 2009).



In case of French market, Article CH36 of the Fire Regulation in Public Buildings (ERP) makes mandatory this level of Flammability grade.

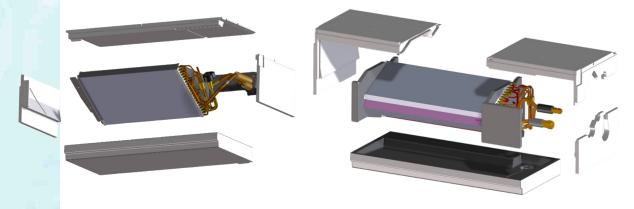

#### **♦ FSN3(P)E-f** series

RPI-(8.0/10.0)FSN3E-f







The RPI-(8.0/10.0)FSN3E-f and RPI-(16.0/20.0)FSN3PE-f models are manufactured by using non-flammable insulations. This non-flammable material is made of long ceramic fibres bonded with an organic binder and finished with aluminium film layer which provides excellent thermal properties.

The non-flammable insulating material is certificated with a grade of Flammability Class "M0" (based on French standard NF P 92-507: 2004) or equivalent "A1" (based on European standard EN 13501-1 +1: 2009).

The other data and specifications for these units are common with the models RPI-(8.0/10.0)FSN3E(-f) - RPI-(16.0/20.0) FSN3PE(-f).

#### RPI-(8.0/10.0)FSN3E(-f)

RPI-(8.0/10.0)FSN3E(-f) units have been designed to be as compact as possible to improve installation work.

The result is units with a profile that is 52 mm less than the units of the previous model, maintaining the other measurements. As a result, they are easier to house and install in false ceilings (from 475 mm in height to 423 x 1592 x 600 mm).

# RPI-(16.0/20.0)FSN3PE(-f)

These units have the following benefits for the installer:

- Improved unit hanging (one compact unit set).
- Easy Duct installation (pre-mounted inlet and outlet Duct Frames onto the unit).
- One Remote control and simply wiring work (units inter-connected factory supplied).
- No need DX-Interface installation (simply refrigerant pipes connection through Multi Kit).

#### 2.10.2 Functional features

Silent running

The innovative ventilation unit that combines an optimised design with the use of materials for a significant reduction in operating noise. The Hitachi RPI units are among the most silent in the market.

The following table shows the sound pressure level of the different models.

		Sound pressure level		
Model	External Static Pressure	Standard operation dB(A)		.)
Wodei		Low	Medium	High
RPIL-0.4FSRE	SP-02	22	23	24
RPIL-0.6FSRE	SP-02	23	25	27
RPIL-0.8FSRE	SP-02	23	25	28
RPIL-1.0FSRE	SP-02	23	25	28
RPIL-1.5FSRE	SP-02	25	28	30
RPI-1.5FSRE	SP-02	29	30	32
RPI-2.0FSRE	SP-02	29	30	32
RPI-2.5FSRE	SP-02	30	32	34
RPI-3.0FSRE	SP-02	31	33	35
RPI-4.0FSRE	SP-00	35	38	39
RPI-5.0FSRE	SP-00	36	38	40
RPI-6.0FSRE	SP-00	36	38	40
RPIH-4.0FSRE	SP-00	35	38	39
RPIH-5.0FSRE	SP-00	36	38	40
RPIH-6.0FSRE	SP-00	36	38	40
RPI-4.0FSN6E-EF	SP-00	35	38	39
RPI-5.0FSN6E-EF	SP-00	36	38	40
RPI-6.0FSN6E-EF	SP-00	36	38	40
RPI-8.0FSN3E(-f)		51	54	54
RPI-10.0FSN3E(-f)		52	55	55
RPI-16.0FSN3PE(-f)		53		56
RPI-20.0FSN3PE(-f)		54		57

Fan speed optimization at each static pressure level on RPI(L/H)-(0.4-6.0)FSRE models.

For RPI(L/H)-FSRE units, function C5 is used to change the static pressure.

C5 setting condition	
00 Standard static pressure (factory set)	
01	High static pressure
02	Low static pressure


Series RPI(L/H)-FSRE has been designed with a DC-Fan motor.

The intelligent DC-Fan Motor control which keeps always the Air Volume constant giving the best comfort to the customer even when the Air Filter is capped by dust or in those installations where there is any dumper system which makes External Static Pressure variations.


#### Higher flexibility in the site

- Fan Speeds have been improved by better distribution at lower External Static Pressure area.
- Remote Control Switch PC-ARFP1E and PC-AWR allows getting an additional High Fan Speed ("HIGH 2" in PC-ARFP1E screen and "Hi2" in PC-AWR screen) which provides additional adaptability of the unit in those installations with Low External Static Pressure and high Air Volume requirement.
- A low ESP Working Range area is available for this series.
- A silent "Low" Fan Speed is adopted which allows working with very short ducts or without duct.

External static pressure (Pa)



External static pressure (Pa)




#### Simple adjustment of static pressure on RPI-(8.0/10.0)FSN3E(-f) and RPI-(16.0/20.0)FSN3PE(-f) models

The fan motor in RPI-(8.0/10.0)FSN3E(-f) and RPI-(16.0/20.0)FSN3PE(-f) units can be configured in two different ways:

- A: connector CN24 LSP (Low Static Pressure) (factory supplied setting).
- B: connector CN25 HSP (High Static Pressure).

The LSP configuration enables the unit to run in low-demand mode. It is used in installations with short ventilation ducts. The HSP configuration enables the unit to run at a high static pressure with the same airflow. This configuration is suitable in installations with long ventilation ducts.



To keep the unit operation noise level as low as possible, it is extremely important to adapt the unit to the type of ventilation ducts available.

The fan motor in the unit is fitted with a dual power connector in the electrical box. Fitters can set the most appropriate static pressure during unit installation.

The fan motor in the unit is factory-supplied set to work at low static pressure. If the unit is built into an installation with long ventilation ducts, the unit must be adapted to work at a high static pressure. To do so, simply replace the motor power connector identified as CN24 (factory-connected for operation at low static pressure, LSP) with the highpressure connector CN25 (operation at high static pressure, HSP).



# ∠!\ CAUTION


Perform the connection with the same settings in both units that make up models RPI-(16.0/20.0)FSN3PE(-f); otherwise malfunction may occur, causing damage to the units.

### 2.10.3 Maintenance benefits


### ◆ New servicing access to the filter for RPI(L/H)-(0.4-6.0)FSRE

The guidance system of the inlet air filter has been improved, for an easier assembling and servicing, while keeping the current servicing for maintenance from the bottom side and also, be able to do maintenance laterally. This allows the maintenance of the inlet air filter without disconnecting the units from the duct.


### Lower extraction

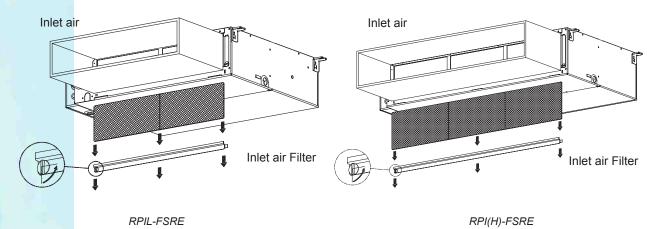

#### Lateral extraction

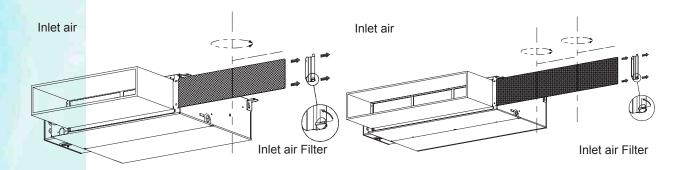

RPI(H)-FSRE Right side RPIL-FSRE

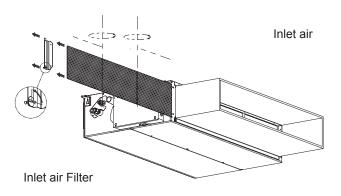


RPI(H)-FSRE Left side

### ◆ For RPI(L)-(0.4-6.0)FSRE change the air inlet from the back side to the bottom side

It is possible to change the factory-default air inlet position from back side to the bottom side in the entire RPI(L)-FSRE range.

This change of air inlet from the back side to the bottom side can be achieved by adding an optional accessory (\*) specifically designed for this purpose.

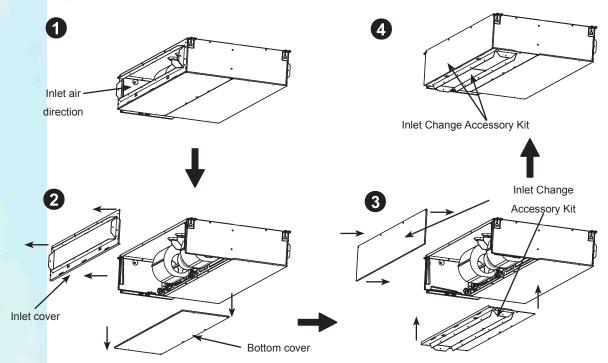



Inlet change accessory codes:


- D-ICA15R (7E590912) RPIL-(0.4-1.5)FSRE
- D-ICA20R (7E590913) RPI-(1.5-2.0)FSRE
- D-ICA30R (7E590914) RPI-(2.5-3.0)FSRE
- D-ICA60R (7E590915) RPI-(4.0-6.0)FSRE

### Maintenance of unit RPI-(8.0/10.0)FSN3E(-f)

One of the aspects considered in the design of the unit is its easy access for maintenance operations. The main aim is to be able to carry out normal operations on the main components without having to uninstall the unit.

The main access is provided from the base of unit -C-, which can be easily separated without the need for any more space. From here, the following unit parts can be reached: fan motor, evaporator, drain pan -B- and the entire refrigerant circuit, all of which are secured to the main unit structure.


There is a cover -A- for electrical maintenance that is located on one side of the unit, which can be separated without affecting its connection.



### ◆ Maintenance of unit RPI-(16.0/20.0)FSN3PE(-f)

The design of the RPI-(16.0/20.0)FSN3PE(-f) makes easy the servicing works:


- A right side servicing of the motor is available (be aware that servicing space of the motor side shall be min. 1200 mm).
- The left side cycle access is available (for servicing and maintenance of drain pan, flow switch, thermistors).
- The filter (split in three parts) has a right or left access and servicing.

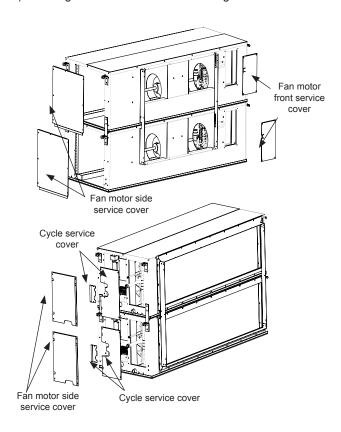

Filter maintenance could be performed from right or left side of the unit.

Remove filter support (x2 screws / each support) and pull out the filter from the handle.

In those installations where the servicing space is narrow, the filter could be bent (in three pieces) when pulling it out.



# 2.11 RPK - Wall type

Renewed design of 2.0 to 4.0HP units unified with the existing design of 0.4 to 1.5HP units.



### 2.11.1 Installation advantages


With the design of RPK-FSR(H)M is achieved a lightweight and compact design to allow easy installation.

Model	Weight (kg)	Sizes [mm] (HxWxD)
RPK-0.4FSR(H)M	9	300x790x230
RPK-(0.6-1.0)FSR(H)M	10	300x790x230
RPK-1.5FSR(H)M	11	300x900x230
RPK-2.0FSRM	14.5	300x1100x260
RPK-(2.5-4.0)FSRM	15	300x1100x260


### **♦** Workability

The RPK series are designed for a easy workability during the installation process. The wiring work and dip switch setting can be performed without removing the front panel.

- 1 Access to terminal board
  - a. Position of electrical box cover. The figure below shows that the front panel is removed. The electrical box cover can be opened without removing the front panel.




b. Open the electrical box cover and perform the field electrical wiring work. Close the electrical box cover after the electrical wiring work is completed.




#### 2 Access to DIP switches

Open the switch cover.



The positions of DIP switches on PCB2 are shown in the figure below.



After the DIP switches are set, attach the switch cover again.

### 2.11.2 Functional features

### Adoption of 4 levels of Air Flow Volume

The 4 steps of air flow volume setting function is adopted. As a result, high speed mode setting by the remote control switch is not required in the case of high ceiling.

RPK
HIGH 2 (*)
HIGH
MED
LOW

(\*) Available through the PC-ARFP1E or PC-AWR remote control switch without additional setting.

Additionally, the "High Speed Mode (C5)" setting allows to fix different airflow volumes for each fan speed, making use of the five different airflow volume modes (HH2, HH1, Hi, Me and Lo) handled internally by the 4-way cassette units.


The High Speed Mode is selected thought the optional functions C5 from the remote control switch. If the High Speed Mode (C5) is set as High Speed 2 (setting 02), the air flow volume of "HIGH 2" and "HIGH" will be equaled as shown in the table, because the air flow volume, "HIGH 2" and "HIGH" are used as "HH2" in high speed 2 setting.

Ligh Chood Mode (CE)	Air flow volume mode selected by remote controller			
High Speed Mode (C5)	HIGH 2	HIGH	MED	LOW
Standard (00)	HH2	Hi	Me	Lo
High Speed 1 (01)	HH2	HH1	Hi	Me
High Speed 2 (02)	HH2	HH2	HH1	Hi

In the case of using the optional filter (except the long life filter), the high speed mode setting is required.

#### **Improvement for Centralized Control**

The wired remote control switch is NOT required at the centralized control when each indoor unit is controlled by each wireless remote control switch.




Wired remote control switch is NOT required.

### Sound level improvement

The design of the models RPK-FSR(H)M achieve an improvement the sound pressure data, accomplishing a reduction in all 4 speed taps.

Madal	Sound pressure level - Standard operation dB(A)			
Model	High 2	High	Med	Low
RPK-2.0FSRM	40	37	34	31
RPK-2.5FSRM	45	42	38	35
RPK-3.0FSRM	47	44	40	35
RPK-4.0FSRM	51	48	44	39

This noise reduction is achieved adopting a large diameter fan with undulating blades has been adopted in 2.0 to 4.0HP units, improving air flow performance.

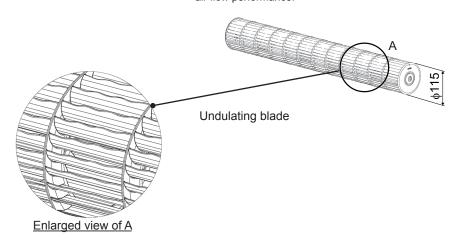

### ◆ Electronic Expansion valve Kit (EV-1.5N1) for a more silent operation on RPK-(0.4-1.5)FSRHM

The flow of refrigerant circulating through the expansion valve is, due to the nature of its operation, responsible for some of the level of sound emissions of the indoor units. The operating noise is occasionally produced, particularly during unit start-up, when the number of indoor units running varies or when heating mode is activated at very low outdoor temperatures.


The RPK-(0.4-1.5)FSRHM units are not fitted with the electronic expansion valve on the inside, although this can be installed independently in the surrounding area, at a sufficient distance from the unit to eliminate the disturbance. The unit is not affected by the factors described above and, therefore, its operation is more silent.

In places where a low noise level is required or desired, e.g. in hotel rooms where the noise of the refrigerant flow may be bothersome, the RPK-(0.4-1.5)FSRHM units provide a simple, effective solution while offering the necessary flexibility for a noise-free installation.

The expansion valve can be installed, for example, in the false ceiling or in a different room to that of the indoor unit. The valve is supplied in kit form, with the necessary connections for the refrigerant pipes.




The wall type indoor unit without expansion valve adopts the refrigerant liquid piping size ø6.35 which is same as the standard wall type indoor unit. For the combination with SET FREE series outdoor units, the restriction for total piping length between indoor unit and expansion valve kit has been changed as well as the calculation for additional refrigerant charge quantity.

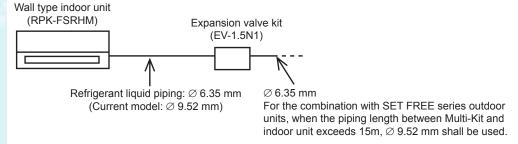

For using RPK-FSRHM (Wall Type indoor units without expansion valve) and expansion valve kit, the installation work shall be performed with followings:

- 1 For RPK-FSRHM (Wall Type indoor units without expansion valve), the total piping length between expansion valve kit and indoor unit is restricted as shown in the table below.
- 2 For SET FREE series outdoor units, the appropriate refrigerant quantity is required to be additionally charged depending on the piping length and the piping size. When the additional refrigerant charge quantity at connected liquid pipe is calculated, calculate the following additional refrigerant quantity each.
  - \* Quantity for Liquid Pipe between Multi-Kit and Expansion Valve Kit.
  - \* Quantity between Indoor Unit and Expansion Valve Kit.

Total Additional Refrigerant Charge Quantity = Additional Refrigerant Charge Quantity between Multi Kit and Expansion Valve Kit + Additional Refrigerant Charge Quantity between Indoor Unit and Expansion Valve Kit.

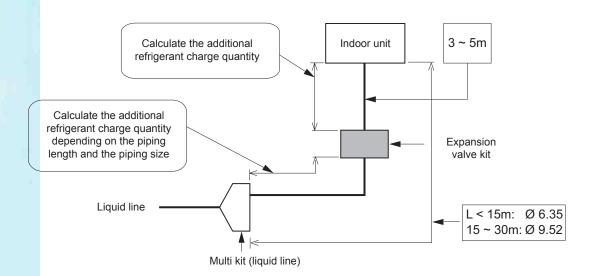





Refer to the "Expansion Valve Kit" Installation and Operation Manual for proper installation.

### 2.11.3 Using one single remote control switch (wire or wireless)

UTOPIA IVX systems comprising several indoor units (up to 4 indoor units) in simultaneous operation setting can be controlled from a single wire remote control switch (PC-ARFP1E) or wireless remote control (PC-AWR) using a wallmounted receiver kit (PC-ALHZ1), without the need to link up the indoor units with dedicated remote control relay wiring, as shown in the figure below.

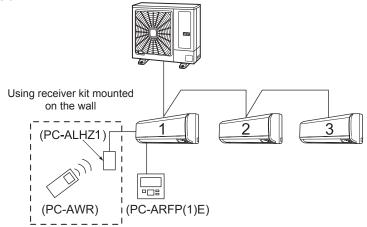

Aslo different system groups can also be controlled from a single wire remote control switch (PC-ARFP1E) or wireless remote control (PC-AWR) using a wall-mounted receiver kit (PC-ALHZ1). In such case, all the indoor units must be linked up with dedicated remote control relay wiring, and operation settings must be changed to individual operation (Not available in the UTOPIA ES series).

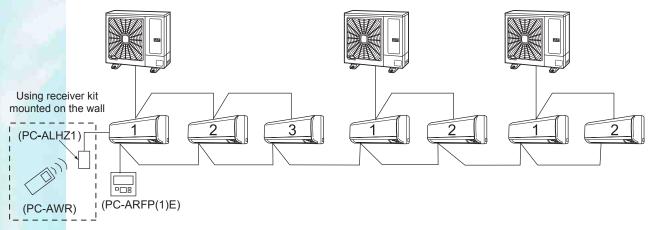




- Some indoor unit series have introduced the possibility of using four (4) fan speed steps (HIGH 2, HIGH, MED and LOW). "HIGH 2" is not indicated and cannot be selected if the connected remote control switch is not compatible with this feature. Hitachi recommends the use of PC-ARFP1E or PC-AWR (in combination with the wall-mounted receiver) remote control switch in order to enjoy the complete set of features.
- Special remark regarding the indication of "HIGH 2" fan speed In case that the central control unit being used does not provide support for the "HIGH 2" fan speed, "HIGH" will be indicated even though actual operation is carried out in "HIGH 2" fan speed.

#### 2.11.4 Maintenance benefits

With the design of the RPK-(2.0-4.0)FSM4M it is improved serviceability due to the fan motor can be replaced without removing the heat exchanger.

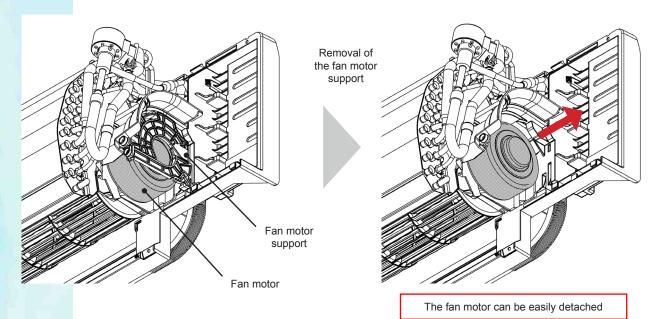

# 2.12 RPF - Floor type, RPFI - Floor concealed type






### 2.12.1 Installation advantages

Thanks to its compact design with a depth of just 220 mm, the RPF(I) units can be installed along the wall to take up the least possible amount of floor space.

The RPF unit measures just 630 mm in height, making it ideal for air conditioning the perimeter of the room.

Remote control built into the unit (RPF)

The remote control can be installed below the plastic cover, as shown in the illustration.




Compact design


The RPFI indoor units are normally installed underneath windows, without altering the inside of the room. Their compact design, measuring 620 mm in height and 220 mm in depth, means that they can be installed in limited spaces inside buildings.

Change in the air outlet direction (RPFI)

The air outlet direction of the unit can be modified to adapt it to installation requirements, as shown in the illustration.

- 1 Lift air outlet -A-.
- 2 Turn the air outlet on itself until it is opposite its initial position.
- 3 Tilt the air outlet so that the nozzle is facing forwards.
- 4 Refit air outlet -A-.





### 2.13 DX-Interface Series 2



The DX-Interface series 2 is used to allow the connection of third-party manufacturer units to Hitachi outdoor units, which enables the control of their direct expansion coil (for R410a) following Hitachi control logic. Typical applications are air handling units (AHU), air curtains and units similar to standard indoor units (standard indoor units understood as cooling/ heating indoor air treatment units for room conditioning).

Thermistors are supplied with the DX-Interface series 2 to be installed into the unit to be controlled (two thermistors for air: inlet and outlet of the DX-Coil; and two for piping: liquid pipe and gas pipe). The connection of the thermistors must be done on site. The correct installation of thermistors must be ensured for proper operation and thermodynamic control of the DX-Interface series 2. Additionally, extension wiring of up to 5 m is supplied for each thermistor.


The DX-Interface Series 2 consists of a Control Box including the PCB and all the electronic components, as well as an Expansion Valve Box, which contains the expansion device. Both items are supplied as a set.

#### 2.13.1 Installation facilities


Thermistors are supplied into the DX-Interface kit to be installed into the unit to be controlled (two thermistors for air -inlet and outlet of the DX-Coil- and two for piping – liquid pipe and gas pipe-). The connections of the thermistors must be done in the field. Correct thermistors installation must be guaranteed for a proper DX-Interface sensing and thermodynamic control.

The installation of the control box must be done through the 4 openings located on the corner of the casing.

Once installed it is necessary to place the 4 feets supplied with the control box into the corners in order to fix the cover.

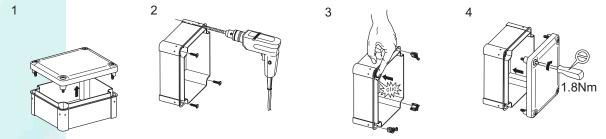

On the other hand the expansion valve boxes have been designed to be installed directly from the front side.



#### ♦ Installation outdoor

DX-Interface, both control boxes and expansion valve terminal boxes, are designed to allow the installation outdoors, by using special ABS material casings (temperatures allowed up to 650°C IEC 695-2-1) with sealed covers that guarantee an IP66 between the casing and the cover.



This IP grade could be reduced due to the product modifications for this specific application.

#### Safe Wires Installation

In order to keep as high as possible the insulation, packing clamps have been used in both casings, providing an easy and safe installation of the external wiring.

### Easy Piping Installation

Expansion valves pipes are designed for the use flare nuts unions, as most of Hitachi indoor units, which makes the installation fast and easy.

### Inverter control for non-Hitachi Indoor Units by Inlet air, outlet air and duty signal

Once the expansion valve kit has been installed, the connected unit is controlled based on Hitachi inverter high performance control.

DX-Interface series 2 has been designed offering to the user up to three different operation modes depending the capacity control to be performed (inlet temperature, outlet temperature or duty control (incremental reference duty control or absolute reference duty control)).

DX-Interface series 2 will be fully compatible with CSNET Manager 2 (but with some functional limitations).

### **♦ Compatible with SET FREE and UTOPIA systems**

DX-Interface series 2 can be either connected to UTOPIA systems for single connections or to SET FREE systems in case of multiple installations. Thanks to Hitachi SYSTEM FREE technology, the same DX-Interface series 2 model is connectable to both systems, making easier the installation design.

#### DX-Interface serie 2 - Optional Functions

Specific functions have been implemented in the DX-Interface series 2, making it suitable for different installation requirements.

In addition, the DX-Interface series 2 and Hitachi outdoor units offer different input/output signals allowing the installer to embed it in any air conditioning / ventilation system.

#### Improvements resulting in enhanced control of system capacity and faster response

In the case of single combination of DX-Interface series 2 with dedicated UTOPIA RAS-XH(V)NP(1)E, control accuracy is improved thanks to a more direct command of compressor frequency and faster response is obtained.

#### Capacity control modes

The capacity control mode means the kind of control the DX-Interface series 2 performs in order to adapt the system performance to the cooling and heating load required by the user.

The control of capacity demand can be done by Inlet Air Temperature, Outlet Air Temperature, Incremental reference duty control and Absolute reference duty control, depending the application and outdoor unit used.

#### Inlet air temperature control

The purpose of the inlet air temperature control is to keep the indoor ambient (room or area) close to the set temperature. Capacity demand based on the difference of temperature between indoor air (inlet air of the DX-Coil) and setting temperature.

The control is done based on the inlet temperature to the DX-Coil. This kind of control is suitable for close installations where the inlet temperature to the DX-Coil comes from the same room to be conditioned, looking for the whole room conditioning [Application example: Indoor Units].

(\*) In the case of Air Handling Units, it is not indoor air which is considered as "air inlet", but the air right before the DX-Coil section.

### **Outlet air temperature control**

The purpose of the outlet air temperature controls is to supply air at a constant temperature, close to the set value. Capacity demand based on the difference of temperature between the DX Coil discharge air temperature and the set temperature.

It makes the discharge temperature (temperature at the outlet of the DX-Coil) same than the setting temperature. This kind of control is focused in controlling the discharge temperature of the system [Application example: Air Handling Units].

### **Duty signal**

Duty control must be understood as a demand control, which signal is provided by an external input. This control mode provides a method to request capacity for each individual DX-Interface series 2.

In the case of single combination of DX-Interface series 2 with a dedicated UTOPIA RAS-XH(V)NP(1)E, a more direct control loop is established between duty signal and compressor frequency.

However, protections and other cycle conditions may have priority over duty demand signal.

The system capacity is fixed by an external input, which can be either a free voltage signal (0~10V or 0~5V - Internal  $47k\Omega$  pull-down resistor) or a current signal (4~20 mA - Internal 100Ω load impedance).

The duty signal, generated externally and supplied to the DX-Interface series 2, must be inherent to the real condition and target of the space to be conditioned [Application example: Air Handling Units, Air Curtains].

The DX-Interfaces series 2 are provided with two Duty control modes:

- Incremental reference duty control
- Absolute Reference duty control

Both of which can be set by means of DSW1 pin 5.

### Incremental reference duty control:

When duty signal is in the middle of its range, the control understands that the system capacity shall not be changed.


When duty signal is higher than the middle of its range, it is understood that there is an increase of demand.

When duty signal is lower than the middle of its range, it is understood that there is a decrease of demand.

Additionally, the duty signal determines how fast compressor frequency (Hz) needs to be raised or lowered and, in consequence, the rate for increase or decrease of system capacity.


The greater the divergence of the duty signal from the middle of its range is, the faster system capacity has to be increased or decreased.

Example: Duty signal 0~10V / Middle of the range = 5 V



Duty	Incremental Target Hz
≤ 15 %	-10
15% < Duty ≤ 25 %	-6
25% < Duty ≤ 35 %	-4
35% < Duty ≤ 45 %	-2
45% < Duty ≤ 55 %	
55% < Duty ≤ 65 %	+2
65% < Duty ≤ 75 %	+4
75% < Duty ≤ 85 %	+6
85% < Duty ≤ 95 %	+8
≥ 95%	+10

Note: The duty signal range is internally divided in 10 proportional steps of control once it has been received by the DX-Interface series 2.

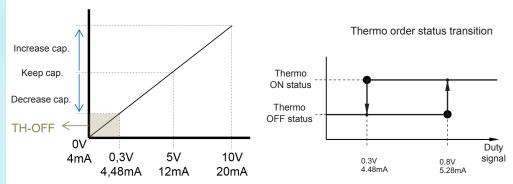




- The compressor frequency is updated every minute.
- Thermo Off: 3 % of the maximum duty signal.
- Thermo On: 8 % of the maximum duty signal.

### - Absolute Reference duty control mode

The capacity requested to the outdoor unit follows the level stated by duty signal, in discrete steps. The control requests the maximum capacity when the duty signal is set to maximum, and likewise, the control requests thermo OFF condition with a barely minimum capacity when the duty signal is lowered to a minimum.


In parallel, and thanks to Hitachi expansion valve control logics, the system becomes adapted within every compressor discrete step to the real demand, resulting in a huge quantity of control steps.

The capacity requested to the Outdoor Unit follows the level stated by duty signal, in discrete steps. When the duty signal is set to maximum, the control requests maximum capacity; likewise, when the duty signal is lowered to the minimum, the control requests thermo OFF condition just under minimum capacity.

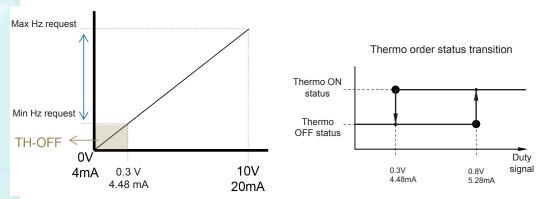



• The generation of Duty signal must be based on a significant condition of the system to be controlled, in order to ensure the proper control of the system. (i.e., discharge temperature against a set temperature, as shown in the figure below)



- Thermo Off: 3 % of the maximum duty signal:
- Thermo On: 8 % of the maximum duty signal.
- Consider that the available frequency range may vary depending on the outdoor units capacity. Depending on the units and its
  working condition it is possible that max. Hz are reacted with a signal lightly below 10V / 20mA.

### ◆ Expanded working range on Air Handling Units (AHU) applications

The working range for combination of DX-Interface series 2 with the outdoor units RAS-XH(V)NP(1)E is expanded in Air Handling Units (AHU) applications.

In case of cooling mode the DX-Interface series 2 can work with indoor unit temperatures from 10°C to 26°C (Wet Bulb), equivalent to 15°C to 35°C (Dry Bulb) in cooling.

On the other hand, in case of heating operation the inlet air temperature range is also modified, allowing minimum inlet air temperatures to the heat exchanger of 5°C (DB).

### Extended range of compatible Heat Exchangers, allowing now larger internal volumes

Up to 10.73 dm3 of Heat Exchanger volume can be installed in single combination (1 Outdoor Unit RAS-XH(V)NP(1)E series + 1 DX-Interface series 2).

DX-Interface series 2			
	DA-IIIteriace Series 2		
Model	Heat Exchanger maximum internal volume (dm³) (1)		
EXV-2.0E2	1.64		
EXV-2.5E2	1.83		
EXV-3.0E2	2.89		
EXV-4.0E2	4.56		
EXV-5.0E2	4.56		
EXV-6.0E2	5.11		
EXV-8.0E2	6.93		
EXV-10.0E2	10.73		

<sup>(1)</sup> Check the limits of piping length vs HEX volume.

#### Improved functionalities for control by outlet air temperature

### Extended range of setting for control by outlet air temperature

When applied to a system focused on discharge temperature, a more suitable temperature setting range is available. When is set the temperature control method in the remote control, automatically the temperature range of the setting allowed is changed to the values shown in the table:

		Control by inlet temperature	Control by outlet temperature
Cooling mode		19°C ~ 30°C (DB)	14°C ~ 27°C (DB)
Heating mode 17°C ~ 30°C (DB)		17°C ~ 30°C (DB)	19°C ~ 40°C (DB)

### Adjustable Thermo-Off temperature by means of "offset" parameter

All heat exchangers (HEX) designs have a ΔT between Tin and Tout temperatures. When capacity demand keeps going down in inverter systems, there is a limit where the system operates at a minimum frequency (minimum system capacity), in spite of demand being lower than system capacity at the barely minimum working status. In these operation conditions, and depending on HEX characteristics, it may occur that the outlet temperature becomes lower than setting temperature in cooling mode or higher in heating mode.

Optional function allows to adjust this difference of temperatures to more favourable conditions. This setting allows to select the maximum Tout offset temperature (against Tsetting), assuming that setting temperature will not be achieved under certain circumstances.

#### Extended lineup for applications up to 50 HP

Up to 5 units of DX-Interfaces series 2 can work as a group in the same indoor unit or device with heat exchanger, equivalent to a total power of 50 HP and a maximum heat exchanger volume of 53.65 dm3.



To get to this maximum power and volume, the heat exchanger has to be split into five sections of 10.73 dm3 and a 10 HP DX-Interface series 2 has to be connected to each module.

#### **◆ Advanced functions for multiple DX-Interface series 2 installation**

Up to 5 DX-Interfaces series 2 can work as a group with the same indoor unit or device with heat exchanger.

Inlet and outlet air temperatures shared for a group of DX-Interfaces series 2 from one DX-Interface series 2 configured as group controller

When several DX-Interfaces series 2 are working with the same indoor unit or device with heat exchanger (HEX), one of them is set as group controller. Then, the air thermistors (THM1 and THM2) only need to be connected to this DX-Interface series 2 (information is shared through the remote controller transmission wiring).

With this option, installation procedure becomes simplified and less time-consuming.

Improvement in defrosting procedure of DX-Interfaces series 2 working as a group, avoiding drop of heating capacity


The defrost operation of Outdoor Units connected to DX-Interface series 2 working as a group is timed in order to limit the effect of heating capacity drop caused by simultaneous defrost. This offers more stable capacity and better comfort from the application.

The time for the beginning of defrosting operation of each OU is established according to the total number of DX-Interface series 2 and the individual need for defrost of each OU, assuring secure operation of each unit.

This functionality will only have effect when using the special outdoor unit RAS-XH(V)NP(1)E.

### Advanced Optional Functions

- EC Fan or Tap Fan: The control of tap fans and EC fans is possible from the Dx-Interface.
- Defrost signal: Output signal get from the Dx-Interface when the system is in defrost mode.
- Fan operation during defrost: During defrost operation three different fan speed settings are possible: fan speed kept as set, fan speed reduced to low speed and fan stoppage.
- Thermo-on / Thermo-OFF by an external input instead of typical control logic.
- Operation delay: Once the system is turned on, the unit is kept in off during an specific time. Useful for applications where the Dx-Interface is focused on comfort and not room conditioning.
- Thermistor selection: Option to select between inlet thermistor, external thermistor or remote controller thermistor to perform the cycle control (Only if demand control is based on inlet temperature).
- Fan Stoppage delay: Once the system is switched off, the unit keeps running for a suitable period of time, to for example, perform the air renovation once the activity is conclude.
- CO<sub>2</sub> sensor: By the action of an ON/OFF CO<sub>2</sub> sensor, the Dx-Interface switches the fan speed to high while the CO<sub>2</sub> concentration exceeds the sensor detection threshold.
- Remote temperature thermistor THM-R2AE (7E299907) is available for the DX-Interface Series 2 (EXV-(2.0-10.0)E2). When connecting the remote temperature thermistor to the THM4 socket on the DX-Interface PCB1, it is automatically recognized and activated by the system control.

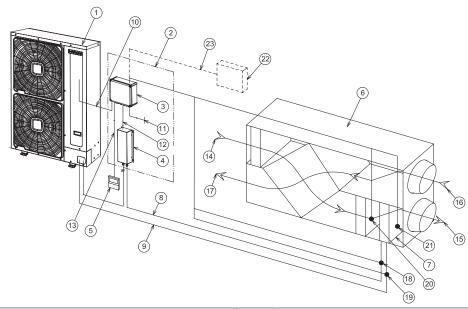

Item	Description	Item	Description
1	Hitachi outdoor unit	13	Remote controller communication
2	DX-Interface EXV-(2.0-10.0)E2	14	Outdoor air (AHU applications)
3	Control box	15	Supply air (AHU applications)
4	Expansion valve box	16	Return air (AHU applications)
5	Remote controller (sold separately as an option)	17	Exhaust air (AHU applications)
6	Unit or device with heat exchanger	18	Liquid pipe thermistor (THM3, PCB1)
7	DX- heat exchanger	19	Gas pipe thermistor (THM5, PCB1)
8	Liquid line	20	Inlet DX-Coil thermistor (THM1, PCB1)
9	Gas line	21	Outlet DX-Coil thermistor (THM2, PCB1)
10	Outdoor - Indoor communication	22	Field supplied controller (Optional)
11	Power supply	23	Duty signal (0~10V, 0~5V, 4~20 mA) (Optional)
12	Expansion valve control communication		

# **A** CAUTION

Check the limits of piping length vs HEX volume.

- The installation distance between the DX-interface and the device with heat exchanger must be the shortest possible.
- Keep the distance between the unit or device with heat exchanger and the expansion valve box for the piping length up to 5 m. Also the elevation difference between the unit or device with heat exchanger and the expansion valve box must be no more than 2 m.
- Make sure that the installation distance between the control box and the unit or device with heat exchanger is short enough that the thermistors sensing are not distorted.
- The thermistor cable should never be installed in the same ducting as power or control cables.

### ◆ DX-Interface series 2 applications and control mode

The following table summarizes system features for the applications with DX-Interface series 2.

		System			
Application		UTOPIA (IVX , RASC and ES)	UTOPIA DX RAS-XH(V)NP(1)E	SET FREE (5)	
	Combinability	Single	-	Multi (6)	
Air curtain	Control type	Outlet air temperature control	-	Inlet air temperature control	
All Cultum	Air curtain Capacity	2 - 10 HP	-	2 - 10 HP	
	Accuracy control level	••••	-	●●●○○ (1)	
	Combinability	Single	Modular	Multi (6)	
Duct (≤ 10%	Control type	Inlet air temperature control	Inlet air temperature control	Inlet air temperature control	
Fresh Air)	Duct Capacity	2 - 10 HP	12 - 50 HP (2)(3)	2 - 10 HP	
	Accuracy control level	••••	••••	●●●○○ (1)	
	Combinability	-	Single or Modular	-	
Air handling	Control type	-	Outlet air temperature control or duty signal	-	
unit (AHU)	UTA Capacity	-	4 - 50 HP (3)(4)	-	
	Accuracy control level	-	••••	-	

# i NOTE

- (1) System control focuses on cycle conditions and performance, not inlet air temperature condition only.
- (2) The power range is obtained by the combination of 3 HP to 10 HP outdoor unit models (RAS-(XH(V)NP(1)E series).
- (3) In order to ensure balanced working conditions for outdoor units, it is necessary to consider the same capacity outdoor units for a same group.
- (4) The power range is obtained by the combination of 4 HP to 10 HP outdoor unit models (RAS-(XH(V)NP(1)E series).
- (5) 1-1 combination with SET FREE series is not allowed.

•	• (6)		DX-Interface series 2 ratio capacity	
			≤ 30%	30 ~ 100%
	Total connection ratio capacity against Outdoor Unit Capacity (%)		50 ~ 130%	50 ~ 100%

In case DX-Interface series 2 ratio is less than 30% of the outdoor units capacity, the total connection ratio against Outdoor Unit Capacity is 50 ~ 130%, Otherwise, total connection ratio is limited to 50 ~ 100%.

#### **♦ Thermo-ON/OFF Control Options**

The DX-Interface series 2 makes it possible to perform thermo-ON / thermo-OFF control in three different ways.

#### Standard thermo-ON / thermo-OFF control (Default setting)

Suitable for installations controlled by suction or discharge temperature.

The thermo-ON / thermo-OFF logic is operated from the difference between the reference temperature sensor and the set temperature on the remote controller or central controller.

#### By an external input

The thermo-ON / thermo-OFF control can be driven externally by an input signal connected to the CN3 socket of the PCB1 of the DX-Interface series 2.

Setting note: DIP Switch 1 - Pin 6 of DX-Interface series 2 PCB2 (small PCB) must be switched on (PCB2-DSW1#6 switched ON). Once the DSW has been set on the PCB, the "i1" input of CN3 is automatically set for thermo-ON / thermo-OFF control. The setting of the "i2" input is kept as set on the remote controller.

Please refer to the Service Manual of Hitachi Indoor Units for further information about the setting and connection of the auxiliary inputs to CN3 socket.

### By the duty signal

For systems controlled by a duty signal, it is possible to force thermo-OFF from the duty signal itself. When the duty signal reaches the minimum value of its range (0 V or 4 mA), the system switches to thermo-OFF condition. The duty value must become higher than 8% of its range in order to switch back to thermo-ON condition.

Note: No additional setting is required once the demand control setting has been set as Duty control.

### ◆ Thermo ON/OFF in capacity control mode by air outlet

All HEX designs have a  $\Delta T$  between Tin and Tout temperatures. When capacity demand keeps going down in inverter systems, there is a limit where the system operates at a minimum frequency (minimum system capacity), in spite of demand being lower than system capacity at the barely minimum working status. In these operation conditions, and depending on HEX characteristics, it may occur that the outlet temperature becomes lower than setting temperature (in cooling mode).

An optional function allows to adjust this difference of temperatures to more favourable conditions. The setting of this optional function (E1) can be done through the remote control, accepting several values:

	Optional Function E1			
Value Thermo ON/OFF offset parameter (when system operates at minimum capacity (min compressor Hz))				
00	0			
01	2			
02	4			

This setting allows to select the maximum Tout offset temperature (against Tsetting), assuming that setting temperature will not be achieved under certain circumstances. By doing so, in the same conditions the system can achieve a room temperature higher than setting temperature (in cooling mode), while avoiding the occurrence of cold draft. A function based on the same principle is available for Heating mode, avoiding an excessively high Tout.

### E1 selection criterium in cooling mode:

E1 = 0: No deviation from setting temperature (Default)

E1 = 1: Deviation of up to 2°C more than setting temperature is allowed

E1 = 2: Deviation of up to 4°C more than setting temperature is allowed

Example (Cooling mode)				
	Thanks to E1=1			
Correction value (A)		2		
Tset	25	25		
Tin	27	27		
∆T at minimum frequency	10	10		
Tout	17	27		
Thermo status	ON	OFF		
Over cooling temperature	8	-2		

#### E1 selection criterium in heating mode:

E1 = 0: No deviation from setting temperature (Default)

E1 = 1: Deviation of up to 2°C less than setting temperature is allowed

E1 = 2: Deviation of up to 4°C less than setting temperature is allowed



#### Considerations for DX-Interface series 2 installation.

These demand control options require specific considerations:


- Inlet temperature control: The system operates as a standard indoor unit whenever the device connected to the DX-Interface series 2 respects design requirements.
- Duty control and outlet air control: Control is possible because the system is able to cope with the changes in demand and operation conditions, but then system accuracy limitations must be taken into consideration. The adjustment of demand might not be guaranteed in all cases, depending on several aspects of the operation conditions (indoor and outdoor air condition, system actions to ensure unit reliability, desired gap between inlet and outlet...).

#### ◆ Mutiple DX-Interface series 2 installation

Up to 5 DX-Interface series 2 working with the same indoor unit or device with heat exchanger (HEX) can be installed. Such installation setting is restricted to certain applications, and by the installation of the dedicated IVX Premium RAS-XH(V)NP(1)E. This configuration is not allowed for other outdoor units.

### Installation considerations:

- One unit of DX-Interface series 2 is to be set as a group controller, while all the other group members are sub (PCB2, DSW1, pin 7).
- Air thermistors (THM1 and THM2) are only connected to the DX-Interface series 2 set as group controller. However, every DX-Inteface needs to be connected to its own pipe thermistors (THM3 and THM5).
- One remote controller PC-ARFP1E has to be installed in the DX-Interface series 2 set as group controller and all DX-Interfaces series 2 must be linked through the remote control transmission wiring.
- Outdoor units must be of the same capacity. It is recommended to split the heat exchanger in as many parts as DX-Interface s series 2 are used in the air stream direction, ensuring that all the HEX sections have equivalent inlet air flow and temperature conditions.

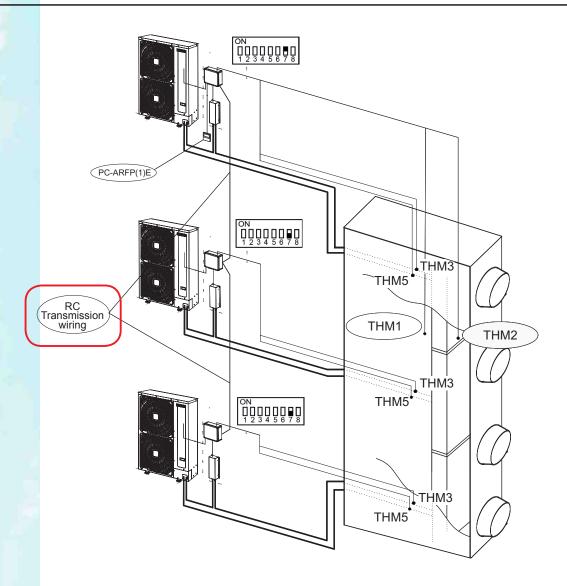

### Improvement of the defrost procedure

The defrost operation of outdoor unit connected to a DX-Interface series 2 working as a group is timed in order to avoid concurrent operation and limit the effect of a drop in heating capacity. This results in more stable capacity and better comfort for the application.

The beginning of defrosting operation of each OU is established according to the total number of DX-Interfaces series 2 and the individual need for defrost of each OU, so that secure operation can be guaranteed for each OU. In addition, simultaneous defrost is limited in order to obtain a better comfort.

The simultaneous defrost control is established according to the total number of DX-Interfaces series 2 working with the same unit or device with heat exchanger (HEX):

Number of DX-Interfaces series 2	Number of concurrent defrost
2 or 3	only 1 DX-Interface series 2 can defrost
4 or 5	up to 2 DX-Interfaces series 2 can defrost at the same time

# 2.14 KPI and KPI Active series 4E - Ventilation systems




The parts forming the range of complementary systems are designed to be added to the installation and improve the performance of aspects such as the power consumption, efficiency and quality of the air conditioning.

A KPI is a ventilation unit designed to renew the air from a room or area taking out the exhaust air and supplying fresh outdoor air, increasing then the indoor air quality. To reduce the effect of supplying outdoor air in a conditioned room where a big temperature gap exists between indoors and outdoors, the KPI exchanges sensible and latent heat between inlet and outlet air streams, approaching supply air conditions to indoor conditions. The result is an indoor air renovation with a significant reduction of the air conditioning system load that would be necessary to compensate the outdoor air supply.



- The sensible heat exchange effect is that the hottest air stream temperature is reduced, while the coldest one is increased.
- The latent heat exchange effect is the transmission of vapor (humidity) from the wettest air stream to the other.

The main benefit of a KPI unit versus other ventilation systems is the free conditioning of fresh air, reducing the air conditioning system demand.



Moreover, the Active KPI, based in a KPI structure, includes an additional air treatment stage before supply air (SA) section. This section includes a direct expansion valve coil, what makes possible the adaptation of the supply air to indoor air conditions, avoiding the inconvenient effect of air supply at a different temperature. Active KPI units have been prepared for the combination with both UTOPIA and SET FREE systems.

4E Energy Recovery and Active KPI is fully compatible with the same central control and interfaces of the rest of indoor units. The installation is also possible with previous versions, but with some functional limitations.

In air conditioning installations where comfort and healthiness of the supplied air must be guaranteed, the transfer of latent heat (humidity) between it and the exhaust air must be avoided. The KPI units include the cellulose energy exchanger that transfers sensible and latent heat between the supplied air and the exhaust air. The sensible heat exchange effect is that the hottest air stream temperature is reduced, while the coldest one is increased.


> Energy recovery exchanger (used also in KPI Active units)



### **♦** Compact units

KPI units were designed to optimise their weight and height and, as a result, making their transport and handling easier. Furthermore, they involve less installation space requirements and can be easily installed in a suspended ceiling like any other indoor unit.


Model	Α
252	270
502	330
802 / 1002	385
1502 / 2002	525

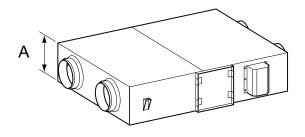

### **Easy to install**

The Hitachi KPI units are safe and easy to install. They are fitted with four attachment hooks for direct installation and a flange to seal the duct connection to the unit.

- A: KPI unit.
- B: sling bolt.
- C: rubber insulation.
- D: washer.
- E: lock nut.



### **Energy Recovery series vertical installation**

Vertical installation is allowed for Energy Recovery series units. The unit should be properly fixed to avoid its movement once installed. Must be guaranteed that any liquid can't flow into the unit.

Even though vertical installation is allow, transportation must follow handling instructions to avoid the damage of any component.

Vertical installation is not allowed in case of Active KPI.

### ◆ Operation flexibility with heat and/or humidity exchangers

The KPI units are available in a wide range of models, with air flow rates from 250 to 1650 m<sup>3</sup>/h. They provide the appropriate air flow rate in any type of installation in line with demand.

The cellulose energy exchanger transfers sensible and latent heat between the supplied air and the exhaust air.






1: winter operating. 2: summer operating.

A: exhaust air.


- The sensible heat exchange effect is that the hottest air stream temperature is reduced, while the coldest one is increased.
- The latent heat exchange effect is the transmission of vapor (humidity) from the wettest air stream to the other.


KPI units are fitted with a highly efficient exchanger to supply fresh air to indoor areas.

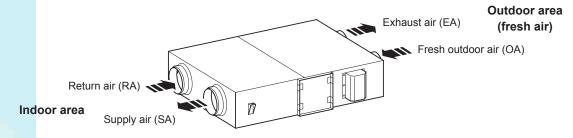

### Energy recovery exchanger (KPI energy recovery units and KPI Active units)

Sensible and latent heat transfer from outdoor air to extracted air in the summer and vice versa in the winter.









The responsible part of the exchange between both streams is the heat exchanger. The heat exchanger is a cross-flow sheet made of ultra-thin celluloid material (Energy Recovery) that allows an energy exchange temperature and humidity by crossing both streams. The air streams are never mixed.

#### **Example of operation in cooling mode**

	<b>5</b>		
A: outdoor air	B: exhaust air		
Temperature: 32 °C.			
Relative humidity: 70%.			
Absolute humidity: 0.0465 kgw/kga.		A	В
Enthalpy: 86.2 kJ/kg.			
C: return air	D: supply air	The MANNEY	Ē.
Temperature: 26 °C.	Temperature: 27.5 °C.	AAAA	2
Relative humidity: 50%.	Relative humidity: 63%.	AAAAA	
Absolute humidity: 0.0105 kgw/kga.	Absolute humidity: 0.0145 kgw/kga.	c	D
Enthalpy: 52.9 kJ/kg.	Enthalpy: 64.7 kJ/kg.		
kgw: kg of steam			
kga: kg of dry air			

### ◆ Active KPI discharge temperature control

The Active KPI is able to adapt the supply air temperature to desired discharge temperature.

Even though the KPI improves the air supply conditions, supply temperature will always be a combination of indoor and outdoor air temperatures. Active KPI supplies this additional temperature gap, making possible the control of the discharge air temperature.

### Harmonized fans ErP regulation

KPI-4E series are totally in compliance with all the efficiency and documentation requirements included in the regulation 1253/2014 (ErP Lot6, ventilation part). Such regulation is part of the general Ecodesign Directive 2009/125/EC.


The Ecodesign Directive (EU directive for energy related products) has developed specific efficiency and documentation requirements for Ventilation Units (VU), dividing them in Residential Ventilation Units (RVU) and Non-Residential Ventilation Units (NRVU) depending if maximum air flow is below 250 m³/h (RVU) or over 250 m³/h (NRVU). KPI-4E series whole line-up is classified then as NRVU, with specific requirements about design and temperature exchange efficiency and others, but without energy labelling requirements.

KPI-4E series has been designed to already comply with the temperature exchange efficiencies and structure design basics fixed by the regulation.

### **Noise reduction**

The effect of an internal structure design is reducing the air flow resistance and so the flow noise through the unit, combined with the application of highly efficient EC fan motors, make possible a reduction of the noise sensed below the unit and at the air discharge section.

The internal structure, done by Expanded PolyStyrene (EPS), in addition with the reduction of the unit weight, makes possible an aerodynamic design reducing the air flow resistance, and consequently the air flow noise inside the unit, which is emitted around it and around the discharge air section.




### ◆ EC fans: Reduced fan power input

KPI and KPI Active series are equipped with high efficient EC fan motors. Main benefit of using this kind of motors is a direct power consumption reduction, meaning a reduction of the specific fan power input of the unit, one of the main aspects considered in the European regulation for ventilation installations.

#### **♦ High-efficiency filter accessory**

When analysing indoor air quality control and air renovations by the supply of outdoor air, the filtering of the fresh air is a key point to consider when the installation is being designed. Besides, depending room final application (office, theatre, hospital...) a minimum filtering level must be guaranteed to cover the building regulations.

KPI and Active KPI series are factory supplied with two G3 air filters, one for inlet air and other for outlet air. Moreover, as accessory, a high efficiency air filter classified as F7 (based on EN779) is available for installations where an additional filtration section is necessary to ensure a high quality air indoors, reducing the effects of external pollution. This filter is placed easily into the unit by the main service cover, being the last treatment section (after the heat exchanger and the fan motor) of the inlet air stream.

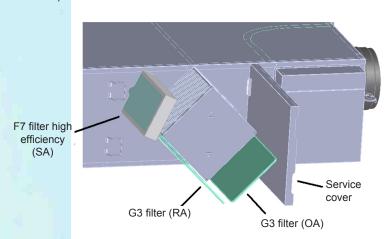

Model description	Code
HEF-252	70552201
HEF-502	70552202
HEF-802	70552203
HEF-1002	70552204
HEF-1502	70552205
HEF-2002	70552206
	description HEF-252 HEF-502 HEF-802 HEF-1002 HEF-1502



- G3: Gravimetric efficiency up to 90%.
- F7: Dust-Spot efficiency up to 90%.
- Filter classification based on EN779.

#### ♦ Insulations classified as M1

Some countries (i.e. France) consider the air conditioning ducted installations as "building components", forcing the elements that compose it, including the unit itself, to follow the same quality requirements. In these requirements are included the fire resistance, avoiding the unit promote the fire spread between rooms.

For this reason, all the internal and external insulations used in KPI and KPI Active series are certified as M1 (UNE-23327 Spain / NF P 92-501 France), fulfilling the ducted installation materials requirements.

# **♦** Automatic ventilation by CO₂ sensor

The concentration of CO<sub>2</sub> in a room is one of the main aspects considered for indoor air quality classification. This fact has been considered into several regulations, which classify the indoor air quality and fix the air renovations based on CO<sub>2</sub> concentration.


This concept is fully integrated in the KPI and KPI Active series, offering to the user two options to control the fan performance following CO<sub>2</sub> concentration levels.

### Automatic fan speed

For  $CO_2$  sensors with a proportional output (0~10V and 4~20mA output signals are accepted). The fan speed is automatically adjusted by the sensor output, ensuring always a high indoor air quality without any action by the user.




Power supply for sensors (24V DC) is available from KPI PCB, with a maximum total power output for both sensors of 6 W.



#### High concentration control

For on/off  $\mathrm{CO}_2$  sensors. KPI unit will work at set fan speed, but when the  $\mathrm{CO}_2$  concentration overpasses the detection threshold of the sensor, the KPI will start working at its maximum fan speed, helping to reduce the  $\mathrm{CO}_2$  levels. Once the sensor signal is turned off the set fan speed is recovered.

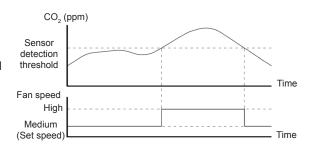

### **♦ Suitable fan pressure setting**

KPI and KPI Active series have been designed to be suitable in any installation. This concept covers several types of installations, including the ones where the KPI is supplying more than one area, what makes possible the KPI to be installed either in short duct installations or in large duct installations, and yet the KPI must cover the installation air renovations requirements.

KPI and KPI Active range have been designed offering an easy and fast setting of the fan pressure level through its PCB, making possible the selection based on installation real requirements. This can be translated as a guarantee that the ventilation flow rate is achieved at the same time that no additional air flow is used, what means lower noise levels emitted through the duct and a lower power consumption.

#### **◆ Electric-heater installation**

Energy recovery series and Active KPI series' heat exchanger element is made by a special celluloid material, similar to paper. In case the unit works with very low outdoor air temperatures, the heat exchanger element could be damaged decreasing significantly its exchange efficiency. For this reason the installation of an additional electrical heater (field supplied) in the OA section before the unit is recommended in installations where outdoor air temperatures below -5°C are possible. Furthermore, the installation of this electric heater in OA section could be also recommended where higher discharge air temperatures are required.

Electric heater power supply doesn't have to be done from the KPI Active electrical box, and its installation and protections must follow electrical heater manufacturer recommendations. Besides, a control signal is available from the KPI electrical box to control the switching on and off of this electric heater. By the sensing of the outdoor air, the control signal will be turned on when outdoor air temperature becomes below -5°C, and will be automatically turned off when outdoor air temperature exceeds -5°C, avoiding the installation of additional sensing devices into the electric heater element. Moreover, once the KPI is set for the electric heater application through the remote controller, the stoppage of the unit will be automatically delayed for three minutes once the remote controller is switched off. During this time the unit will work at its minimum fan speed, cooling down the electrical heater element avoiding the ducts damage by the remainder heat.



An additional air inlet thermistor (THM4) (sold separately as an option) must be installed before the electrical heater, in order to measure the temperature of the outdoor air to be heated.


#### **♦ Three different ventilation modes**

KPI and KPI Active series have been designed to offer to the user the maximum comfort at the same time the indoor air quality is improved by the renovation of the indoor air. Three different ventilation modes are available, so that the user can choose the ventilation mode of the system.

#### Forced energy recovery

The exchange between inlet and outlet air streams is always performed, without any incidence of the outdoor air condition. By this ventilation mode the inlet air will always be an average of the indoors and outdoors conditions.


SA: supply air.
EA. exhaust air.
RA: return air.
OA: outdoor air.



#### Forced free ventilation


The damper is fixed open, what means the heat exchanger element is bypassed and no exchange is performed between inlet and outlet air streams. The air from outdoors is directly supplied to indoors.

SA: supply air.
EA. exhaust air.
RA: return air.
OA: outdoor air.

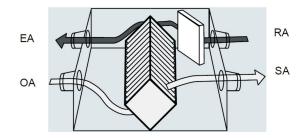

#### Automatic ventilation (factory setting)

An advanced temperature control is performed deciding automatically if the damper must be closed or open, based on indoor and outdoor temperatures and the setting temperature of the remote controller. The target is to achieve the maximum efficiency during the ventilation.

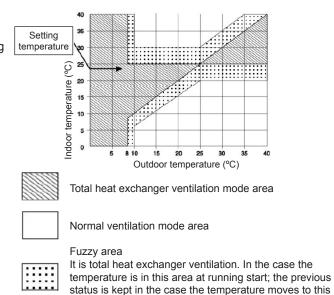

### ◆ Un-balancing of the ventilation for room pressurization

KPI unit works with two air streams: fresh air coming from outdoors and, on the hand, the indoor air to be renewed. As default setting the unit will supply the same quantity of air that it extracts, so the areas (if there is more than one) under the effect of the KPI will be balanced.

Depending the activities of the areas could be interesting to cause an over-pressure/depression in one of them, i.e. to avoid the smoke and smells to be transferred from one area to another. KPI offers the possibility to un-balance the two air-streams by the setting of the remote controller:

Pomoto control	Remote control Supply fan set		fan set	Exhaust fan set		
speed	Outdoor air fan (supply air)	Return air fan (exhaust air)	Outdoor air fan (supply air)	Return air fan (exhaust air)	Outdoor air fan (supply air)	Return air fan (exhaust air)
High	High	High	High	High	High	High
Medium	Medium	Medium	High	Medium	Medium	High
Low	Low	Low	Medium	Low	Low	Medium
			Prevent smoke and contamination to enter into the room and compensate the effect of auxiliary extraction devices.		Helps to evacuate contamination from	

### **♦** Fan stoppage delay function

Even though the ventilation system works for the whole day, while the installation is full of people doing any activity the indoor air won't be as fresh as it would be in case the facility is empty. This means that at the end of the day some pollution could remain in the air. If the ventilation system is stopped at the end of the activity, the remaining pollution wouldn't be extracted and the indoor air won't be completely fresh at the starting of the next day.

KPI series offer to the user the option to delay the stoppage of the unit, keeping the unit switched on when the conditioning/ventilation system is switched off during a specific time. In case of KPI Active, during this time the unit will work as an energy recovery ventilation unit (outdoor unit compressor off, without any cooling/heating load to save energy).

The result will be a completely fresh air of high quality at the starting of the next activity.

### Sound attenuator accessory

For installations where a reduction of the sound level is required, it is offered a sound attenuator to be connected directly on the unit duct adapter. An average reduction of 5 dB(A) is obtained in the discharge section (sound attenuation level in the field may vary depending on real installation specifications).

KPI unit	Sound attenuator model	Code	
KPI-502(E/X)4E	SLT-30-200-L600	70550200	
KPI-802(E/X)4E	SLT-30-250-L600	70550201	
KPI-1002(E/X)4E	SLT-30-300-L600	70550202	WV
KPI-1502(E/H)4E	SLT-30-355-L600	70550203	
KPI-2002(E/H)4E	SL1-30-355-L000	7000203	



Sound attenuator accessory is not available for KPI-252E4E model.

### 2.14.1 Active KPI

### Combinability

Active KPI units have been prepared for the combination with both UTOPIA and SET FREE systems.

	CAPACITIES (kW) (5)		Equivalent HP	COMBINABILITY	
	Cooling (1)	Heating (2)	Capacity	UTOPIA (3)	SET FREE (4)
KPI-502X4E	5.3 (1.8)	6.9 (2.1)	1.5 HP	_	V
KPI-802X4E	7.9 (2.9)	9.8 (3.5)	2.0 HP	2 HP	V
KPI-1002X4E	10.8 (3.7)	12.9 (4.4)	2.5 HP	2.5 HP	V



(1) Cooling capacity is based on the following conditions: OA= 35°C DB / 24°C WB; IA= 27°C DB / 19°C WB with the unit working at its nominal air flow (high speed).

Figure between brackets represents the capacity contribution of the heat exchanger element.

(2) Heating capacity is based on the following conditions: OA= 7°C DB / 6°C WB; IA= 20°C DB / 14°C WB with the unit working at its nominal air flow (high speed).

Figure between brackets represents the capacity contribution of the heat exchanger element.

(3) Only the single combination is allowed, with RAS-(2/2.5)HVNP(1) series.

In case of connecting the KPI-802X4E and KPI-1002X4E with RAS-(2/2.5)HVNP(1) outdoor units the capacity would be reduced as follows.

	CAPACITIES (kW) (5)		
	Cooling	Heating	
KPI-802X4E	7.4 (2.9)	9.1 (3.5)	
KPI-1002X4E	9.7 (3.7)	11.4 (4.4)	

<sup>(4)</sup> Allowed SET FREE series installation: FS(V)N(Y)3E, FSXNSE and FSXNPE.

For installations into SF systems, standard indications and selection methods used for SF outdoor units must be followed considering the Active KPI as a standard indoor unit of the equivalent HP capacity. The total capacity of installed Active KPIs can never exceed the 30% of the total system capacity.


For further information about SF selection method, please refer to SET FREE Technical Catalogue.

(5) Actual system performance may vary depending on the specific installation conditions.

#### **Control Specification**

#### Active KPI capacity demand control

Active KPI demand control is based on the control of the discharge air temperature. Set temperature on the remote controller or equivalent centralized controller will be understood by the control as the desired discharge temperature.

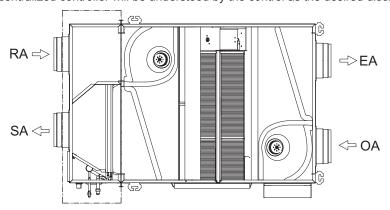

The capacity demand is adjusted by the continuous sensing of  $T_x$  and  $T_{out}$  temperatures. In case  $T_x$  becomes close to set temperature, the control could decide to stop the heat pump, saving energy and achieving the heat demand just by the effect of the heat exchanger element. Must be considered that return air (RA) is not supplied again to the room. It is extracted from indoors and replaced by fresh air (from OA to SA), changing typical considerations of conditioning indoor units

It could be possible that due to refrigerant cycle limitations, T, temperature, setting temperature and the whole system working conditions, "Tout" cannot be adjusted to match the setting temperature. In this case, by the continuous sensing of "Tout", the unit will cycle on/off in order to match as much as possible the setting temperature. During this on/off cycling the ventilation is never stopped in order to guarantee the air renovations.

### 2.15 Econofresh air renewal unit



The air in the rooms must be renewed to reduce the levels of CO<sub>2</sub> and to eliminate unpleasant smells, smoke and pollution; however, air renewal has the downside of an increased energy consumption.

The Econofresh is an easy-to-install smart accessory, which does not only supply a flow of fresh new air into the room while keeping the correct indoor temperature, but also provides natural cooling for increased energy saving (reducing the energy consumption).

The Econofresh unit efficiently manages air renewal in the room, in cooling as well as in heating mode. It is easy to install and it allows installers and designers to do without additional ventilation installations or additional refrigeration systems. This is possible because it is connected directly to the return duct of the RPI-(4.0-6.0)FSN6E-EF unit.


This system allows the inflow of fresh air into the room through the indoor unit, even when the thermostat is switched off (Thermo-OFF). Depending on the supply air and outlet air temperatures, the Econofresh works like an intelligent system, permanently controlling the air flow by modifying the position of the damper.

The Econofresh air renewal unit effectively increases the installation performance when the outdoor temperature is lower than the room temperature (in cooling mode), allowing the inlet of fresh air and cooling to the set temperature without activating the outdoor unit. For example, it can supply up to 100% of fresh air and is able to provide "natural cooling" through a damper when the outdoor temperature is lower than the set indoor temperature (in cooling mode), leading to significant energy savings particularly in spring and autumn.

The Econofresh can operate with CO<sub>2</sub> or enthalpy sensors to control the air quality in the room.

### System description & structure

The Econofresh is equipped with an outdoor air damper control mechanism, and the system provides various operation modes, such as free cooling, all fresh, in cooling and heating mode.

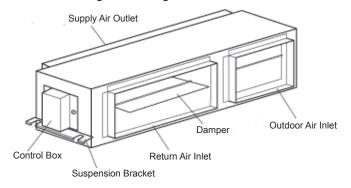



The Econofresh unit can only be installed in combination with the RPI-(4.0-6.0)FSN6E-EF units.

### Easy setting by 7-segments display

Most of the settings and optional functions are configurable through the control box PCB. The control box is equipped with a newly developed PCB, which includes four 7-segments display and three push buttons, making easier the setting during the installation.

#### Range of accessories

All indoor units have a range of accessories for easier installation, operating and maintenance.

These accessories are designed to adapt the unit to the type of installation that the air conditioning system needs and to improve its performance, considering the quality parameters required.

The range of accessories includes:


- Remote controls for the handling and management of the installation's operation.
- Panels to provide cassette-type indoor units with air outlet and distribution mechanisms.
- Filters to absorb dust and odours.
- Branch pipes (pipe kit and Multi-Kits), distributors and manifolds to effectively complete the installation.

The Econofresh kit is an easy-to-install intelligent accessory. It renews the air in the room and saves energy.

No cooling cycle is required. It is connected directly to the return duct of the RPI-(4.0-6.0)FSN6E-EF unit.



#### **Econofresh air renewal unit system**

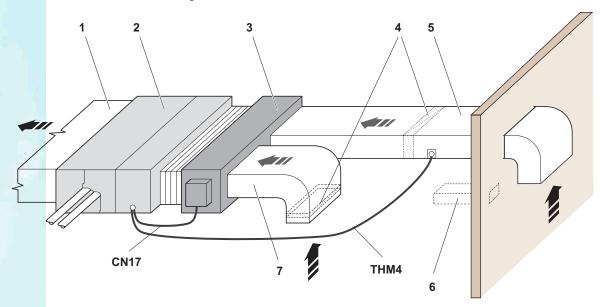

- 1 Supply air duct.
- 2 RPI-(4.0-6.0)FSN6E-EF indoor unit.
- 3 Econofresh
- 4 Return air filter (field supplied)
- 5 Fresh air inlet duct from the outside (field supplied)
- 6 Pressure relief damper (field supplied), connected if necessary to the outside or to another place with atmospheric pressure
- 7 Return air inlet duct from the inside (field supplied)

THM4 Thermistor cable **CN17** AS motor cable

The Econofresh kit can supply up to 100% of fresh air and is able to provide "natural cooling" through a damper when the outdoor temperature is lower than the set indoor temperature.

The system not only supplies fresh air and keeps the room at the correct temperature, it also provides natural cooling for increased energy savings.



RPI-(4.0-6.0)FSN6E-EF units are supplied with standard Air Filter at the suction side. This air filter need to be removed, adding a Return air filter (field supplied) in the supply air duct from outside and return air duct front inside.

### Damper control

A micro-computer controls the angle of the damper according to air temperatures to adjust the fresh air flow, thus keeping the room temperature constant with excellent comfort.

### Selectable minimum damper opening

The minimum opening for fresh outdoor air damper is selectable through the remote control switch (d7 setting of the optional remote control functions). This allows to establish a minimum air volume renewal in the room.

## Standard and All Fresh process mode


Two different process modes are selectable:

### Standard process

#### Standard process in cooling mode


In case that the outdoor ambient temperature is lower than 19 °C, the compressor stops and the indoor temperature is cooled down with an intake of outdoor fresh cold air controlled by the damper.

The minimum guaranteed fresh air intake can be set through d7 setting (7% or more of the total outlet air).



### Cooling economizer

An energy saving control is adopted which uses fresh cold air from the outdoor for cooling the intermediate seasons. The compressor is not used during this control, which results in outstanding energy saving.

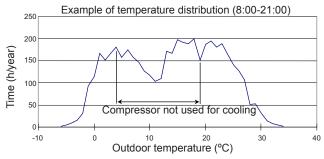

### 3 different economizer cooling controls


In order to optimise the energy saving, Econofresh can manage 3 types of control: normal cooling, outdoor air cooling or fan cooling. Each type is managed according to the outdoor air temperature.

#### Comfort control

When Thermo OFF is requested, Econofresh compares temperatures in order to offer a good comfort in the room. Econofresh control compares the setting temperature (set in the remote control) and the inlet air temperature in the Indoor Unit, and requests Thermo ON under certain conditions, in order to achieve the requested room temperature as soon as possible.

### Standard process in heating mode

Depending on the temperature of indoor air return, the damper remains either opened for a minimum guaranteed intake of fresh air, or fully closed during 10 minutes. After this time, the damper is opened for a minimum guaranteed intake of fresh air intake; this opening can be set through d7 setting (7% or more of the total outlet air).



#### ♦ All Fresh process in cooling and heating mode

This operation mode is very useful for buildings with many tenants, or for public buildings.

Basically, the damper is fully opened (100% fresh air) when activated through the corresponding optional setting of the remote control (E1).

The following parameters are controlled by the All Fresh process in an independent fashion:


- Thermo ON/OFF status
- · Damper opening
- Fan speed

#### Thermo ON/OFF status

The general principle is that the compressor remains stopped when the outdoor ambient temperature is lower than 17°C in cooling mode and higher than 24°C in heating mode.

### Damper opening

The damper is set to be either fully open or closed to the minimum opening to ensure an intake of fresh air (7% or more of the total outlet air, as fixed by d7 setting).



Additionally, the damper is closed to the minimum opening to ensure an intake of fresh air, under certain temperature combinations.

#### Fan speed

The fan speed is adjusted one tap lower when the air outlet temperature...

- rises higher than 20°C in cooling mode
- drops lower than 30°C in heating mode

In the above cases, the fan speed is changed from high to medium, or from medium to low.

The fan speed is adjusted back to fan setting tap when air outlet temperature returns to the following ranges:

- 15°C or lower in cooling mode
- 35°C or higher in heating mode

### **Draft prevention control**

Additionally, while All Fresh process is activated, the Econofresh control keeps monitoring and comparing several temperature parameters. The damper may be closed to the minimum opening to ensure the intake of fresh air under certain circumstances, and in order to avoid discomfort and unwanted changes to room temperature due to inlet outdoor air conditions.

This function is active in case that the outdoor ambient temperature is:

- 5 degrees higher than the setting temperature in cooling thermo-OFF
- 5 degrees lower than the setting temperature in heating thermo-OFF

# Econofresh enthalpy and CO<sub>2</sub> gas sensors

### Econofresh enthalpy sensor (field-supplied)

This function provides precise control of the air quality, mixing the outdoor air and return air inflow as determined by an entalphy sensor installed outside, at the "outdoor air" inlet.

The sensor is connected to the input signal port CN3 (pins 1-2), and it is necessary to set the enthalpy sensor mode through remote control switch settings (optional control function E2).

- The arrangement of the switch shall be:
- OFF: to activate free cooling
- ON: to activate mechanical cooling (Thermo ON)

### Econofresh CO<sub>2</sub> gas sensor (field-supplied)

The system controls the concentration of CO<sub>2</sub> gas by means of the CO<sub>2</sub> gas sensor installed in the room.

The sensor is connected to the input signal port CN3 (pins1-2), and it is necessary to set the CO<sub>2</sub> Gas sensor through remote control switch settings (optional control function E4).

- The arrangement of the switch shall be:
  - ON: to increase the intake of outdoor air
  - OFF: to decrease the intake of outdoor air

# i NOTE

- The enthalpy sensor and CO<sub>2</sub> gas sensor cannot be installed together.
- The enthalpy sensor and CO<sub>2</sub> gas sensor have no effect on the Econofresh operation when the All Fresh process is activated.

# General data

# Index

3.1	General data	100
	3.1.1 RCI-FSR - 4-way cassette	101
	3.1.2 RCIM-FSRE - 4-way cassette (compact)	103
	3.1.3 RCD-FSR - 2-way cassette	105
	3.1.4 RPC-FSR - Ceiling type	107
	3.1.5 RPI(L/H)-FSRE - Indoor ducted unit	109
	3.1.6 RPI-FSN6E-EF - Indoor ducted unit for Econofresh assembly	112
	3.1.7 RPI-FSN3(P)E(-f) - Indoor ducted unit	113
	3.1.8 RPK - Wall type	115
	3.1.9 RPF - Floor type and RPFI - Floor concealed type	117
	3.1.10 KPI Units	119
	3.1.11 Econofresh kit	122
	3.1.12 DX-Interface	122
	3.1.13 Adjusted capacities of indoor units	122
3.2	Component data	123
	3.2.1 RCI-FSR - 4-way cassette	123
	3.2.2 RCIM-FSRE - 4-way cassette (compact)	124
	3.2.3 RCD-FSR - 2-way cassette	124
	3.2.4 RPC-FSR - Ceiling type	126
	3.2.5 RPI - Indoor ducted unit	127
	3.2.6 RPK - Wall type	130
	3.2.7 RPF - Floor type and RPFI - Floor concealed type	131
	3.2.8 KPI Units	132
3.3	Electrical data	133
	3.3.1 Considerations	133
	3.3.2 RCI - 4-way cassette	133
	3.3.3 RCIM - 4-way cassette (compact)	133
	3.3.4 RCD - 2-way cassette	134
	3.3.5 RPC - Ceiling type	134
	3.3.6 RPI - Indoor ducted unit	135
	3.3.7 RPK - Wall type	135
	3.3.8 RPF(I) - Floor type	136
	3.3.9 KPI energy	136

### 3.1 General data

### Indoor units general considerations

The nominal cooling and heating capacities indicated refer to the outdoor units operating with the indoor units at 100% of their capacity and are based on the EN14511 standard, with the operating conditions indicated in the table:



- The cooling and heating capacity of the indoor units is different in the UTOPIA Prime / UTOPIA IVX Prime, UTOPIA IVX Standard / Premium series, Centrifugal VRF and SET FREE systems.
- In the case of UTOPIA Prime / UTOPIA IVX Prime , UTOPIA IVX Standard / Premium series and Centrifugal VRF, the nominal capacity shown in the following tables corresponds to combinations of 1 indoor unit with 1 outdoor unit, provided that such combination is allowed.

### Operation conditions

		Cooling	Heating	
Indoor air inlet temperature	DB	27.0 °C	20.0 °C	
	WB	19.0 °C	_	
Outdoor air inlet town orature	DB	35.0 °C	7.0 °C	
Outdoor air inlet temperature	WB	_	6.0 °C	
DB: dry bulb; WB: wet bulb				

Pipe length: 7.5 m; pipe height: 0 m.

Power supply: 230 V.

The sound pressure level has been measured in an anechoic chamber under the following conditions:

RCI(M), RCD indoor units: 1.5 m below the unit.

RPC and RPK indoor units: 1 m below the unit, 1 m from the discharge louver.

RPF(I): 1 m from floor level, 1 m from the front surface of the unit.



Reflected sound must be considered when installing the unit in the field. Because of it the sound pressure load measured in on installation could be higher than the specification.

The tests for RCI, RCIM and RCD units were carried out in combination with their respective panels as indicated in chapter "1. General information".

Sound power level was measured in a reverberant room, in accordance with the EN12102 standard. Used environment conditions are the same as specified in EN14511 for performance test.

# 3.1.1 RCI-FSR - 4-way cassette

### RCI-(1.0-2.5)FSR

	MODEL			RCI-1.0FSR	RCI-1.5FSR	RCI-2.0FSR	RCI-2.5FSR		
Power supply					1~ 230	V 50Hz			
Nominal cooling	capacity (UTOPIA)		kW	2.5	3.6	5.0	5.6		
Nominal heating	capacity (UTOPIA)		kW	2.8	4.0	5.6	6.3		
Nominal cooling	capacity (SET FREE	(1)	kW	2.8	4.0	5.6	7.1		
Nominal heating	capacity (SET FREE	Ξ)	kW	3.2	4.8	6.3	8.5		
Air flow	Speed (Hi2/Hi/Me/Lo)		m³/min	15 / 13 / 11 / 9	21 / 17 / 14 / 11	22 / 17 / 14 / 11	27 / 23 / 18 / 1		
an motor type (d	output)		W	57	57	57	57		
Sound pressure evel	Speed (Hi2/Hi/Me/Lo)		dB(A)	33 / 30 / 28 / 27	35 / 31 / 30 / 27	37 / 32 / 30 / 27	42 / 36 / 32 / 2		
Sound power leve	el		dB(A)	52	53	55	56		
	Height		mm	248	248	248	248		
Outer dimensions	Width		mm	840	840	840	840		
	Depth		mm	840	840	840	840		
Net weight			kg	20	21	21	22		
Refrigerant				R32 / R4	10A (factory-charg	ed corrosion-proof	nitrogen)		
Refrigerant pipe	connection				Flare	nuts			
Refrigerant pipe	Liquid		mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 9.52 (3/8)		
size	Gas		mm (in)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 15.88 (5/8		
Condensate drair	connection		mm	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>		
Maximum electric	city demand		А	5	5	5	5		
Packaging volum	e		m <sup>3</sup>	0.26	0.26	0.26	0.26		
Adaptable air par (Sold separately				P-N23NA2/ P-GP160NAP/ P-GP160NAPU/ P-AP160KA3/ P-GP160KAP					
0.1	all and a			Neutral wh	ite (4.56Y8.85/0.38 P-GP16	3): P-N23NA2/ P-0 60NAPU	GP160NAP/		
Colour (Muns	ell code)				Black (8.1B 0.5/0	.2): P-AP160KA3			
					Black (N2): F	P-GP160KAP			
	P-N23NA2			40	40	40	40		
	P-GP160NAP			52	52	52	52		
	P-GP160NAPU	Height		52	52	52	52		
Outer dimensions	P-AP160KA3		mm	40	40	40	40		
difficitions	P-GP160KAP			52	52	52	52		
	All consider	Width		950	950	950	950		
	All models	Depth		950	950	950	950		
	P-N23NA2			6.5	6.5	6.5	6.5		
	P-GP160NAP			8.5	8.5	8.5	8.5		
Net weight	P-GP160NAPU P-AP160KA3 P-GP160KAP		kg	10	10	10	10		
-				6.5	6.5	6.5	6.5		
				8.5	8.5	8.5	8.5		
Packaging volume			m <sup>3</sup>	0.10	0.10	0.10	0.10		
Packaging vo	Idillo								

<sup>&</sup>lt;sup>(1)</sup> Outer diameter (VP25).

### RCI-(3.0-6.0)FSR

	MODEL			RCI-3.0FSR	RCI-4.0FSR	RCI-5.0FSR	RCI-6.0FSR			
Power supply					1~ 230V 50Hz					
Nominal cooling	capacity (UTOPIA	)	kW	7.1	10.0	12.5	14.0			
Nominal heating	capacity (UTOPIA	.)	kW	8.0	11.2	14.0	16.0			
Nominal cooling	capacity (SET FRI	EE)	kW	8.0	11.2	14.0	16.0			
Nominal heating	capacity (SET FR	EE)	kW	9.0	12.5	16.0	18.0			
Air flow	Speed (Hi2/Hi/Me/Lo)		m³/min	27 / 23 / 18 / 14	37 / 31 / 24 / 20	37 / 33 / 26 / 21	37 / 35 / 28 / 2			
Fan motor type	(output)		W	57	127	127	127			
Sound Speed oressure level (Hi2/Hi/Me/Lo)		dB(A)	42 / 36 / 32 / 28	48 / 43 / 39 / 33	48 / 45 / 40 / 35	48 / 46 / 41 / 3				
Sound power le	vel		dB(A)	57	64	64	65			
	Height		mm	298	298	298	298			
Outer dimensions	Width		mm	840	840	840	840			
AII 1101101110	Depth		mm	840	840	840	840			
Net weight			kg	26	26	26	26			
Refrigerant				R32 / F	R410A (factory-char	ged corrosion-proof	nitrogen)			
Refrigerant pipe	connection				Flar	e nuts				
Refrigerant	Liquid		mm (in)	Ø 9.52 (3/8)	Ø 9.52 (3/8)	Ø 9.52 (3/8)	Ø 9.52 (3/8)			
oipe size	Gas		mm (in)	Ø 15.88 (5/8)	Ø 15.88 (5/8)	Ø 15.88 (5/8)	Ø 15.88 (5/8)			
Condensate dra	in connection		mm	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>			
Maximum currer	nt		Α	5	5	5	5			
Packaging volur	ne		m³	0.31	0.31	0.31	0.31			
Adaptable air panel model										
Adaptable air pa (Sold separately				P-N23NA2/ P-A	P160NAP/ P-GP-16	60NAPU/ P-AP160k	(A3/ P-GP160KAF			
	as an option)			-	56Y8.85/0.38): P-N Black (8.1B 0.5/	60NAPU/ P-AP160K 23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP				
(Sold separately	as an option)			-	56Y8.85/0.38): P-N Black (8.1B 0.5/	23NA2/ P-GP160NA 0.2): P-AP160KA3				
Sold separately	as an option)			Neutral white (4.	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2):	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP	AP/ P-GP160NAP			
Sold separately	sell code)	Height		Neutral white (4.4	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2):	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40	AP/ P-GP160NAP			
(Sold separately  Colour (Mun  Outer	y as an option) sell code) P-N23NA2 P-GP160NAP	Height	mm	Neutral white (4.4)	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2): 40 52	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52	AP/ P-GP160NAP 40 52			
(Sold separately  Colour (Mun	P-N23NA2 P-GP160NAP P-GP160NAPU P-AP160KA3	Height	mm	40 52 52 40	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2): 40 52 52 40	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40	40 52 52 40			
(Sold separately  Colour (Mun  Outer	P-N23NA2 P-GP160NAP P-GP160NAPU P-AP160KA3 P-GP160KAP		mm	Neutral white (4.4) 40 52 52	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2): 40 52 52	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52	40 52 52 40 52			
Sold separately  Colour (Mun  Outer	P-N23NA2 P-GP160NAP P-GP160NAPU P-AP160KA3	Width	mm	40 52 52 40 52 950	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2): 40 52 52 40 52 950	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40 52 950	40 52 52 40 52 950			
Sold separately  Colour (Mun  Outer	P-N23NA2 P-GP160NAP P-GP160NAPU P-AP160KA3 P-GP160KAP		mm	40 52 52 40 52 950	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2): 40 52 52 40 52 950	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40 52 950	40 52 52 40 52 950			
Sold separately  Colour (Mun  Outer	P-N23NA2 P-GP160NAP P-GP160NAPU P-AP160KA3 P-GP160KAP All models P-N23NA2	Width	mm	40 52 52 40 52 950 950	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2): 40 52 52 40 52 950 950 6.5	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40 52 950 950 6.5	40 52 52 40 52 950 950			
Colour (Mun  Outer dimensions	P-N23NA2 P-GP160NAP P-GP160NAPU P-AP160KA3 P-GP160KAP All models	Width		40 52 52 40 52 950	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2): 40 52 52 40 52 950 950 6.5 8.5	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40 52 950 950 6.5 8.5	40 52 52 40 52 950			
(Sold separately  Colour (Mun  Outer	P-N23NA2 P-GP160NAPU P-AP160KA3 P-GP160KAP All models P-N23NA2 P-GP160NAPU	Width	mm	40 52 52 52 40 52 950 950 6.5 8.5	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2):  40  52  52  40  52  950  950  6.5  8.5  10	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40 52 950 950 6.5 8.5	40 52 52 40 52 950 950 6.5 8.5			
(Sold separately  Colour (Mun  Outer  dimensions	P-N23NA2 P-GP160NAP P-AP160KA3 P-GP160KAP All models P-N23NA2 P-GP160NAP	Width		40 52 52 40 52 950 950 6.5 8.5 10 6.5	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2):  40  52  52  40  52  950  950  6.5  8.5  10  6.5	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40 52 950 950 6.5 8.5 10 6.5	40 52 52 40 52 950 950 6.5 8.5 10 6.5			
(Sold separately  Colour (Mun  Outer  dimensions	P-N23NA2 P-GP160NAPU P-AP160KAP All models P-N23NA2 P-GP160NAPU P-AP160KAP All models P-N23NA2 P-GP160NAPU P-AP160NAPU P-GP160NAPU P-AP160KA3 P-GP160NAPU	Width		40 52 52 52 40 52 950 950 6.5 8.5	56Y8.85/0.38): P-N: Black (8.1B 0.5/ Black (N2):  40  52  52  40  52  950  950  6.5  8.5  10	23NA2/ P-GP160NA 0.2): P-AP160KA3 P-GP160KAP 40 52 52 40 52 950 950 6.5 8.5	40 52 52 40 52 950 950 6.5 8.5			

<sup>&</sup>lt;sup>(1)</sup> Outer diameter (VP25).

# 3.1.2 RCIM-FSRE - 4-way cassette (compact)

### RCIM-(0.4-1.0)FSRE

M	ODEL		RCIM-0.4FSRE	RCIM-0.6FSRE	RCIM-0.8FSRE	RCIM-1.0FSRE		
Power supply			1~ 230V 50Hz					
Nominal cooling capacity (	UTOPIA)	kW	-	-	2	2.5		
Nominal heating capacity (	(UTOPIA)	kW	-	-	2.2	2.8		
Nominal cooling capacity (	SET FREE)	kW	1.1	1.7	2.2	2.8		
Nominal heating capacity (SET FREE) kW			1.3	1.9	2.5	3.2		
Air flow Speed (Hi2/Hi/Me/Lo)		m³/min	8.5/7.8/6.9/6.0	10/8.5/7.5/6	11/9.5/8/6	12/10/8.5/6		
Fan motor type (output)		W	57	57	57	57		
Sound pressure level Speed (Hi2/Hi/Me/Lo)		dB(A)	29/27/25/24.5	34/30/28/24.5	36/33/29/24.5	38/34/30/24.5		
Sound power level		dB(A)	43	47	50	51		
	Height	mm	285	285	285	285		
Outer dimensions	Width	mm	570	570	570	570		
	Depth	mm	570	570	570	570		
Net weight		kg	16	16	16	16		
Refrigerant			R32 / R4	410A (factory-charg	ed corrosion-proof I	nitrogen)		
Refrigerant pipe connectio	n		Flare nuts					
Defricement nine size	Liquid	mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)		
Refrigerant pipe size	Gas	mm (in)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)		
Condensate drain connect	ion	mm	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>		
Maximum electricity dema	nd	Α	5	5	5	5		
Packaging volume		m³	0.13	0.13	0.13	0.13		
Adaptable air panel model (Sold separately as an opt			P-AP56NAM (without Motion Sensor) P-AP56NAMS (Motion Sensor embedded) P-AP56NAMR (Receiver kit embedded)					
Colour (Munsell code)				Neutral white (4	1.56Y8.85/0.38)			
	Height	mm	30	30	30	30		
Outer dimensions	Width	mm	620	620	620	620		
	Depth	mm	620	620	620	620		
Net weight		kg	2.5	2.5	2.5	2.5		
Packaging volume		m³	0.07	0.07	0.07	0.07		
Remote control (Sold sepa	arately as an option)			PC-ARFP1E / PC-	ARH1E / PC-AWR			

<sup>(1)</sup> Outer diameter(VP25).

### **RCIM-(1.5-2.5)FSRE**

IV	IODEL		RCIM-1.5FSRE	RCIM-2.0FSRE	RCIM-2.5FSR	
Power supply				1~ 230V 50Hz		
Nominal cooling capacity (UTC	PIA)	kW	3.6	5.0	5.6	
Nominal heating capacity (UTC	PIA)	kW	4.0	5.6	6.3	
Nominal cooling capacity (SET	FREE)	kW	4.0	5.6	7.1	
Nominal heating capacity (SET	FREE)	kW	4.8	6.3	8.5	
Air flow Speed (Hi2/Hi/Me/Lo)		m³/min	13/11/9.5/7	15/12/10/8	16/14/12/10	
Fan motor type (output)		W	57	57	57	
Sound pressure level	Speed (Hi2/Hi/Me/Lo)	dB(A)	41/37/33/27.5	45/39/35/31	47/43/39/35	
Sound power level		dB(A)	54	56	60	
	Height	mm	285	285	285	
Outer dimensions	Width	mm	570	570	570	
	Depth	mm	570	570	570	
Net weight	kg	16	17	17		
Refrigerant			R32 / R410A (fa	ctory-charged corrosio	n-proof nitrogen)	
Refrigerant pipe connection				Flare nuts		
Defrigerent nine size	Liquid	mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 9.52 (3/8)	
Refrigerant pipe size	Gas	mm (in)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 15.88 (5/8)	
Condensate drain connection		mm	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	
Maximum electricity demand		А	5	5	5	
Packaging volume		m <sup>3</sup>	0.13	0.13	0.13	
Adaptable air panel model (Sold separately as an option)			P-AP56NAM (without Motion Sensor) P-AP56NAMS (Motion Sensor embedded) P-AP56NAMR (Receiver kit embedded)			
Colour (Munsell code)			Neu	utral white (4.56Y8.85/0	0.38)	
	Height	mm	30	30	30	
Outer dimensions	Width	mm	620	620	620	
	Depth	mm	620	620	620	
Net weight		kg	2.5	2.5	2.5	
Packaging volume		m³	0.07	0.07	0.07	
Remote control (Sold separate	ly as an option)		PC-AR	RFP1E / PC-ARH1E / P	C-AWR	

The data obtained is based on the operating conditions described at the beginning of this chapter.

# 3.1.3 RCD-FSR - 2-way cassette

### RCD-(0.8-2.0)FSR

MODEL		RCD-0.8FSR	RCD-1.0FSR	RCD-1.5FSR	RCD-2.0FSR		
		1~ 230V 50Hz					
(UTOPIA)	kW	2.0	2.5	3.6	5.0		
Nominal heating capacity (UTOPIA)			2.8	4.0	5.6		
Nominal cooling capacity (SET FREE) kW			2.8	4.0	5.6		
y (SET FREE)	kW	2.5	3.2	4.8	6.3		
Air flow Speed (Hi/Me/Lo)		10/9/7.5/6.5	11/9.5/8.5/7	15/13/11.5/10	16.5/14.5/12.5/10.		
	W	57	57	57	57		
Sound pressure level Speed (Hi2/Hi/Me/Lo)		30/29/28/27	31/29/28/27	37/34/31/30	39/36/33/30		
Sound power level Speed (Hi2/Hi/Me/Lo)		45/44/43/42	48/46/45/44	51/49/47/46	52/51/49/47		
Height	mm	345	345	345	345		
Width	mm	860	860	860	860		
Depth	mm	630	630	630	630		
	Kg	23	23	25	25		
		R32 / F	R410A (factory-char	ged corrosion-pro	of nitrogen)		
ion		Flare nuts					
Liquid	mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)		
Gas	mm (in)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)		
ction	mm	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>		
and	А	5	5	5	5		
	m³	0.24	0.24	0.24	0.24		
el ption)			P-AP90DNA (wit	hout Motion Senso	or)		
<del>)</del>			Neutral white	(4.56Y8.85/0.38)			
Height	mm	30	30	30	30		
Width	mm	1100	1100	1100	1100		
Depth	mm	710	710	710	710		
	kg	7.5	7.5	7.5	7.5		
	m³	0.13	0.13	0.13	0.13		
parately as an option	)		PC-ARFP1E / PC	C-ARH1E / PC-AW	/R		
	y (UTOPIA) y (UTOPIA) y (UTOPIA) y (SET FREE) y (SET FREE) Speed (Hi/Me/Lo) Speed (Hi2/Hi/Me/Lo) Height Width Depth  ion Liquid Gas ction and el ption) e) Height Width Depth	(UTOPIA)   kW   (UTOPIA)   kW   (UTOPIA)   kW   (SET FREE)   kW   (SET FREE)   kW   (SET FREE)   kW   Speed (Hi/Me/Lo)   W   Speed (Hi2/Hi/Me/Lo)   dB(A)   Height   mm   Width   mm   Kg   mm (in)   Gas   mm (in)   Gas   mm (in)   ction   mm   mand   A   m³   el ption)   el   Height   mm   Width   mm   Depth   mm   width   mm   Depth   mm   mm   mand   A   m³   el ption)   el   mm   mm   mm   mm   mm   mm   mm	(UTOPIA)	Composition   Composition	Topic   Topi		

<sup>(1)</sup> Outer diameter (VP25).

The data obtained is based on the operating conditions described at the beginning of this chapter.

### RCD-(2.5-6.0)FSR

	MODEL		RCD-2.5FSR	RCD-3.0FSR	RCD-4.0FSR	RCD-5.0FSR	RCD-6.0FSR		
Power supply				1	~ 230V 50Hz	0			
Nominal cooling ca	apacity (UTOPIA)	kW	5.6	7.1	10.0	12.5	14.0		
Nominal heating c	apacity (UTOPIA)	kW	6.3	8.0	11.2	14.0	16.0		
Nominal cooling ca (SET FREE)	apacity	kW	7.1	8.0	11.2	14.0	16.0		
Nominal heating c (SET FREE)	Nominal heating capacity (SET FREE)		8.5	9.0	12.5	16.0	18.0		
Air flow	Speed (Hi/Me/Lo)	m³/min	18.5/16.5/14.5/12.5	21/18.5/16/12.5	30/26.5/23/20	35/31/27/21	37/32.5/28.5/24		
Fan motor type (or	utput)	W	57	57	57x2	57x2	57x2		
Sound pressure level	Speed (Hi2/Hi/Me/Lo)	dB(A)	42/39/36/33	45/42/38/33	43/40/37/34	47/44/41/35	48/45/42/38		
Sound power level	Speed (Hi2/Hi/Me/Lo)	dB(A)	55/52/51/49	58/55/52/49	57/55/52/50	60/55/52/50	61/59/56/53		
_	Height	mm	345	345	345	345	345		
Outer dimensions	Width	Mm	860	860	1420	1420	1420		
difficitions	Depth	Mm	630	630	630	630	630		
Net weight		Kg	25	25	39	39	39		
Refrigerant			R32	/ R410A (factory-	charged corrosi	on-proof nitroger	1)		
Refrigerant pipe co	onnection		Flare nuts						
Refrigerant pipe	Liquid	mm (in)	Ø 9.52 (3/8)						
size	Gas	mm (in)	Ø 15.88 (5/8)						
Condensate drain	connection	mm	Ø 32 <sup>(1)</sup>						
Maximum electrici	ty demand	Α	5	5	5	5	5		
Packaging volume	<b>:</b>	m³	0.24	0.24	0.36	0.36	0.36		
Adaptable air pane as an option)	el model (Sold sepa	ırately	P-AP90DNA (withou	t Motion Sensor)	P-AP160E	DNA (without Mot	ion Sensor)		
Colour (Munse	ell code)			Neutral w	hite (4.56Y8.85/	0.38)			
	Height	mm	30	30	30	30	30		
Outer dimen- sions	Width	mm	1100	1100	1660	1660	1660		
010110	Depth	mm	710	710	710	710	710		
Net weight		kg	7.5	7.5	10.5	10.5	10.5		
Packaging vol	ume	m <sup>3</sup>	0.13	0.13	0.20	0.20	0.20		
Remote control (Sold separately a	s an option)			PC-ARFP1E	/ PC-ARH1E / F	PC-AWR			
(1) Outer diameter	(\/D2E\								

<sup>(1)</sup> Outer diameter (VP25).

### 3.1.4 RPC-FSR - Ceiling type

### RPC-(1.5-3.0)FSR

N	MODEL		RPC-1.5FSR	RPC-2.0FSR	RPC-2.5FSR	RPC-3.0FSR			
Power supply			1~ 230V 50Hz						
Nominal cooling capacit	y (UTOPIA)	kW	3.6	5.0	5.6	7.1			
Nominal heating capacit	Nominal heating capacity (UTOPIA) k¹			5.6	6.3	8.0			
Nominal cooling capacit	y (SET FREE)	kW	4.0	5.6	7.1	8.0			
Nominal heating capacit	ty (SET FREE)	kW	4.8	6.3	8.5	9.0			
Air flow	ir flow Speed (Hi2/Hi/Me/Lo)		15/13/11/9	15/13/11/9	19/16.5/14/11.5	21/18.5/15.5/12.5			
Fan motor type (output)		W	50	50	80	80			
Sound pressure level Speed (Hi2/Hi/Me/Lo)		dB(A)	37/35/31/28	38/35/31/28	38/35/31/28	40/37/33/29			
Sound power level	Speed (Hi2/Hi/Me/Lo)	dB(A)	53/50/46/43	54/50/46/43	54/50/47/44	56/52/48/44			
	Height	mm	235	235	235	235			
Outer dimensions	Width	mm	960	960	1270	1270			
	Depth	mm	690	690	690	690			
Net weight	·	kg	26	27	35	35			
Refrigerant			R32 / R410A (factory-charged corrosion-proof nitrogen)						
Refrigerant pipe connec	tion				Flare nuts				
Defeirement wine sine	Liquid	mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 9.52 (3/8)	Ø 9.52 (3/8)			
Refrigerant pipe size	Gas	mm (in)	Ø 12.7 (1/2)	Ø 15.88 (5/8)	Ø 15.88 (5/8)	Ø 15.88 (5/8)			
Condensate drain conne	ection	mm	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>			
Drain-up Mechanism (o	otional - sold separa	ately)	DUPC-63K1	DUPC-71K1	DUPC-160K1	DUPC-160K1			
Maximum electricity der	nand	А	5	5	5	5			
Packaging volume		m³	0.23	0.23	0.31	0.31			
Colour (Munsell code)				Neutral white	(4.56Y8.85/0.38)				
Remote control (Sold se	parately as an option	on)	PC-ARFP1E / PC-ARH1E / PC-AWR						

The data obtained is based on the operating conditions described at the beginning of this chapter.

# i NOTE

- Before installing the indoor unit, provide a hole (Ø 300 mm) for piping connection. Use the accessory refrigerant gas/liquid pipes and pipe for drain-up to mount the drain-up mechanism.
- PVC Tube (VP25) must be used for the drain connection.
- Lower the indoor unit 10 mm when the drain-up mechanism is installed. (In case of inclination beyond 10 mm, it'll be water leakage or abnormal stoppage.)
- Do not provide a trap or riser portion for the drain pipe. Install the pipe with a falling gradient of 1/25 ~ 1/100.

### RPC-(4.0-6.0)FSR

	MODEL		RPC-4.0FSR	RPC-5.0FSR	RPC-6.0FSR		
Power supply				1~ 230V 50Hz	^		
Nominal cooling capacity (UT	OPIA)	kW	10.0	12.5	14.0		
Nominal heating capacity (UT	kW	11.2	14.0	16.0			
Nominal cooling capacity (SE	T FREE)	kW	11.2	14.0	16.0		
Nominal heating capacity (SE	T FREE)	kW	12.5	16.0	18.0		
Air flow	Speed (Hi2/Hi/Me/Lo)	m³/min	30/26.5/22/17	35/31/25.5/20	37/32.5/27/21		
Fan motor type (output)		W	160	160	160		
Sound pressure level	Speed (Hi2/Hi/Me/Lo)	dB(A)	44/42/37/32	48/45/41/35	49/47/42/36		
Sound power level	Sound power level Speed (Hi2/Hi/Me/Lo)		60/57/52/47	64/60/56/50	65/62/57/51		
	Height	mm	235	235	235		
Outer dimensions	Width	mm	1580	1580	1580		
	Depth	mm	690	690	690		
Net weight		kg	41	41	41		
Refrigerant			R32 / R410A (factory-charged corrosion-proof nitrogen)				
Refrigerant pipe connection				Flare nuts			
Refrigerant pipe size	Liquid	mm (in)	Ø 9.52 (3/8)	Ø 9.52 (3/8)	Ø 9.52 (3/8)		
Reingerant pipe size	Gas	mm (in)	Ø 15.88 (5/8)	Ø 15.88 (5/8)	Ø 15.88 (5/8)		
Condensate drain connection		mm	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>	Ø 32 <sup>(1)</sup>		
Drain-up Mechanism (optiona	l - sold separately)		DUPC-160K1	DUPC-160K1	DUPC-160K1		
Maximum electricity demand		А	5	5	5		
Packaging volume		m³	0.38	0.38	0.38		
Colour (Munsell code)			Neut	ral white (4.56Y8.85/0	.38)		
Remote control (Sold separate	ely as an option)		PC-ARF	P1E / PC-ARH1E / P	C-AWR		
<sup>(1)</sup> Outer diameter (VP25).							



- Before installing the indoor unit, provide a hole (Ø 300 mm) for piping connection. Use the accessory refrigerant gas/liquid pipes and pipe for drain-up to mount the drain-up mechanism.
- PVC Tube (VP25) must be used for the drain connection.
- Lower the indoor unit 10 mm when the drain-up mechanism is installed. (In case of inclination beyond 10 mm, it'll be water leakage or abnormal stoppage.)
- Do not provide a trap or riser portion for the drain pipe. Install the pipe with a falling gradient of  $1/25 \sim 1/100$ .

### 3.1.5 RPI(L/H)-FSRE - Indoor ducted unit

### **RPIL-(0.4-1.5)FSRE**

М	ODEL		RPIL-0.4FSRE	RPIL-0.6FSRE	RPIL-0.8FSRE	RPIL-1.0FSRE	RPIL-1.5FSRE
Power supply					1~ 230V 50Hz		
Nominal cooling capaci	ty (UTOPIA)	kW	-	-	2.0	2.5	3.6
Nominal heating capac	ity (UTOPIA)	kW	-	-	2.2	2.8	4.0
Nominal cooling capaci	ty (SET FREE)	kW	1.1	1.7	2.2	2.8	4.0
Nominal heating capac	ity (SET FREE)	kW	1.3	1.9	2.5	3.2	4.8
Airflow (2)	Speed (Lo/Me/Hi)	m³/min	5.0 / 5.5 / 6.0 (SP02) (2)	5.5 / 6.5 / 7.3 (SP02) (2)	5.7 / 6.5 / 7.7 (SP02) (2)	5.7 / 6.5 / 7.7 (SP02) (2)	6.5 / 7.9 / 8.8 (SP02) (2)
External static pressure (3)	Nominal (min max.)	Pa	15 (0-100)	15 (0-100)	25 (0–100)	25 (0–100)	25 (0–100)
Sound pressure level	Speed (Lo/Me/Hi)	dB(A)	22 / 23 / 24 (SP02) (2)	23 / 25 / 27 (SP02) (2)	23 / 25 / 28 (SP02) (2)	23 / 25 / 28 (SP02) (2)	25 / 28 / 30 (SP02) (2)
Minimum sound pressure (5)	Speed (lo)	dB(A)	22	23	23	23	25
Sound power level (4)	Speed (Hi)	dB(A)	48 (SP02) (2)	51 (SP02) (2)	52 (SP02) (2)	52 (SP02) (2)	53 (SP02) (2)
Nominal input power	Speed (Lo)	kW	0.02	0.02	0.02	0.03	0.03
	Height	mm	197	197	197	197	197
Outer measurements	Width	mm	750	750	750	750	750
	Depth	mm	600	600	600	600	600
Net weight		kg	23	23	23	23	23
Refrigerant			R32	R410A (factory-c	charged with corre	osion-proof nitro	gen)
Refrigerant pipe connect	tion				Flare nuts		
Refrigerant pipe size	Liquid	mm (in)	ø6.35 (1/4)				
rtomgoram pipo dizo	Gas	mm (in)	ø12.7 (1/2)				
Drain-up height		mm (in)			850		
Condensation drain con	nection (1)	mm	ø32 <sup>(1)</sup>				
MC Protection fuse		Α	5	5	5	5	5
Packaging measuremen	nts	m³	0.15	0.15	0.15	0.15	0.15

<sup>(1)</sup> Outer diameter (VP25).

<sup>(2)</sup> SP: external static pressure (set with Optional Function "C5" in the remote control: 00: Standard, 01: High external static pressure, 02: Low external static pressure).

<sup>&</sup>lt;sup>(3)</sup> Nominal: External static pressure at nominal air flow volume.

<sup>(4)</sup> Sound Power data at Nominal External Static Pressure.

<sup>(5)</sup> Working range minimum airflow.

### **RPI-(1.5-6.0)FSRE**

, ,									
	MODEL		RPI- 1.5FSRE	RPI- 2.0FSRE	RPI- 2.5FSRE	RPI- 3.0FSRE	RPI- 4.0FSRE	RPI- 5.0FSRE	RPI- 6.0FSRE
Po	wer supply					1~ 230V 50H	Z		
Nominal cooling (UTOPIA)	capacity	kW	3.6	5.0	5.6	7.1	10.0	12.5	14.0
Nominal heating (UTOPIA)	Nominal heating capacity (UTOPIA)		4.0	5.6	6.3	8.0	11.2	14.0	16.0
Nominal cooling (SET FREE)	capacity	kW	4.0	5.6	7.1	8.0	11.2	14.0	16.0
Nominal heating (SET FREE)	capacity	kW	4.8	6.3	8.5	9.0	12.5	16.0	18.0
Airflow <sup>(2)</sup>	Speed (Lo/Me/Hi)	m³/min	10/11.5/14 (SP02) (2)	10.5/12/14 (SP02) (2)	15/17/20 (SP02) (2)	16/19/21.5 (SP02) (2)	28/34.5/36 (SP00) (2)	32/35/37 (SP00) (2)	32.5/35.5/37.5 (SP00) (2)
External static pressure (3)	Nominal (min - max)	Pa	25 (0-150)	25 (0-150)	30 (0-150)	30 (0-150)	37 (0-150)	50 (0-150)	50 (0-150)
Sound pressure level	Speed (Lo//Me/Hi)	dB(A)	29/30/32 (SP02) (2)	29/30/32 (SP02) (2)	30/32/34 (SP02) (2)	31/33/35 (SP02) (2)	35/38/39 (SP00) (2)	36/38/40 (SP00) (2)	36/38/40 (SP00) (2)
Minimum sound pressure (5)	Speed (lo)	dB(A)	26	27	27	28	33	34	34
Sound power level (4)	Speed (Hi)	dB(A)	55 (SP02) <sup>(2)</sup>	58 (SP02) <sup>(2)</sup>	57 (SP02) <sup>(2)</sup>	59 (SP02) <sup>(2)</sup>	62 (SP00) <sup>(2)</sup>	64 (SP00) <sup>(2)</sup>	64 (SP00) <sup>(2)</sup>
Nominal input power	Speed (Lo)	kW	0.04	0.04	0.09	0.10	0.08	0.10	0.11
_	Height	mm	240	240	240	240	240	240	240
Outer measurements	Width	mm	750	750	1084	1084	1474	1474	1474
	Depth	mm	600	600	600	600	600	600	600
Net weight		kg	26	26	32	32	42	42	42
Refrigerant				R32/R41	0A (factory-cl	narged with c	orrosion-proo	f nitrogen)	
Refrigerant pipe	connection					Flare nuts			
Refrigerant	Liquid	mm (in)	ø6.35 (1/4)	ø6.35 (1/4)	ø9.52 (3/8)	ø9.52 (3/8)	ø9.52 (3/8)	ø9.52 (3/8)	ø9.52 (3/8)
pipe size	Gas	mm (in)	ø15.88 (5/8)						
Drain-up height		mm (in)				850			
Condensate drai	n connection	mm	ø32 <sup>(1)</sup>						
MC Protection fu	se	Α	5	5	5	5	5	5	5
Packaging meas	urements	m³	0.16	0.16	0.22	0.22	0.28	0.28	0.28

<sup>&</sup>lt;sup>(1)</sup> Outer diameter (VP25).

<sup>(2)</sup> SP: external static pressure (set with Optional Function "C5" in the remote control: 00: Standard, 01: High external static pressure, 02: Low external static pressure).

<sup>(3)</sup> Nominal: External static pressure at nominal air flow volume.

<sup>(4)</sup> Sound Power data at Nominal External Static Pressure.

<sup>(5)</sup> Working range minimum airflow.

### RPIH-(4.0-6.0)FSRE

IV	MODEL		DDIII 4 AECDE	RPIH-5.0FSRE	
MODEL			RPIH-4.0FSRE	KPIN-3.UF3KE	RPIH-6.0FSRE
Pow	ver supply			1~ 230V 50Hz	
Nominal cooling capacity (	(UTOPIA)	kW	10.0	12.5	14.0
Nominal heating capacity (	(UTOPIA)	kW	11.2	14.0	16.0
Nominal cooling capacity (SET FREE)		kW	11.2	14.0	16.0
Nominal heating capacity (SET FREE)		kW	12.5	16.0	18.0
$\Delta irflow(2)$	Speed Lo/Me/Hi)	m³/min	29/31.5/35 (SP00) (2)	32/34/36 (SP00) (2)	32/34/36 (SP00) (2)
	lominal min - max)	Pa	155 (0-200)	155 (0-200)	155 (0-200)
Solind proceding laval	Speed Lo//Me/Hi)	dB(A)	35/38/39 (SP00) <sup>(2)</sup>	36/38/40 (SP00) <sup>(2)</sup>	36/38/40 (SP00) <sup>(2)</sup>
Minimum sound pressure (5)	Speed (lo)	dB(A)	33	34	34
Sound power level (4) S	peed (Hi)	dB(A)	62 (SP00) <sup>(2)</sup>	64 (SP00) <sup>(2)</sup>	64 (SP00) <sup>(2)</sup>
Nominal input power S	Speed (Lo)	kW	0.08	0.10	0.11
He	eight	mm	340	340	340
Outer measurements W	/idth	mm	1474	1474	1474
De	epth	mm	600	600	600
Net weight		kg	44	44	44
Refrigerant			R32/R410A (fact	ory-charged with corrosio	n-proof nitrogen)
Refrigerant pipe connection	n			Flare nuts	
Pofrigorant pine size	iquid	mm (in)	ø9.52 (3/8)	ø9.52 (3/8)	ø9.52 (3/8)
Refrigerant pipe size G	ias	mm (in)	ø15.88 (5/8)	ø15.88 (5/8)	ø15.88 (5/8)
Drain-up height		mm (in)		850	
Condensate drain connecti	ion	mm	ø32 <sup>(1)</sup>	ø32 <sup>(1)</sup>	ø32 <sup>(1)</sup>
MC Protection fuse		А	5	5	5
Packaging measurements		m³	0.39	0.39	0.39

<sup>(1)</sup> Outer diameter (VP25).

<sup>(2)</sup> SP: external static pressure (set with Optional Function "C5" in the remote control: 00: Standard, 01: High external static pressure, 02: Low external static pressure).

<sup>&</sup>lt;sup>(3)</sup> Nominal: External static pressure at nominal air flow volume.

<sup>&</sup>lt;sup>(4)</sup> Sound Power data at Nominal External Static Pressure.

<sup>(5)</sup> Working range minimum airflow

### 3.1.6 RPI-FSN6E-EF - Indoor ducted unit for Econofresh assembly

### RPI-(4.0-6.0)FSN6E-EF

MODEL			RPI-4.0FSN6E-EF	RPI-5.0FSN6E-EF	RPI-6.0FSN6E-EI	
Pov	wer supply			1~ 230V 50Hz		
Nominal cooling capacity (UTC	OPIA)	kW	10.0	12.5	14.0	
Nominal heating capacity (UTC		kW	11.2	14.0	16.0	
Nominal cooling capacity (SET	FREE)	kW	11.2	14.0	16.0	
Nominal heating capacity (SET	Γ FREE)	kW	12.5	16.0	18.0	
Airflow (2)	Speed (Lo/Me/Hi)	m³/min	28/34.5/36 (SP00) (2)	32/35/37 (SP00) (2)	32.5/35.5/37.5 (SP00) (2)	
External static pressure (3)	Nominal (min - max)	Pa	37 (0-150)	50 (0-150)	50 (0-150)	
Sound pressure level	Speed (Lo/Me/Hi)	dB(A)	35/38/39 (SP00) (2)	36/38/40 (SP00) (2)	36/38/40 (SP00) (2)	
Minimum sound pressure (5)	Speed (lo)	dB(A)	33	34	34	
Sound power level (4)	Speed (Hi)	dB(A)	62 (SP00) <sup>(2)</sup>	64 (SP00) <sup>(2)</sup>	64 (SP00) <sup>(2)</sup>	
Nominal input power	Speed (Lo)	kW	0.08	0.10	0.11	
	Height	mm	240	240	240	
Outer measurements	Width	mm	1474	1474	1474	
	Depth	mm	600	600	600	
Net weight		kg	42	42	42	
Refrigerant			R410A (factory-charged with corrosion-proof nitrogen)			
Refrigerant pipe connection				Flare nuts		
Refrigerant pipe size	Liquid	mm (in)	ø9.52 (3/8)	ø9.52 (3/8)	ø9.52 (3/8)	
rtemgerum pipe size	Gas	mm (in)	ø15.88 (5/8)	ø15.88 (5/8)	ø15.88 (5/8)	
Drain-up height mr				850		
Condensate drain connection		mm	ø32 <sup>(1)</sup>	ø32 <sup>(1)</sup>	ø32 <sup>(1)</sup>	
MC Protection fuse		А	5	5	5	
Packaging measurements		m <sup>3</sup>	0.28	0.28	0.28	
(1) Outer diameter (VP25)						

<sup>(1)</sup> Outer diameter (VP25).

<sup>&</sup>lt;sup>(2)</sup> SP: external static pressure (set with Optional Function "C5" in the remote control: 00: Standard, 01: High external static pressure, 02: Low external static pressure).

<sup>(3)</sup> Nominal: External static pressure at nominal air flow volume.

<sup>&</sup>lt;sup>(4)</sup> Sound Power data at Nominal External Static Pressure.

<sup>(5)</sup> Working range minimum airflow.

### 3.1.7 RPI-FSN3(P)E(-f) - Indoor ducted unit

### RPI-(8.0/10.0)FSN3E(-f)

MODEL			RPI-8.0FSN3E(-f)	RPI-10.0FSN3E(-f)	
Power supply			1~ 230	0V 50Hz	
Nominal cooling capacity (UT	OPIA) (*)	kW	20.0	25.0	
Nominal heating capacity (UT	OPIA) (*)	kW	22.4	28.0	
Nominal cooling capacity (SE	T FREE)	kW	22.4	28.0	
Nominal heating capacity (SE	T FREE)	kW	25.0	31.0	
Air flow (HSP) <sup>(2)</sup>	Speed (Hi/Me/Lo)	m³/min	66/66/60	75/75/68.5	
Air flow (LSP)(3)	Speed (Hi/Me/Lo)	m³/min	66/66/59.5	75/75/67.6	
Static pressure (HSP)(2)		Pa	220/220/180	220/220/180	
Static pressure (LSP)(3)		Pa	Pa 180/180/140 180/18		
Fan motor type (output)		W	1065	1065	
Sound pressure level	Speed (Hi/Me/Lo)	dB(A)	54/54/51	55/55/52	
Sound power level		dB(A)	77	78	
	Height	mm	423	423	
Outer dimensions	Width	mm	1592	1592	
	Depth	mm	600	600	
Net weight	·	kg	85	87	
Refrigerant			R410A (factory-charged w	vith corrosion-proof nitrogen)	
Refrigerant pipe connection			Welded	connection	
Defet count it is at a	Liquid	mm (in)	Ø 9.52 (3/8)	Ø 9.52 (3/8)	
Refrigerant pipe size	Gas	mm (in)	Ø 19.05 (3/4) <sup>(4)</sup>	Ø 22.2 (7/8) <sup>(4)</sup>	
Condensate drain connection mm		mm	Ø 25 <sup>(1)</sup>	Ø 25 <sup>(1)</sup>	
Maximum electricity demand		А	10	10	
Packaging volume		m³	0.68	0.68	
Remote control (Sold separately as an option)			PC-ARFP1	IE - PC-AWR	

<sup>(1)</sup> Outer diameter (VP20).

The data obtained is based on the operating conditions described at the beginning of this chapter.



(\*) Nominal capacity in 1 indoor unit combination with UTOPIA IVX Premium and IVX Standard RAS-(8/10)HNPE and RAS-(8/10)HNCE.

<sup>(2)</sup> HSP: high static pressure.

<sup>&</sup>lt;sup>(3)</sup>LSP: low static pressure; predetermined setting.

 $<sup>^{(4)}</sup>$  Indoor unit supplied with a reduction for systems with UTOPIA IVX (8/10HP) outdoor unit.

# RPI-(16.0/20.0)FSN3PE(-f)

MODEL			RPI-16.0FSN3PE(-f)	RPI-20.0FSN3PE(-f)	
Power supply			1~ 230	V 50Hz	
Nominal cooling capacity (SET	FREE)	kW	45.0	56.0	
Nominal heating capacity (SE	ΓFREE)	kW	50.0	63.0	
Airflow (HSP)(2)	Speed (Hi/Lo)	m³/min	132/120	150/137	
Airflow (LSP)(3)	Speed (Hi/Lo)	m³/min	132/119	150/135	
Static pressure (HSP)(2)		Pa	220/180	220/180	
Static pressure (LSP)(3)		Pa	180/140	180/140	
Fan motor type (output)		W	2 x 1065	2 x 1065	
Sound pressure level	Speed (Hi/Lo)	dB(A)	56/53	57/54	
Sound power level		dB(A)	79	80	
	Height	mm	846	846	
Outer dimensions	Width	mm	1592	1592	
	Depth	mm	600	600	
Net weight		kg	171	175	
Refrigerant			R410A (factory-charged with corrosion-proof nitrogen)		
Refrigerant pipe connection			Welded o	connection	
Defricement size size	Liquid	mm (in)	2 x Ø 9.52 (3/8)	2 x Ø 9.52 (3/8)	
Refrigerant pipe size	Gas	mm (in)	2 x Ø 19.05 (3/4)	2 x Ø 22.2 (7/8)	
Condensation drain connection	า	mm	2 x Ø 25 <sup>(1)</sup>	2 x Ø 25 <sup>(1)</sup>	
Maximum electricity demand		A	16.2	17.7	
Volume of packaging		m³	0.81	0.81	
Remote control (Sold separately as an option) (required; sold separately)			PC-ARFP1	E - PC-AWR	
Multi-Kit (required; sold separa	ately)		1 x E-162SN4	1 x E-242SN3	

<sup>&</sup>lt;sup>(1)</sup> Outer diameter (VP20).

<sup>(2)</sup> HSP: high static pressure.

 $<sup>\</sup>ensuremath{^{(3)}\text{LSP:}}$  low static pressure; predetermined setting.

# 3.1.8 RPK - Wall type

### **RPK-(0.4-1.5)FSR(H)M**

MODEL			RPK-0.4 FSR(H)M	RPK-0.6 FSR(H)M	RPK-0.8 FSR(H)M	RPK-1.0 FSR(H)M	RPK-1.5 FSR(H)M	
Power supply			1~ 220-240V 50/60Hz					
Nominal cooling (UTOPIA)	capacity	kW	-	-	2.0	2.5	3.6	
Nominal heating (UTOPIA)	capacity	kW	-	-	2.2	2.8	4.0	
Nominal cooling (SET FREE)	capacity	kW	1.1	1.7	2.2	2.8	4.0	
Nominal heating (SET FREE)	capacity	kW	1.3	1.9	2.5	3.2	4.8	
Air flow	Speed (Hi2/Hi/Me/Lo)	m³/min	7.5/7.3/6.7/6.0	8/7.5/7/6.0	10/8/7/6.5	10/8/7/6.5	14/11/9/7.5	
Fan motor type (	output)	W	38	38	38	38	38	
Sound pressure level	Speed (Hi2/Hi/Me/Lo)	dB(A)	32/31/30/29	35/32/31/29	39/35/32/30	39/35/32/30	46/40/36/33	
Sound power level	Speed (Hi2/Hi/Me/Lo)	dB(A)	49/48/46/45	49/48/46/45	53/49/47/45	53/49/47/45	58/54/50/47	
	Height	mm	300	300	300	300	300	
Outer dimensions	Width	mm	790	790	790	790	900	
difficitions	Depth	mm	230	230	230	230	230	
Net weight		kg	9	10	10	10	11	
Refrigerant			R3	2 / R410A (factory	-charged with corr	osion-proof nitrog	en)	
Refrigerant pipe	connection				Flare nuts			
Refrigerant pipe	Liquid	mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	
size	Gas	mm (in)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	
Condensate drain	n connection	mm	Ø 20 <sup>(1)</sup>	Ø 20 <sup>(1)</sup>	Ø 20 <sup>(1)</sup>	Ø 20 <sup>(1)</sup>	Ø 20 <sup>(1)</sup>	
Maximum electric	city demand	А	5	5	5	5	5	
Packaging volum	е	m³	0.09	0.09	0.09	0.09	0.11	
Colour (Munsell o	code)			Wh	nite (6.8PB 9.21/0.	49)		
Remote control (Sold separately	as an option)		PC-ARFP1E / PC-ARH1E / PC-AWR (*)					

The data obtained is based on the operating conditions described at the beginning of this chapter.

<sup>&</sup>lt;sup>(1)</sup> Outer diameter (VP16).

<sup>(\*)</sup> IR receiver is included on indoor units as standard (see chapter "7. General dimensions").

### **RPK-(2.0-4.0)FSRM**

	MODEL		RPK-2.0FSRM	RPK-2.5FSRM	RPK-3.0FSRM	RPK-4.0FSRM			
Power supply			1~ 220-240V 50/60Hz						
Nominal cooling capac	city (UTOPIA)	kW	5.0	5.6	7.1	10.0			
Nominal heating capa	city (UTOPIA)	kW	5.6	6.3	8.0	11.2			
Nominal cooling capac	city (SET FREE)	kW	5.6	7.1	8.0	11.2			
Nominal heating capa	city (SET FREE)	kW	6.3	8.5	9.0	12.5			
Air flow	Speed (Hi2/Hi/Me/Lo)	m³/min	14.5/13/11/9.5	18.5/16.5/14/12	20/17.5/15.5/12.5	23/20/17.5/14.5			
Fan motor type (output	t)	W	38	38	38	38			
Sound pressure level	Speed (Hi2/Hi/Me/Lo)	dB(A)	40/37/34/31	45/42/38/35	47/44/40/35	51/48/44/39			
Sound power level	Speed (Hi2/Hi/Me/Lo)	dB(A)	55/53/50/47	60/58/54/51	63/60/56/51	65/64/60/54			
	Height	mm	300	300	300	300			
Outer dimensions	Width	mm	1100	1100	1100	1100			
	Depth	mm	260	260	260	260			
Net weight		kg	14.5	15	15	15			
Refrigerant			R32 / R4	10A (factory-charge	d with corrosion-proof	nitrogen)			
Refrigerant pipe conne	ection			Flar	e nuts				
Refrigerant pipe size	Liquid	mm (in)	Ø 6.35 (1/4)	Ø 9.52 (3/8)	Ø 9.52 (3/8)	Ø 9.52 (3/8)			
Reingerant pipe size	Gas	mm (in)	Ø 12.7 (1/2)	Ø 15.88 (5/8)	Ø 15.88 (5/8)	Ø 15.88 (5/8)			
Condensate drain con	nection	mm	Ø 20 <sup>(1)</sup>	Ø 20 <sup>(1)</sup>	Ø 20 <sup>(1)</sup>	Ø 20 <sup>(1)</sup>			
Maximum electricity de	emand	А	5	5	5	5			
Packaging volume		m³	0.14	0.14	0.14	0.14			
Colour (Munsell code)			White (6.8PB 9.21/0.49)						
Remote control (Sold	separately as an opt	on)	PC-ARFP1E / PC-ARH1E / PC-AWR (*)						
(									

The data obtained is based on the operating conditions described at the beginning of this chapter.

<sup>(1)</sup> Outer diameter (VP16).

<sup>(\*)</sup> IR receiver is included on indoor units as standard (see chapter "7. General dimensions").

# 3.1.9 RPF - Floor type and RPFI - Floor concealed type

### RPF-(1.0-2.5)FSN2E

MC	DDEL		RPF-1.0FSN2E	RPF-1.5FSN2E	RPF-2.0FSN2E	RPF-2.5FSN2E	
Power supply			1~ 230V 50Hz				
Nominal cooling capacity (UTC	OPIA)	kW	2.5	3.6	5.0	5.6	
Nominal heating capacity (UTC	OPIA)	kW	2.8	4.0	5.6	6.3	
Nominal cooling capacity (SET	FREE)	kW	2.8	4.0	5.6	7.1	
Nominal heating capacity (SE	Γ FREE)	kW	3.2	4.8	6.3	8.5	
Air flow	Speed (Hi/Me/Lo)	m³/min	8.5/7/6	12/10/9	16/14/11	16/14/11	
Fan motor type (output)		W	20	28	45	45	
Sound pressure level	Speed (Hi/Me/Lo)	dB(A)	35/32/29	38/35/31	39/36/32	42/38/34	
Sound power level		dB(A)	57	60	60	60	
	Height	mm	630	630	630	630	
Outer dimensions	Width	mm	1045	1170	1420	1420	
	Depth	mm	220	220	220	220	
Net weight		kg	25	28	33	34	
Refrigerant			R410A (factory-charged corrosion-proof nitrogen)				
Refrigerant pipe connection			Flare nuts				
Defricement vice vice	Liquid	mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 9.52 (3/8)	
Refrigerant pipe size	Gas	mm (in)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 15.88 (5/8)	Ø 15.88 (5/8)	
Condensate drain connection		mm	Ø 18.5 <sup>(1)</sup>	Ø 18.5 <sup>(1)</sup>	Ø 18.5 <sup>(1)</sup>	Ø 18.5 <sup>(1)</sup>	
Maximum electricity demand		Α	5	5	5	5	
Packaging volume m³			0.22	0.24	0.29	0.29	
Colour (Munsell code)				Spring white	(4.1Y8.5/0.7)		
Remote control (Sold separate	ely as an option)		PC-ARFP1E - PC-AWR				
(1) Outer diameter.							

The data obtained is based on the operating conditions described at the beginning of this chapter.

### RPFI-(1.0-2.5)FSN2E

	MODEL		RPFI-1.0FSN2E	RPFI-1.5FSN2E	RPFI-2.0FSN2E	RPFI-2.5FSN2E	
Power supply			1~ 230V 50Hz				
Nominal cooling capacity	(UTOPIA)	kW	2.5	3.6	5.0	5.6	
Nominal heating capacity	y (UTOPIA)	kW	2.8	4.0	5.6	6.3	
Nominal cooling capacity	(SET FREE)	kW	2.8	4.0	5.6	7.1	
Nominal heating capacity	y (SET FREE)	kW	3.2	4.8	6.3	8.5	
Air flow	Speed (Hi/Me/Lo)	m³/min	8.5/7/6	12/10/9	16/14/11	16/14/11	
Fan motor type (output)		W	20	28	45	45	
Sound pressure level	Speed (Hi/Me/Lo)	dB(A)	35/32/29	38/35/31	39/36/32	42/38/34	
Sound power level		dB(A)	57	60	60	60	
	Height	mm	620	620	620	620	
Outer dimensions	Width	mm	848	973	1223	1223	
	Depth	mm	220	220	220	220	
Net weight		kg	19	23	27	28	
Refrigerant			R410A (factory-charged corrosion-proof nitrogen)				
Refrigerant pipe connect	ion			Flare nuts			
Defide annual along all a	Liquid	mm (in)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 6.35 (1/4)	Ø 9.52 (3/8)	
Refrigerant pipe size	Gas	mm (in)	Ø 12.7 (1/2)	Ø 12.7 (1/2)	Ø 15.88 (5/8)	Ø 15.88 (5/8)	
Condensate drain conne	ction	mm	Ø 18.5 <sup>(1)</sup>	Ø 18.5 <sup>(1)</sup>	Ø 18.5 <sup>(1)</sup>	Ø 18.5 <sup>(1)</sup>	
Maximum electricity demand A		А	5	5	5	5	
Packaging volume m³			0.22	0.23	0.25	0.25	
Colour (Munsell code)				Spring white	(4.1Y8.5/0.7)		
Remote control (Sold se	parately as an option	)	PC-ARFP1E - PC-AWR				
(1) Outer diameter.							

The data obtained is based on the operating conditions described at the beginning of this chapter.

### 3.1.10 KPI Units

#### Considerations

The sound pressure level has been measured in an anechoic chamber under the following conditions:

1.5 m below the unit (with no ceiling below the unit, using a sound-insulated duct).

Suction duct 1 m away and discharge duct 2 m away.

Power supply: 230 V.



Data obtained in an anechoic chamber and, therefore, the sound indicated must be taken into account when installing the unit.

### **♦ KPI Energy recovery series**

### KPI-(252-802)E4E

MODEL				KPI-252E4E	KPI-502E4E	KPI-802E4E	
Electrical power supply	•				1~ 230V 50Hz		
Air flow rate		Hi/Me/Lo	m³/h	250/208/180	500/411/360	800/650/540	
Static pressure (1)		Hi/Me/Lo	Pa	55/35/30	80/55/42	90/60/40	
Maximum external pres	ssure (nom. air flow)		Pa	240	217	120	
Heat Exchanger Eleme	ent			Air to Air cross flow - Celluloid material			
Temperature exchange	efficiency (2)	Hi/Me/Lo	%	74/77/79	73/74/76	76/78/79	
Enthalpy exchange effi	ciency for heating	High	%	66	65	65	
Enthalpy exchange effi	ciency for cooling	High	%	60	61	62	
Sound pressure level (3)		Hi/Me/Lo	dB(A)	28/27/25	33/31/30	35/34/33	
Sound power level		High	dB(A)	43	51	54	
		Height		270	330	385	
		Width	mm	900	1130	1210	
		Depth		750	920	1015	
Net weight			kg	34	46	51	
Duct Connection diame	eter		mm	Ø 160	Ø 200	Ø 250	
Nominal power input		Hi/Me/Lo	W	48/32/25	110/69/52	243/148/92	
Specific Fan Power inp	out (SFP)	High	W/(m <sup>3</sup> /s)	408	514	762	
Maximum current		High	А	4.0	4.0	4.0	
_ Quantity			-	2	2	2	
Fan Type		-		EC Fan			
Working Range (4)					20°C (DB) ~ 46°C (DE	3)	
Supplied Air Filter class	sification (acc. EN779)	) (5)		G3	G3	G3	
Remote control (sold se	eparately as an option	1)			PC-ARFP1E		



- (1) Default fan pressure setting.
- (2) Measured according to EN 308.
- <sup>(3)</sup> Sound pressure level has been measured in an anechoic chamber, with the measuring point 1.5 m below the center of the unit, with no ceiling under the unit and using a sound insulated duct Reflected sound must be considered when installing the unit in the field. Because of it the sound pressure level measured in an installation could be higher than the specification.
- (4) The installation of an electric heater and additional air inlet thermistor THM4 (optional accessory installed before the electrical heater) is necessary when temperature becomes lower to -5°C(DB).
- (5) High efficiency filter classified as F7 (acc.EN779) is available as accessory.

### KPI-(1002-2002)E4E

	MODEL			KPI-1002E4E	KPI-1502E4E	KPI-2002E4E	
Electrical power supply					1~ 230V 50Hz		
Air flow rate		Hi/Me/Lo	m³/h	1000/800/620	1150/945/735	1650/1200/975	
Static pressure (1)		Hi/Me/Lo	Pa	95/65/40	228/155/90	282/145/95	
Maximum external pressure (	nom. air flow)		Pa	190	530	458	
Heat Exchanger Element				Air to Air	cross flow - Cellulo	d material	
Temperature exchange efficie	ncy (2)	Hi/Me/Lo	%	76/78/81	75.4/77.7/79.8	75.4/78.3/79.7	
Enthalpy exchange efficiency	for heating	High	%	68	68	66.5	
Enthalpy exchange efficiency	for cooling	High	%	62	62.5	61.5	
Sound pressure level (3)		Hi/Me/Lo	dB(A)	37/34/32	39/37/35	40/39/36	
Sound power level		High	dB(A)	55	56	57	
		Height		385	525	525	
External dimensions		Width	mm	1600	1800	1800	
		Depth		1295	1130	1430	
Net weight			kg	79	97	106	
Duct Connection diameter			mm	Ø 300	Ø 355	Ø 355	
Nominal power input		Hi/Me/Lo	W	261/154/83	496/318/190	694/305/192	
Specific Fan Power input (SFI	P)	High	W/(m <sup>3</sup> /s)	545	763	690	
Maximum current		High	А	8.0	8.0	8.0	
Fon	Quantity		-	2	2	2	
Fan Type			-		EC Fan		
Working Range (4)				-2	0°C (DB) ~ 46°C (E	DB)	
Supplied Air Filter classification (acc. EN779) (5)				G3 G3 G3			
Remote control (sold separate	ely as an option)				PC-ARFP1E		



- (1) Default fan pressure setting.
- (2) Measured according to EN 308.
- (3) Sound pressure level has been measured in an anechoic chamber, with the measuring point 1.5 m below the center of the unit, with no ceiling under the unit and using a sound insulated duct Reflected sound must be considered when installing the unit in the field. Because of it the sound pressure level measured in an installation could be higher than the specification.
- (4) The installation of an electric heater and additional air inlet thermistor THM4 (optional accessory installed before the electrical heater) is necessary when temperature becomes lower to -5°C(DB).
- (5) High efficiency filter classified as F7 (acc.EN779) is available as accessory.

#### **♦ KPI Active series**

### KPI-(502-1002)X4E

	MODEL			KPI-502X4E	KPI-802X4E	KPI-1002X4E	
Electrical power supply					1~ 230V 50Hz		
Nominal cooling capacity	(1)		kW	5.32 (1.81)	7.96 (2.94)	10.83 (3.73)	
Nominal heating capacity	, (1)		kW	6.92 (2.12)	9.79 (3.49)	12.93 (4.43)	
Air flow rate		Hi/Me/Lo		500/450/400	800/700/590	1000/820/740	
Static pressure (2)		Hi/Me/Lo	Pa	90/72/58	110/80/57	170/105/80	
Maximum external press	ure (nom. air flow)		Pa	218	110	170	
Heat Exchanger element			-	Air to air cross flow - Paper material			
Temperature exchange e	fficiency (3)	Hi/Me/Lo	%	73/74/76	76/78/79	76/78/79	
Enthalpy exchange efficient	ency for heating	High	%	65	65	68	
Enthalpy exchange efficient	ency for cooling	High	%	61	62	62	
Sound pressure level (4)		Hi/Me/Lo	dB(A)	32/30/29	34/33/32	36/33/31	
Sound Power Level	Sound Power Level		dB(A)	50	53	54	
		Height	mm	330	385	385	
External dimensions	External dimensions			1435	1513	1904	
				920	1015	1295	
Net weight			kg	62	69	100	
Duct Connection diameter	er		mm	Ø 200	Ø 250	Ø 300	
Refrigerant			-	R410			
Refrigerant piping conne	ction		-	Flare nuts			
Size	Liquid piping		mm (in.)	Ø 6.35 1/4	Ø 6.35 1/4	Ø 9.52 3/8	
Size	Gas piping		mm (in.)	Ø 12.7 1/2	Ø 15.88 5/8	Ø 15.88 5/8	
Condensate drain conne	ction		mm	Ø 32	Ø 32	Ø 32	
Nominal power input		Hi/Me/Lo	W	111/85/56	255/161/108	357/198/150	
Specific Fan Power input	(SFP)	High	W/(m <sup>3</sup> /s)	518	793	586	
Maximum current	Maximum current High		Α	4.0	4.0	8.0	
Fon	Quantity		-	2	2	2	
Fan Type			-		EC Fan		
Working Range (5)				-2	0°C (DB) ~ 40°C(D	)B)	
Supplied air filter classific	cation (ecc EN779) (6)			G3 G3 G3			
Remote control (sold sep	arately as an option)				PC-ARFP1E		



(1) The nominal cooling and heating capacity is the combined capacity of the outdoor and indoor units of the system and is based on Standard EN14511, with the following operating conditions:

	Cooling	Heating
Indoor Air Inlet Temperature	27°C DB / 19°C WB	20°C DB / 14 °C WB
Outdoor Air Inlet Temperature	35°C DB / 24°C WB	7°C DB / 6°C WB

Pipe length: 7.5m; Pipe height: 0 m

Active KPI unit working at its nominal air flow.

Value between brackets represents the capacity of the Heat Recovery element.

- (2) Default fan pressure setting.
- (3) Measured according to EN 308.
- (4) Sound pressure level has been measured in an anechoic chamber, with the measuring point 1.5 m below the center of the unit, with no ceiling under the unit and using a sound insulated duct. Reflected sound must be considered when installing the unit in the field. Because of it, the sound pressure level measured in an installation could be higher than the specification.
- (5) The installation of an electric heater and additional air inlet thermistor THM4 (optional accessory installed before the electrical heater) is necessary when temperature becomes lower to -5°C (DB). Cooling and heating performance may vary depending on working conditions because of control protections.
- (6) High efficiency filter classified as F7 (acc. EN779) is available as accessory.

### 3.1.11 Econofresh kit

MOD	DEL		EF-456N1E
Combination indoor unit model			RPI-(4.0-6.0)FSN6E-EF
Outer dimensions	Height	mm	254
	Width	mm	1491+59
	Depth	mm	270
Number of damper motors			1
Net weight		kg	13.7
Standard accessories			Fresh outdoor air inlet thermistor
Packaging volume		m³	0.14
Remote control (Sold separately a	as an option)	-	PC-ARFP1E

### 3.1.12 DX-Interface

						DX-Interfa	ace models						
			EXV-2.0E2	EXV-2.5E2	EXV-3.0E2	EXV-4.0E2	EXV-5.0E2	EXV-6.0E2	EXV-8.0E2	EXV-10.0E2			
Control Box					,	,	,		,				
Casing colou	r				Nat	ural Grey (Mu	unsell 1.0Y8.5	nsell 1.0Y8.5/0.5)					
	Height	mm				2	91						
Dimensions	Width	mm				3	41						
	Depth	mm		127									
Weight		kg		3.0									
Maximum far	current	Α		3.5									
Power supply	,			1~ 230V 50Hz									
Expansion v	alves												
Casing colou	r					White (F	RAL-9016)						
	Height	mm				4	31						
Dimensions	Width	mm				1	99						
	Depth	mm				1	03						
Weight		kg	2.0			2.7			4	.5			
Piping conne	ction	mm	Ø 6.35				Ø 9.52						
Accessories													
Remote contra separately as	`	า)	PC-ARFP1E										
Centralized re (Sold separation)	d remote control							rature					

### 3.1.13 Adjusted capacities of indoor units

Unit whose capacity can be set thought the dsw setting, the capacity are shown in the following table:

Power (HP)		1.3 (*)(**)			1.3 (*)		1.8 (*)			2.3 (*)			
Variable capacity thought DWS		1.0	<b></b>	1.3	1.5	-	1.3	2.0	-	1.8	2.5	-	2.3
Nominal cooling capacity (UTOPIA and CENTRIFUGAL series)	kW		3.2			3.2			4.5			5.3	
Nominal heating capacity (UTOPIA and CENTRIFUGAL series)	kW		3.6			3.6			5.0			6.0	
Nominal cooling capacity (SET FREE series)	kW		3.8			3.8			5.2			6.7	
Nominal heating capacity (SET FREE series)	kW		4.2			4.2			5.6			7.5	

- (\*) Capacity available with DSW3 setting.
- (\*\*) Only for RPK units.

# 3.2 Component data

# 3.2.1 RCI-FSR - 4-way cassette

# RCI-(1.0-2.5)FSR

MODEL		RCI-1.0FSR	RCI-1.5FSR	RCI-2.0FSR	RCI-2.5FSR				
Heat exchanger									
Type		Multi-Pass Cross Finned Tube							
Tube material		Copper Tube							
Outer diameter	Outer diameter mm			5	5				
Rows of tubes		2	2	2	3				
Number of tubes in the coil	20	28	28	42					
Fin material			Alum	inium					
Fin pitch	mm	1.3	1.3	1.3	1.3				
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15				
Total front area	m²	0.29	0.41	0.41	0.41				
Number of coils per unit		1	1	1	1				
Fan									
Fan type			Multi-blade turbo fan						
Fans per unit		1	1	1	1				
Outer diameter	mm	490	490	490	490				
Motor									
Shell			Drip-Proof Ty	pe Enclosure					
Starting			DC N	Лotor					
Quantity	1	1	1	1					
Insulation class		E	Е	E	Е				

# RCI-(3.0-6.0)FSR

MODEL		RCI-3.0FSR	RCI-4.0FSR	RCI-5.0FSR	RCI-6.0FSR			
Heat exchanger								
Туре		Multi-Pass Cross Finned Tube						
Tube material			Coppe	r Tube				
Outer diameter	mm	5	5	5	5			
Rows of tubes		3	3	3	3			
Number of tubes in the coil	54	54	54	54				
Fin material			Alum	inium				
Fin pitch	mm	1.3	1.3	1.3	1.3			
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15			
Total front area	m <sup>2</sup>	0.52	0.52	0.52	0.52			
Number of coils per unit		1	1	1	1			
Fan								
Fan type		Multi-blade turbo fan						
Fans per unit		1	1	1	1			
Outer diameter	mm	490	490	490	490			
Motor								
Shell			Drip-Proof Ty	pe Enclosure				
Starting		DC N	Motor					
Quantity		1	1	1	1			
Insulation class		E	E	Е	E			

# 3.2.2 RCIM-FSRE - 4-way cassette (compact)

# RCIM-(0.4-2.5)FSRE

MODEL		RCIM- 0.4FSRE	RCIM- 0.6FSRE	RCIM- 0.8FSRE	RCIM- 1.0FSRE	RCIM- 1.5FSRE	RCIM- 2.0FSRE	RCIM- 2.5FSRE	
Heat exchanger									
Туре		Multi-pass cross finned tube							
Tube material					Copper				
Outer diameter	mm	5	5	5	5	5	5	5	
Rows of tubes		1	2	2	2	2	3	3	
Number of tubes in the coil		14	20	20	28	28	42	42	
Fin material		Aluminium							
Fin pitch	mm	1.3	1.3	1.3	1.3	1.3	1.3	1.3	
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15	4.15	4.15	4.15	
Total front area	m²	0.19	0.19	0.19	0.19	0.19	0.19	0.19	
Number of coils per unit	-	1	1	1	1	1	1	1	
Fan									
Fan type			Multi-blade centrifugal fan						
Fans per unit		1	1	1	1	1	1	1	
Outer diameter	mm	318	318	318	318	318	318	318	
Motor							0		
Shell				Drip-p	roof type enc	losure			
Starting	Starting				DC Motor				
Quantity		1	1	1	1	1	1	1	
Insulation class		E	Е	Е	Е	Е	E	Е	

### 3.2.3 RCD-FSR - 2-way cassette

### RCD-(0.8-1.5)FSR

MODEL		RCD-0.8FSR	RCD-1.0FSR	RCD-1.5FSR	RCD-2.0FSR				
Heat exchanger									
Туре		Multi-Pass Cross Finned Tube							
Tube material		Copper							
Outer diameter	mm	7	7	7	7				
Rows of tubes		1	1	2	2				
Number of tubes in the co	oil	10	10	24	24				
Fin material			Alumi	nium					
Fin pitch	Mm	1.8	1.8	1.6	1.6				
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15				
Total front area	m²	0.30	0.30	0.36	0.36				
Number of coils per unit		1	1	1	1				
Fan									
Fan type			Multi-Blade Ce	entrifugal Fan					
Fans per unit		1	1	1	1				
Outer diameter	mm	360	360	360	360				
Motor									
Shell			Drip-proof typ	e enclosure					
Starting			DC N	lotor					
Quantity		1	1	1	1				
Insulation class		Е	E	E	E				

### RCD-(2.5-6.0)FSR

MODEL		RCD-2.5FSR	RCD-3.0FSR	RCD-4.0FSR	RCD-5.0FSR	RCD-6.0FSR				
Heat exchanger										
Туре			N	fulti-pass finned tub	e					
Tube material				Copper						
Outer diameter	mm	7	7	7	7	7				
Rows of tubes		2	2	2	2	2				
Number of tubes in the coil		24	24	24	24	24				
Fin material				Aluminium						
Fin pitch	mm	1.6	1.6	1.6	1.6	1.6				
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15	4.15				
Total front area	m <sup>2</sup>	0.36	0.36	0.63	0.63	0.63				
Number of coils per unit		1	1	1	1	1				
Fan										
Fan type			Multi-Blade Centrifugal Fan							
Fans per unit		1	1	2	2	2				
Outer diameter	mm	360	360	360	360	360				
Motor										
Shell			ure							
Starting				DC Motor						
Quantity		1	1	2	2	2				
Insulation class		Е	E	Е	E	E				

# 3.2.4 RPC-FSR - Ceiling type

# RPC-(1.5-3.0)FSR

MODEL		RPC-1.5FSR	RPC-2.0FSR	RPC-2.5FSR	RPC-3.0FSR					
Heat exchanger										
Туре			Multi-pass	finned tube						
Tube material		Copper								
Outer diameter	mm	7	7	7	7					
Rows of tubes		2	3	3	3					
Number of tubes in the coil		14	20	20	20					
Fin material			Alum	inium						
Fin pitch	mm	1.6	1.8	1.8	1.8					
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15					
Total front area	m <sup>2</sup>	0.20	0.20	0.29	0.29					
Number of coils per unit		1	1 1 1		1					
Fan										
Fan type			Centr	ifugal						
Fans per unit		2	2	3	2					
Outer diameter	mm	155	155	155	155					
Motor										
Shell			Drip-proof ty	pe enclosure						
Starting			DC r	notor						
Quantity		1	1	1	1					
Insulation class		E	E	E	E					

### RPC-(4.0-6.0)FSR

MODEL		RPC-4.0FSR	RPC-5.0FSR	RPC-6.0FSR				
Heat exchanger								
Туре			Multi-pass finned tube					
Tube material		Copper						
Outer diameter	mm	7	7	7				
Rows of tubes		3	3	3				
Number of tubes in the co	oil	20	20	20				
Fin material			Aluminium					
Fin pitch	mm	1.6	1.6	1.6				
Maximum operating pressure	MPa	4.15	4.15	4.15				
Total front area	m²	0.38	0.38	0.38				
Number of coils per unit		1 1						
Fan								
Fan type			Centrifugal					
Fans per unit		4	4	4				
Outer diameter	mm	155	155	155				
Motor								
Shell			Drip-proof type enclosure					
Starting		DC motor						
Quantity		1	1					
Insulation class		Е	E	Е				

### 3.2.5 RPI - Indoor ducted unit

# RPIL-(0.4-1.5)FSRE

MODEL		RPIL-0.4FSRE	RPIL-0.4FSRE RPIL-0.6FSRE RPIL-0.8FSRE RPIL-1.0FSRE RPIL-1.5F					
Heat exchanger								
Туре			N	/lulti-pass finned tub	e			
Tube material		Copper						
Outer diameter	mm			5				
Rows of tubes				2				
Number of tubes in the	coil	3	32 40					
Fin material			Aluminium					
Fin pitch	mm			1.3				
Maximum operating pressure	MPa		4.15					
Total front area	m <sup>2</sup>			0.129				
Number of coils per uni	t			1				
Fan								
Fan type			Mι	ılti-blade centrifugal	fan			
Fans per unit				2				
Outer diameter	mm			136				
Motor								
Shell		Splash proof						
Starting		Direct current control						
Quantity				1				
Insulation class				Е				

### **RPI-(1.5-6.0)FSRE**

MODEL		RPI- 1.5FSRE	RPI- 2.0FSRE	RPI- 2.5FSRE	RPI- 3.0FSRE	RPI- 4.0FSRE	RPI- 5.0FSRE	RPI- 6.0FSRE			
Heat exchanger		1.01 OILE	Z.OI OILE	Z.OI OILE	O.OI OILE	4.01 0112	O.OI OILE	0.01 0112			
Туре				Multi-pass finned tube							
Tube material					Copper						
Outer diameter	mm	5									
Rows of tubes		3 2 3									
Number of tubes in the co	il	76 56 84									
Fin material					Aluminium						
Fin pitch	mm	1.3									
Maximum operating pressure	MPa	4.15									
Total front area	m <sup>2</sup>	0.2	:04	0.3	332	0.484					
Number of coils per unit					2						
Fan											
Fan type				Multi-l	olade centrifuç	gal fan					
Fans per unit		•				2					
Outer diameter	mm				180						
Motor											
Shell					Splash proof						
Starting		Direct current control									
Quantity					1						
Insulation class					E						

### RPIH-(4.0-6.0)FSRE

MODEL		RPIH-4.0FSRE	RPIH-5.0FSRE	RPIH-6.0FSRE		
Heat exchanger						
Туре			Multi-pass finned tube			
Tube material			Copper			
Outer diameter	mm		7			
Rows of tubes			3			
Number of tubes in the coils	3		48			
Fin material			Aluminium			
Fin pitch	mm	1.8				
Maximum operating pressure	MPa	4.15				
Total front area	ront area m² 0.397					
Number of coils per unit		1				
Fan						
Fan type		Multi-blade centrifugal fan				
Fans per unit			2			
Outer diameter	mm		180			
Motor						
Shell		Splash proof				
Starting		Direct current control				
Quantity		1				
Insulation class		E				

### RPI-(4.0-6.0)FSN6E-EF

MODEL		RPI-4.0FSN6E-EF	RPI-5.0FSN6E-EF	RPI-6.0FSN6E-EF		
Heat exchanger						
Туре			Multi-pass finned tube			
Tube material			Copper			
Outer diameter	mm		7			
Rows of tubes			4			
Number of tubes in the coil		36	48	48		
Fin material			Aluminium			
Fin pitch	mm		1.8			
Maximum operating pressure	MPa	4.15				
Total front area	m <sup>2</sup>		0.3			
Number of coils per unit			1			
Fan						
Fan type			Multi-blade centrifugal fan			
Fans per unit			2			
Outer diameter	mm		180			
Motor						
Shell		Splash proof				
Starting			Direct current control			
Quantity			1			
Insulation class			E			

# RPI-(8.0/10.0)FSN3E(-f)

MODEL		RPI-8.0FSN3E(-f)	RPI-10.0FSN3E(-f)			
Heat exchanger						
Туре		Multi-pass finned tube				
Tube material		Сорг	per			
Outer diameter	mm	7	7			
Rows of tubes		3	4			
Number of tubes in the coil		60	80			
Fin material		Alumir	iium			
Fin pitch	mm	1.8	1.8			
Maximum operating pressure	MPa	4.15	4.15			
Total front area	m <sup>2</sup>	0.57	0.57			
Number of coils per unit		1	1			
Fan						
Fan type		Multi-blade centrifugal fan				
Fans per unit		2	2			
Outer diameter	mm	240	240			
Motor						
Shell		Drip-proof type	e enclosure			
Starting		Permanent sp	lit capacitor			
Quantity		1	1			
Insulation class		F	F			

### RPI-(16.0/20.0)FSN3PE(-f)

MODEL		RPI-16.0FSN3PE(-f)	RPI-20.0FSN3PE(-f)			
Heat exchanger						
Туре		Multi-pass finned tube				
Tube material		Сорг	per			
Outer diameter	mm	7	7			
Rows of tubes		3	4			
Number of tubes in the co	oil	60+60	80+80			
Fin material		Aluminium with anti-corro	sive coating treatment			
Fin pitch	mm	1.8	1.8			
Maximum operating pressure	MPa	4.15	4.15			
Total front area	m <sup>2</sup> 0.57+0.57 0.57+		0.57+0.57			
Number of coils per unit		2 2				
Fan						
Fan type		Multi-blade ce	ntrifugal fan			
Fans per unit		2+2	2+2			
Outer diameter	mm	240	240			
Motor						
Shell		Drip-proof type	e enclosure			
Starting		Permanent split capacitor				
Quantity		1+1	1+1			
Insulation class		F	F			

# 3.2.6 RPK - Wall type

# RPK-(0.4-1.5)FSR(H)M

MODEL		RPK-0.4 FSR(H)M	RPK-0.6 FSR(H)M	RPK-0.8 FSR(H)M	RPK-1.0 FSR(H)M	RPK-1.5 FSR(H)M
Heat exchanger						
Туре			N	Iulti-pass finned tub	е	
Tube material				Copper		
Outer diameter	mm	7	7	7	7	7
Rows of tubes		2	2	2	2	2
Number of tubes in the coil		18	34	34	34	34
Fin material				Aluminium		
Fin pitch	mm	1.25	1.25	1.25	1.25	1.25
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15	4.15
Total front area	m <sup>2</sup>	0.20	0.20	0.20	0.20	0.24
Number of coils per unit		1	1	1	1	1
Fan						-
Fan type			N	lulti-blade centrifug	al	
Fans per unit		1	1	1	1	1
Outer diameter	mm	115	115	115	115	115
Motor						
Shell			Dri	p-proof type enclos	ure	
Starting			Г	Direct current contro	ol	
Quantity		1	1	1	1	1
Insulation class		E	E	E	E	E

### **RPK-(2.0-4.0)FSRM**

MODEL		RPK-2.0FSRM	RPK-2.5FSRM	RPK-3.0FSRM	RPK-4.0FSRM			
Heat exchanger								
Туре		Multi-pass finned tube						
Tube material			Сор	per				
Outer diameter	mm	7	7	7	7			
Rows of tubes		3	3	3	3			
Number of tubes in the coil		40	56	46	56			
Fin material			Alumi	nium				
Fin pitch	mm	front: 1.25 / back: 1.4	front: 1.25 / back: 1.4	front: 1.25 / back: 1.4	front: 1.25 / back: 1.4			
Maximum operating pressure MPa		4.15	4.15	4.15	4.15			
Total front area	m <sup>2</sup>	0.31	0.31	0.31	0.31			
Number of coils per unit		1	1 1		1			
Fan								
Fan type		Multi-blade centrifugal						
Fans per unit		1	1	1	1			
Outer diameter	mm	115	115	115	115			
Motor								
Shell			D	rip-proof type enclosure	)			
Starting				Direct current control				
Quantity		1	1 1		1			
Insulation class		Е	Е	Е	Е			

# 3.2.7 RPF - Floor type and RPFI - Floor concealed type

# RPF-(1.0-2.5)FSN2E

MODEL		RPF-1.0FSN2E	RPF-1.5FSN2E	RPF-2.0FSN2E	RPF-2.5FSN2E	
Heat exchanger						
Туре			Multi-pass	finned tube		
Tube material			Сор	pper		
Outer diameter	mm	7	7	7	7	
Rows of tubes		2	2	2	3	
Number of tubes in the coil		24	24	24	36	
Fin material			Alum	inium		
Fin pitch	mm	1.8	1.8	1.8	1.8	
Maximum operating pressure	· · · · · · · · · · · · · · · · · · · ·		4.15	4.15	4.15	
Total front area	m <sup>2</sup>	0.13	0.16	0.22	0.22	
Number of coils per unit		1	1	1	1	
Fan						
Fan type		Multi-blade centrifugal fan				
Fans per unit		1	2	2	2	
Outer diameter	mm	136	136	136	136	
Motor						
Shell			Splash	n-proof		
Starting			Permanent s	plit capacitor		
Quantity		1	1			
Insulation class		В	В	В	В	

### RPFI-(1.0-2.5)FSN2E

MODEL		RPFI-1.0FSN2E	RPFI-1.5FSN2E	RPFI-2.0FSN2E	RPFI-2.5FSN2E	
Heat exchanger						
Туре			Multi-pass	finned tube		
Tube material			Cop	pper		
Outer diameter	mm	7	7	7	7	
Rows of tubes		2	2	2	3	
Number of tubes in the co	ils	24	24	24	36	
Fin material			Alum	inium		
Fin pitch	mm	1.8	1.8	1.8	1.8	
Maximum operating pressure	MPa	4.15	4.15	4.15	4.15	
Total front area	m²	0.13	0.16	0.22	0.22	
Number of coils per unit		1	1	1	1	
Fan						
Fan type		Multi-blade centrifugal fan				
Fans per unit		1	2	2	2	
Outer diameter	mm	136	136	136	136	
Motor						
Shell			Splast	n-proof		
Starting			Permanent s	plit capacitor		
Quantity		1	1	1	1	
Insulation class		В	В	В	В	

### 3.2.8 KPI Units

### **♦ KPI Energy recovery series**

# KPI-(252-2002)E4E

MODEL		KPI-252E4E	KPI-502E4E	KPI-802E4E	KPI-1002E4E	KPI-1502E4E	KPI-2002E4E		
Fan									
Fan type				EC	Fan				
Fans per unit		2	2	2	2	2	2		
Outer diameter	mm	133	220	220	310	310	310		
Motor									
Shell			Splash-proof						
Starting		Soft start							
Quantity		2	2	2	2	2	2		
Insulation class		В	В	В	В	В	В		
Filter									
Filter class		G3							
Efficiency	%			9	0				

### **♦ KPI Active series**

### **KPI-**(502-1002)X4E

MODEL		KPI-502X4E	KPI-802X4E	KPI-1002X4E		
Fan						
Fan type		EC Fan				
Fans per unit		2	2	2		
Outer diameter	mm	220	220	310		
Motor						
Shell			Splash-proof			
Starting			Soft start			
Quantity			2			
Insulation class			В			
Filter						
Filter class		G3				
Efficiency	%		90			
Heat exchanger						
Туре		Multi-pass finned tube				
Tube material		Copper				
Outer diameter	mm	7	7	7		
Rows of tubes		2	2	2		
Number of tubes in the co	oils	26	32	32		
Fin material			Aluminium			
Fin pitch	mm					
Maximum operating pressure	MPa	4.15	4.15 4.15			
Total front area	m <sup>2</sup>	0.12	0.16	0.19		
Number of coils per unit		1	1	1		

### 3.3 Electrical data

### 3.3.1 Considerations

### Key:

- U: power supply.
- PH: phase.
- f: frequency.
- IPT: total input power.
- · RNC: operating current.
- MC: maximum current.

# i NOTE

The specifications given in the following tables are subject to change without prior notice.

### 3.3.2 RCI - 4-way cassette

	Main uı	nit power	supply	Applicabl	e voltage	Fan motor				
Model	U (V)	РН	f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A) Operation	MC (A) Protection fuse
RCI-1.0FSR						0.02	0.2	0.09	1.0	5.0
RCI-1.5FSR				050	207	0.03	0.4	0.09	1.0	5.0
RCI-2.0FSR						0.04	0.4	0.09	1.0	5.0
RCI-2.5FSR	230	4	50			0.07	0.7	0.09	1.0	5.0
RCI-3.0FSR	230	1	50	253		0.07	0.7	0.09	1.0	5.0
RCI-4.0FSR						0.13	1.2	0.21	2.2	5.0
RCI-5.0FSR						0.13	1.2	0.21	2.2	5.0
RCI-6.0FSR						0.13	1.2	0.21	2.2	5.0

### 3.3.3 RCIM - 4-way cassette (compact)

	Main unit power supply		Applicable voltage Fan motor									
Model	U (V)	РН	f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A) Operation	MC (A) Protection fuse		
RCIM-0.4FSRE								0.05	0.25	0.08	0.5	5.0
RCIM-0.6FSRE							0.05	0.25	0.08	0.5	5.0	
RCIM-0.8FSRE						0.05	0.25	0.09	0.5	5.0		
RCIM-1.0FSRE	230	1	50	253	207	0.06	0.30	0.10	0.6	5.0		
RCIM-1.5FSRE						0.07	0.35	0.11	0.7	5.0		
RCIM-2.0FSRE						0.10	0.51	0.13	0.8	5.0		
RCIM-2.5FSRE						0.11	0.56	0.15	0.9	5.0		

# 3.3.4 RCD - 2-way cassette

Model	Main unit power supply			Applicable voltage		Fan motor					
	U (V)	PH	f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A) Operation	MC (A) Protection fuse	
RCD-0.8FSR	230	1	50	253	207	0.03	0.13	0.05	0.3	5.0	
RCD-1.0FSR						0.03	0.14	0.06	0.4	5.0	
RCD-1.5FSR						0.05	0.23	0.08	0.5	5.0	
RCD-2.0FSR						0.06	0.29	0.09	0.5	5.0	
RCD-2.5FSR						0.07	0.37	0.10	0.6	5.0	
RCD-3.0FSR						0.09	0.48	0.12	0.8	5.0	
RCD-4.0FSR						0.11	0.55	0.14	0.8	5.0	
RCD-5.0FSR						0.13	0.68	0.16	1.0	5.0	
RCD-6.0FSR						0.15	0.76	0.18	1.1	5.0	

# 3.3.5 RPC - Ceiling type

Model	Main unit power supply			Applicable voltage		Fan motor				
	U (V)	PH	f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A) Operation	MC (A) Protection fuse
RPC-1.5FSR	230	1	50	253	207	0.04	0.20	0.12	0.7	5.0
RPC-2.0FSR						0.05	0.25	0.12	0.7	5.0
RPC-2.5FSR						0.05	0.25	0.15	0.9	5.0
RPC-3.0FSR						0.06	0.30	0.15	0.9	5.0
RPC-4.0FSR						0.10	0.51	0.41	2.4	5.0
RPC-5.0FSR						0.16	0.81	0.41	2.4	5.0
RPC-6.0FSR						0.19	0.96	0.41	2.4	5.0

#### 3.3.6 RPI - Indoor ducted unit

	Mair	n unit po supply			cable age			Fan mot	tor	
Model	Model U (V) PH f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A) Operation	MC (A) Protection fuse		
RPIL-0.4FSRE						0.04	0.4	0.05	0.5	5.0
RPIL-0.6FSRE						0.05	0.5	0.06	0.6	5.0
RPIL-0.8FSRE						0.05	0.5	0.06	0.6	5.0
RPIL-1.0FSRE						0.05	0.5	0.07	0.6	5.0
RPIL-1.5FSRE						0.05	0.5	0.07	0.7	5.0
RPI-1.5FSRE						0.15	1.4	0.19	1.8	5.0
RPI-2.0FSRE					207	0.15	1.4	0.19	1.8	5.0
RPI-2.5FSRE						0.21	2.0	0.29	2.8	5.0
RPI-3.0FSRE						0.22	2.1	0.30	3.0	5.0
RPI-4.0FSRE						0.23	2.2	0.27	3.2	5.0
RPI-5.0FSRE	230	1	50	253		0.29	2.8	0.34	3.5	5.0
RPI-6.0FSRE	200	•		200	207	0.31	3.0	0.38	3.5	5.0
RPIH-4.0FSRE						0.22	2.1	0.26	3.0	5.0
RPIH-5.0FSRE						0.27	2.6	0.32	3.4	5.0
RPIH-6.0FSRE						0.30	2.9	0.36	3.4	5.0
RPI-4.0FSN6E-EF						0.23	2.2	0.27	3.2	5.0
RPI-5.0FSN6E-EF						0.29	2.8	0.34	3.5	5.0
RPI-6.0FSN6E-EF						0.31	3.0	0.38	3.5	5.0
RPI-8.0FSN3E(-f)						0.97	4.5	1.75	10.0	10.0
RPI-10.0FSN3E(-f)						1.06	4.8	1.91	10.0	10.0
RPI-16.0FSN3PE(-f)						1.94	9.0	3.50	16.2	16.2
RPI-20.0FSN3PE(-f)						2.12	9.6	3.82	17.7	17.7

## 3.3.7 RPK - Wall type

	Mai	n unit po supply	ower	Applicable voltage		Fan motor				
Model	U (V)	PH	f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A) Operation	MC (A) Protection fuse
RPK-0.4FSR(H)M						0.02	0.2	0.03	0.2	5.0
RPK-0.6FSR(H)M						0.02	0.2	0.03	0.2	5.0
RPK-0.8FSR(H)M						0.02	0.2	0.03	0.2	5.0
RPK-1.0FSR(H)M						0.02	0.2	0.03	0.2	5.0
RPK-1.5FSR(H)M	230	1	50	253	207	0.05	0.4	0.06	0.4	5.0
RPK-2.0FSRM						0.03	0.2	0.06	0.3	5.0
RPK-2.5FSRM						0.05	0.4	0.08	0.5	5.0
RPK-3.0FSRM						0.06	0.4	0.09	0.6	5.0
RPK-4.0FSRM						0.06	0.6	0.10	0.7	5.0

## 3.3.8 RPF(I) - Floor type

	Main unit power supply		Applicable voltage		Fan motor					
Model	U (V)	PH	f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A) Operation	MC (A) Protection fuse
RPF(I)-1.0FSN2E						0.04	0.2	0.05	0.3	5.0
RPF(I)-1.5FSN2E	220	4	50	252	207	0.05	0.2	0.07	0.3	5.0
RPF(I)-2.0FSN2E	230		50	0 253	207	0.09	0.4	0.12	0.6	5.0
RPF(I)-2.5FSN2E						0.09	0.4	0.12	0.6	5.0

#### 3.3.9 KPI energy

	Main	unit power	supply	Applicab	le voltage	Fan motor			
Model	U (V)	PH	f (Hz)	Max. U (V)	Min. U (V)	IPT (kW)	RNC (A)	Max. IPT (kW)	MC (A)
KPI-252E4E			50	253	207	0.05	0.39	0.10	4.0
KPI-502E4E						0.12	0.88	0.20	4.0
KPI-802E4E						0.24	1.82	0.27	4.0
KPI-1002E4E						0.26	1.85	0.35	8.0
KPI-1502E4E	230	1				0.46	2.11	0.58	8.0
KPI-2002E4E						0.67	3.04	0.81	8.0
KPI-502X4E						0.13	1.06	0.20	4.0
KPI-802X4E						0.26	2.01	0.27	4.0
KPI-1002X4E						0.36	2.68	0.36	8.0

# System selection procedure

## Index

4.1	System selection procedure	138
4.2	Sensible heat correction factor (SHF)	141
4.3	RPI Fan performance	142
	4.3.1 RPIL-(0.4-1.5)FSRE	142
	4.3.2 RPI-(1.5-6.0)FSRE	143
	4.3.3 RPIH-(4.0-6.0)FSRE	144
	4.3.4 RPI-(4.0-6.0)FSN6E-EF	145
	4.3.5 RPI-(8.0-20.0)FSN3(P)E-(-f)	145
4.4	Temperature distribution diagrams	148
	4.4.1 RCI-(1.0-6.0)FSR - 4-way cassette	148
	4.4.2 RCIM (0.4-2.5)FSRE - 4-way cassette (compact)	150
	4.4.3 RCD-(0.8-6.0)FSR - 2-way cassette	152
	4.4.4 RPC-(1.5-6.0)FSR - Ceiling type	154
	4.4.5 RPK-(0.4-4.0)FSR(H)M - Wall type	155
4.5	Selection procedure for KPI	156
	4.5.1 Selection guide	156
	4.5.2 Calculation of heat exchanger efficiency	157
	4.5.3 KPI energy	158
4.6	Selection procedure for Econofresh	160
	4.6.1 Ducting arrangement	160
	4.6.2 Maximum capacity of the Free Cooling system (Economizer)	162
	4.6.3 Outdoor cooling mode (All Fresh)	162
4.7	Selection procedure for DX-interface	163
	4.7.1 Cycle design evaporating and condensing temperatures	164
	4.7.2 DX-Interface series 2 applications and control mode	164
4.8	Communication network compatibility	165

#### 4.1 System selection procedure

In the outdoor unit technical documentation there is detailed the selection procedure of the indoor units and outdoor unit.

Bearing in mind the building layout, the planned location of the indoor units and the air flow distribution, always select units that provide the most efficiency, performance and comfort.

Plan a location to install the units that allow for easy maintenance and operating tasks and for the installing of refrigerant

Appropriate selection of indoor units and nominal capacity.

The pre-selected capacity of the different indoor units need to be the immediately higher in all the units, in order to apply a safety factor considering the different correction factors existing, which will reduce the capacity.

Select the outdoor unit and the most suitable indoor-outdoor unit combination according to design conditions. To do so, consult the Technical Catalogue for the corresponding outdoor unit series (UTOPIA or SET FREE).

The selection procedure is divided into two main parts: cooling and heating, in line with the specific requirements of each installation.

Its is also necessary to selection the indoor units according to the different indoor unit characteristics described in the following chapter.




- For the setting temperature at the heating operation in RPI, RCD and RCI indoor unit type, consider the temperature irregularity between the floor and the ceiling surface. The temperature around the ceiling surface normally becomes 2°C higher than the floor surface during the heating operation.
- For selecting indoor unit capacity, if the sensible heating load is considered, consider the sensible heat correction factor (SHF)

Indoor unit sensible heating capacity = Indoor units capacity x SHF factor

#### Brief description of the system selection procedure

The procedure for system selection follows the flowchart below.

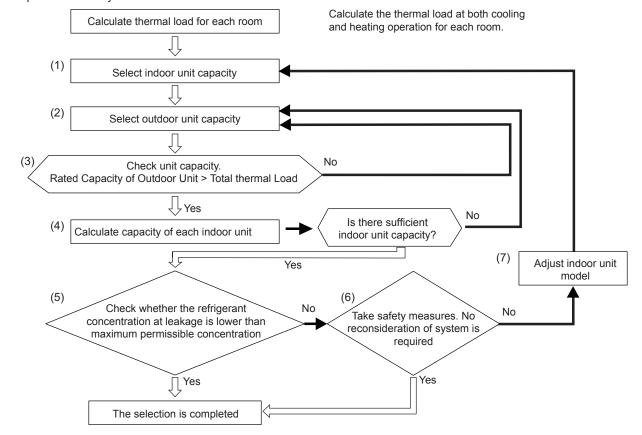

A detailed explanation of each of the steps is provided as follows.

#### (1) Selecting indoor unit capacity.

Set a tentative model of indoor unit for each room, making sure that its capacity complies with the following rule:

Nominal capacity of the indoor unit > Estimated load for the corresponding room

Then, sum up each the nominal capacity of all the indoor units (The calculation for both cooling and heating operation is required).

Total nominal capacity of the indoor units =  $\sum$  Nominal capacity of each indoor unit



In case that the room temperature used to calculate the estimate load of the rooms differs from the rated temperatures for each operation mode (27°C DB / 19°C WB for cooling, 20°C DB for heating), it is advisable to carry out a rough calculation to check whether the capacity of the selected indoor units is sufficient.

Indoor unit capacity = Nominal capacity of each indoor unit x Correction factor (room temperature)

Correction factor according to room temperature: select the outdoor unit capacity at the estimated load from the "Cooling / Heating capacity tables".

Correction Factor (room temperature) = Outdoor unit capacity at estimated load at room temperature / Nominal outdoor unit capacity

#### (2) Selecting outdoor unit capacity.

Establish the desired connection ratio based on the total combined capacity of the indoor units and set a tentative outdoor unit capacity according to the total nominal capacity of the indoor units calculated in step (1).

Outdoor unit capacity at estimated load: Check the temperatures used for the estimation of load when calculating the capacity of the outdoor unit. In case that the room temperature or the outdoor air temperature are different from those used for the calculation of nominal capacity (room temperature: 27 °C DB / 19 °C WB for cooling, 20 °C DB for heating; outdoor air temperature: 35 °C DB for cooling, 7 °C DB / 6 °C WB for heating). Then select the outdoor unit capacity at the estimated load (considering the room temperature and outdoor air temperature) from the "Cooling / Heating capacity tables" in the technical documentation of the outdoor unit.

Then, calculate the maximum capacity of the outdoor unit considering the correction factors depending on piping length, height difference and altitude, as well as the defrosting correction factor (for heating operation).

The calculation for both cooling and heating operation is required.

Corrected Outdoor unit capacity = Outdoor unit capacity at estimated load x Correction factors (piping length and height difference, altitude correction factor, defrosting correction factor (for heating operation))

#### (3) Checking outdoor unit capacity.

Compare the outdoor unit capacity obtained in step (2) with the total nominal capacity of the indoor units obtained in step (1), making sure that the following is true.

Corrected Outdoor Unit capacity > Total thermal load (the total sum of the thermal load of all the rooms)

#### (4) Calculating the capacity of each indoor unit.

Recalculate indoor unit capacity as follow (The calculation for both cooling and heating operation is required).

Real indoor unit capacity for each room = Capacity of the system (obtained in step 2) × (Nominal capacity of the indoor unit / Total nominal capacity of the installed indoor units (obtained in step 2))

Confirm that the real indoor unit capacity for each room is sufficient to cover the thermal load required for the corresponding room:

Indoor Unit real capacity > Load for concerned room (\*)

(\*) Indoor unit real capacity is calculated with all indoor units working at full capacity. Maximum indoor unit capacity is up to nominal capacity when total load doesn't exceed outdoor unit capacity.


In case that outdoor unit capacity is either too small to cover the thermal load required for one or more of the rooms or too large to cover the thermal load required in each and all of the rooms, then recalculate it in step (2) after selecting an outdoor unit with increased or decreased capacity, as appropriate.

In case that is a significant lack or excess of capacity in a given room persists even after having recalculated outdoor unit requirements, it is advisable to select another indoor unit model for that room.

#### Different load areas

In some buildings or installations the load can be split in a different areas and each area don't required the maximum load simultaneous. For example in a typical building with a morning peak heat load on the east area, and in the afternoon a peak occurs on the west area. In this cases the outdoor units to be selected only need to cover the maximum simultaneous load for the entire building.


The following diagram shows a installation where the maximum simultaneous load occur in the western area (B = C)



- A: morning peak heat load in the eastern area
- B: evening peak heat load in the western area
- C: maximum simultaneous load for the entire building
- D: eastern area load
- E: total load
- F: western area load
- G: load
- H: time

The selected outdoor units need to cover the load in the western area (B) and the indoor units need to cover the load of each western rooms as well as the indoor units in eastern rooms need to cover the load of each room (at the temperatures used for calculate the estimate load of the rooms).

The following diagram shown a installation where the maximum simultaneous load for entire building occur when there are load simultaneous in both area (but are not the maximum of each area).



- A: morning peak heat load in the eastern area
- B: evening peak heat load in the western area
- C: maximum simultaneous load for the entire building
- D: eastern area load
- E: total load
- F: western area load
- G: load
- H: time

In these case the selected outdoor units need to cover the maximum simultaneous load for the entire building (C) and the indoor units maximum capacity need to cover the maximum load of each room (at the temperatures used for calculate the estimate load of the rooms).



In case that the total indoor unit capacity exceeds the capacity of the outdoor unit, the discharge temperature in heating operation may drop and cause discomfort when outdoor air temperature is low or piping length is long, or when all the indoor units are operated simultaneously. Therefore, the installation should be designed making sure that the "cooling/heating" capacity of the indoor units calculated from the "cooling/heating" capacity for the system is greater than the required heating load.

- (5) Checking the concentration of refrigerant in the event of refrigerant leakage < Permissible concentration of refrigerant
- (6) Taking safety measures (Reconsideration of system is not required).
- (7) Correction of indoor unit model if the outcome of both (5) and (6) is negative.

## 4.2 Sensible heat correction factor (SHF)

Sensible heat factor of the indoor units for each fan speed (High 2, High, Medium, Low), according to the JIS B8616 Standard.

	Ser	nsible hea	t factor (Sh	·IF)
Indoor unit model	High 2	High	Medium	Low
RCI-1.0FSR	0.86	0.85	0.81	0.80
RCI-1.3FSR (*)	0.88	0.84	0.80	0.75
RCI-1.5FSR	0.89	0.83	0.80	0.71
RCI-1.8FSR (*)	0.89	0.80	0.75	0.69
RCI-2.0FSR	0.89	0.78	0.71	0.67
RCI-2.3FSR (*)	0.88	0.80	0.72	0.67
RCI-2.5FSR	0.87	0.81	0.73	0.67
RCI-3.0FSR	0.81	0.76	0.67	0.64
RCI-4.0FSR	0.77	0.71	0.68	0.65
RCI-5.0FSR	0.72	0.69	0.65	0.62
RCI-6.0FSR	0.69	0.68	0.64	0.61
RCIM-0.4FSRE	0.96	0.94	0.92	0.90
RCIM-0.6FSRE	0.94	0.92	0.90	0.89
RCIM-0.8FSRE	0.87	0.86	0.85	0.84
RCIM-1.0FSRE	0.83	0.82	0.81	0.80
RCIM-1.3FSRE (*)	0.78	0.77	0.76	0.75
RCIM-1.5FSRE	0.74	0.73	0.73	0.72
RCIM-1.8FSRE (*)	0.72	0.72	0.72	0.71
RCIM-2.0FSRE	0.71	0.71	0.71	0.70
RCIM-2.3FSRE (*)	0.69	0.70	0.70	0.70
RCIM-2.5FSRE	0.68	0.70	0.70	0.70
RCD-0.8FSR	0.93	0.87	0.82	0.78
RCD-1.0FSR	0.86	0.81	0.77	0.73
RCD-1.3FSR (*)	0.85	0.80	0.76	0.72
RCD-1.5FSR	0.84	0.79	0.76	0.72
RCD-1.8FSR (*)	0.79	0.75	0.72	0.68
RCD-2.0FSR	0.75	0.72	0.69	0.66
RCD-2.3FSR (*)	0.74	0.70	0.68	0.65
RCD-2.5FSR	0.73	0.69	0.67	0.65
RCD-3.0FSR	0.74	0.70	0.67	0.64
RCD-4.0FSR	0.74	0.70	0.68	0.65
RCD-5.0FSR	0.73	0.69	0.67	0.64
RCD-6.0FSR	0.71	0.68	0.66	0.64
RPC-1.3FSR (*)	0.91	0.86	0.79	0.72
RPC-1.5FSR	0.86	0.81	0.76	0.70
RPC-1.8FSR (*)	0.78	0.74	0.71	0.68
RPC-2.0FSR	0.73	0.69	0.68	0.66
RPC-2.3FSR (*)	0.73	0.69	0.68	0.65
RPC-2.5FSR	0.73	0.69	0.68	0.65
RPC-3.0FSR	0.75	0.72	0.68	0.66
RPC-4.0FSR	0.77	0.74	0.71	0.67
RPC-5.0FSR	0.71	0.68	0.67	0.63
RPC-6.0FSR	0.69	0.66	0.63	0.60

Indoor unit reads!	Ser	sible hea	t factor (Sh	HF)
Indoor unit model	High 2	High	Medium	Low
RPIL-0.4FSRE	-	0.75	0.71	0.67
RPIL-0.6FSRE	-	0.74	0.70	0.66
RPIL-0.8FSRE	-	0.73	0.69	0.65
RPIL-1.0FSRE	-	0.73	0.69	0.65
RPIL-1.5FSRE	-	0.72	0.68	0.64
RPI-1.5FSRE	-	0.76	0.72	0.68
RPI-2.0FSRE	-	0.75	0.71	0.67
RPI-2.5FSRE	-	0.75	0.71	0.67
RPI-3.0FSRE	-	0.74	0.70	0.66
RPI-4.0FSRE	-	0.84	0.81	0.78
RPI-5.0FSRE	-	0.83	0.80	0.77
RPI-6.0FSRE	-	0.83	0.80	0.76
RPIH-4.0FSRE	-	0.76	0.72	0.68
RPIH-5.0FSRE	-	0.75	0.71	0.67
RPIH-6.0FSRE	-	0.75	0.71	0.66
RPI-4.0FSN6E-EF	-	0.84	0.81	0.78
RPI-5.0FSN6E-EF	-	0.83	0.80	0.77
RPI-6.0FSN6E-EF	-	0.83	0.80	0.76
RPI-8.0FSN3E(-f)	-	0.77	0.77	0.70
RPI-10.0FSN3E(-f)	-	0.79	0.79	0.72
RPI-16.0FSN3PE(-f)	-	0.77	-	0.70
RPI-20.0FSN3PE(-f)	-	0.79	-	0.72
RPK-0.4FSR(H)M	0.92	0.83	0.77	0.73
RPK-0.6FSR(H)M	0.90	0.81	0.75	0.72
RPK-0.8FSR(H)M	0.90	0.81	0.75	0.72
RPK-1.0FSR(H)M	0.78	0.70	0.66	0.65
RPK-1.3FSR(H)M (*)	0.80	0.72	0.68	0.66
RPK-1.5FSR(H)M	0.82	0.73	0.69	0.66
RPK-1.8FSRM (*)	0.75	0.71	0.67	0.65
RPK-2.0FSRM	0.71	0.69	0.66	0.65
RPK-2.3FSRM (*)	0.72	0.70	0.67	0.65
RPK-2.5FSRM	0.73	0.70	0.67	0.65
RPK-3.0FSRM	0.72	0.69	0.67	0.64
RPK-4.0FSRM	0.67	0.66	0.65	0.65
RPF(I)-1.0FSN2E	-	0.73	0.69	0.65
RPF(I)-1.5FSN2E	-	0.73	0.69	0.65
RPF(I)-1.8FSN2E (*)	-	0.73	0.69	0.65
RPF(I)-2.0FSN2E	-	0.73	0.69	0.65
RPF(I)-2.3FSN2E (*)	-	0.73	0.69	0.65
RPF(I)-2.5FSN2E	-	0.73	0.69	0.65
KPI-502X4E	-	0.69	0.60	0.56
KPI-802X4E	-	0.70	0.64	0.62
KPI-1002X4E	-	0.73	0.67	0.65




(\*) Capacity available with DSW3 setting.


#### 4.3 RPI Fan performance




- Make sure SP-02 is selected on the remote control for RPI-(0.4-6.0)FSRE units in the case of short duct installations. To configure SP-02, refer the optional functions C5->"02", low static pressure option. Make sure the low static pressure option (LSP) is selected for RPI (8.0/10.0)FSN3E(-f) units.
- Ensure a minimal resistance is maintained in the duct, as shown in the fan performance graphs. Starting the unit with a duct that is too short causes it to operate outside its accepted operating range.


#### 4.3.1 RPIL-(0.4-1.5)FSRE

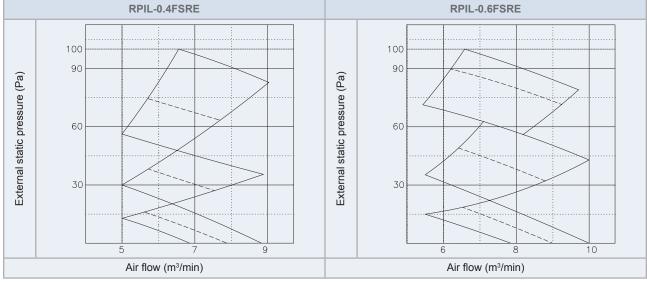


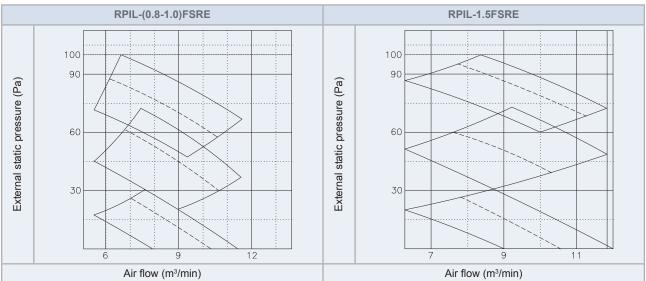


#### 4.3.2 RPI-(1.5-6.0)FSRE

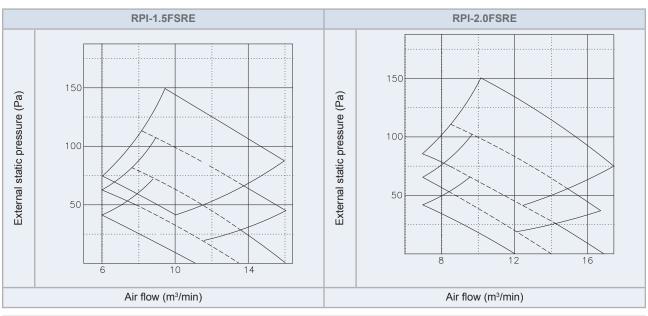


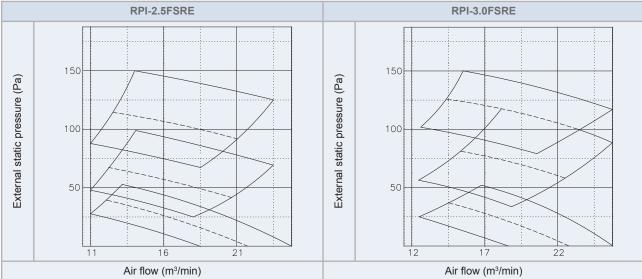


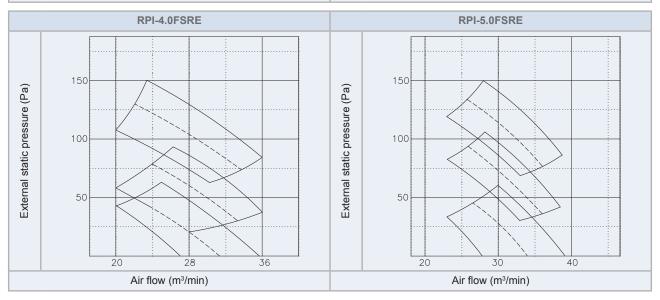

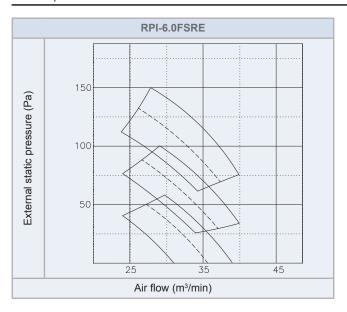



#### 4.3.3 RPIH-(4.0-6.0)FSRE

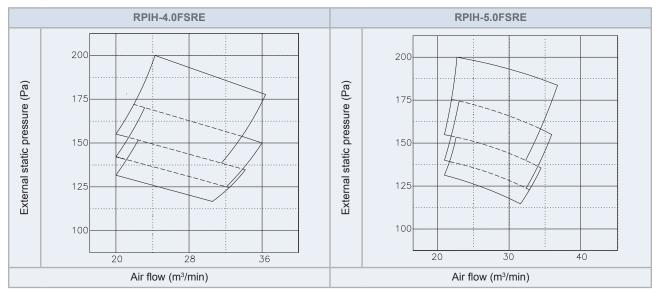

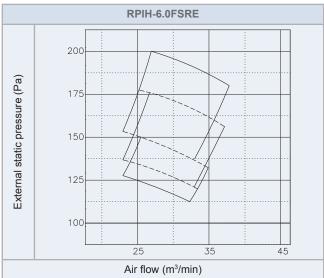



#### 4.3.4 RPI-(4.0-6.0)FSN6E-EF

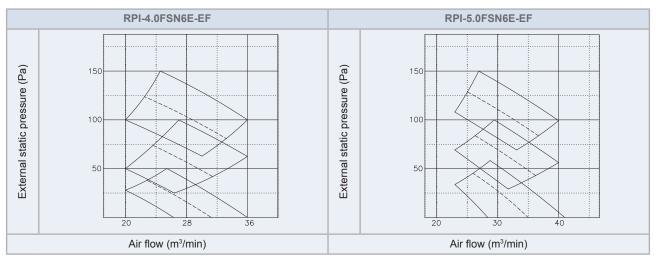

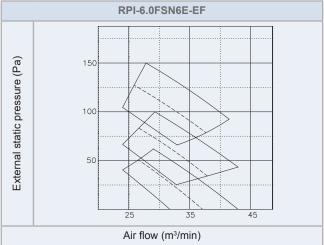


#### 4.3.5 RPI-(8.0-20.0)FSN3(P)E-(-f)

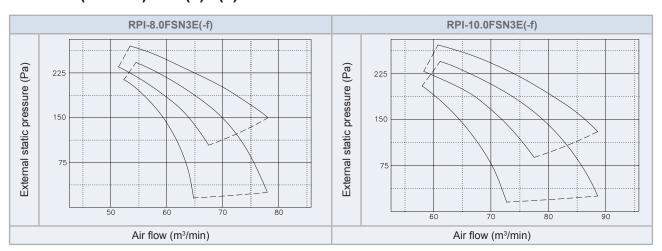

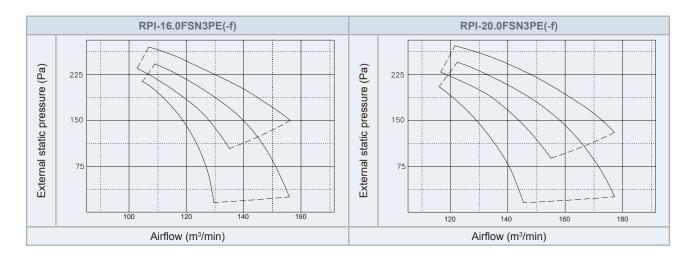

#### ◆ Fan speed availability according to the selected external static pressure RPI(L/H)-(0.4-6.0)FSRE

According to the selected of External Static Pressure configuration (through the optional function C5) the fan speed available in the Remote Control Switch are the ones show as example in the following pictures.

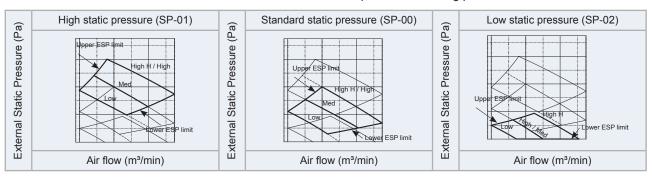

## i NOTE

- "High H" speed available only with PC-ARFP1E remote control switch.
- Factory setting C5 = 00.


#### ◆ Fan speed availability according to the static pressure setting (RPI-(8.0/10.0)FSN3E(-f), RPI-(16.0/20.0)FSN3PE-(f)

The fan motor in RPI-(8.0/10.0)FSN3E(-f) and RPI-(16.0/20.0)FSN3PE(-f) units can be configured in two different ways:

- A: connector CN24 LSP (Low Static Pressure);
- B: connector CN25 HSP (High Static Pressure). (factory supplied).




Perform the connection with the same settings in both units that make up models RPI-(16.0/20.0)FSN3E(-f); otherwise malfunction may occur, causing damage to the units.



According to the Static Pressure setting (connector CN24 LSP (Low Static Pressure) or CN25 HSP (High Static Pressure)) the fan speed available in the Remote Control Switch are the ones show as example in the following pictures.

Example for RPI-(8.0/10.0)FSN3E(-f):

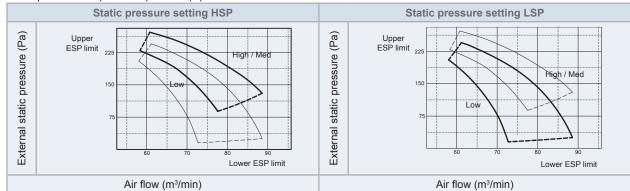


#### 4.4 Temperature distribution diagrams


The air is discharged almost symmetrically. The illustrations show obstacle-free air distribution.

Figures in this chapter shown a calculated temperature distributions near the centre of the air outlet and in case where added a load proportional to cooling or heating capacity onto the wall and floor under the conditions JIS standard.

The values do not necessarily match the wind speed distribution. They vary depending on air temperature, wall and floor size and temperature, ceiling height, louver position, obstacles, etc.

#### 4.4.1 RCI-(1.0-6.0)FSR - 4-way cassette

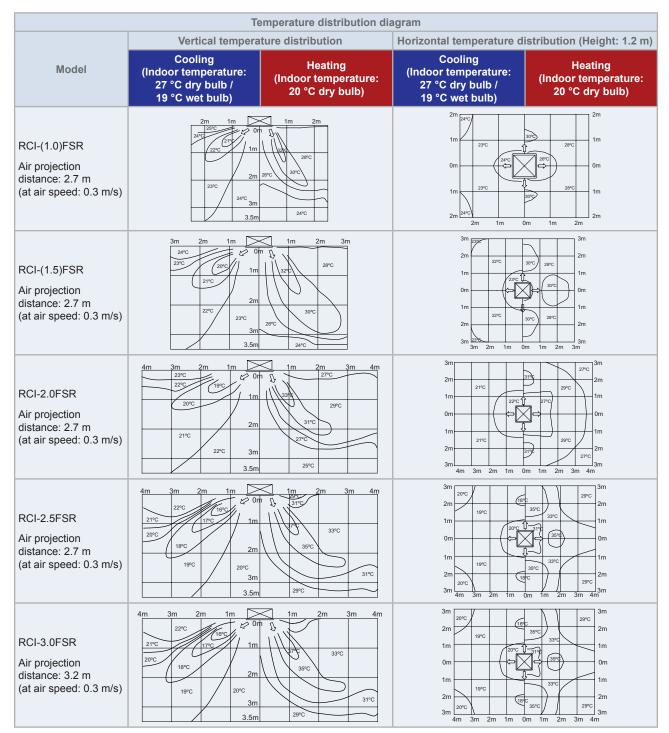

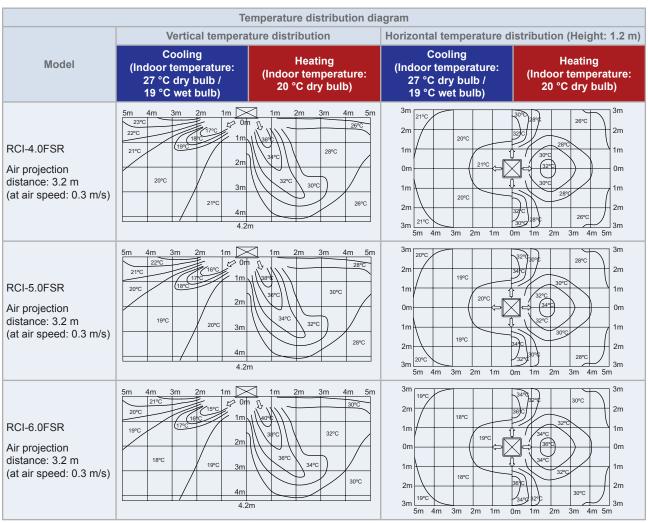





Louver angle test:

- cooling 25°
- heating 60°

Indoor unit set at High2 speed

#### 4.4.2 RCIM (0.4-2.5)FSRE - 4-way cassette (compact)

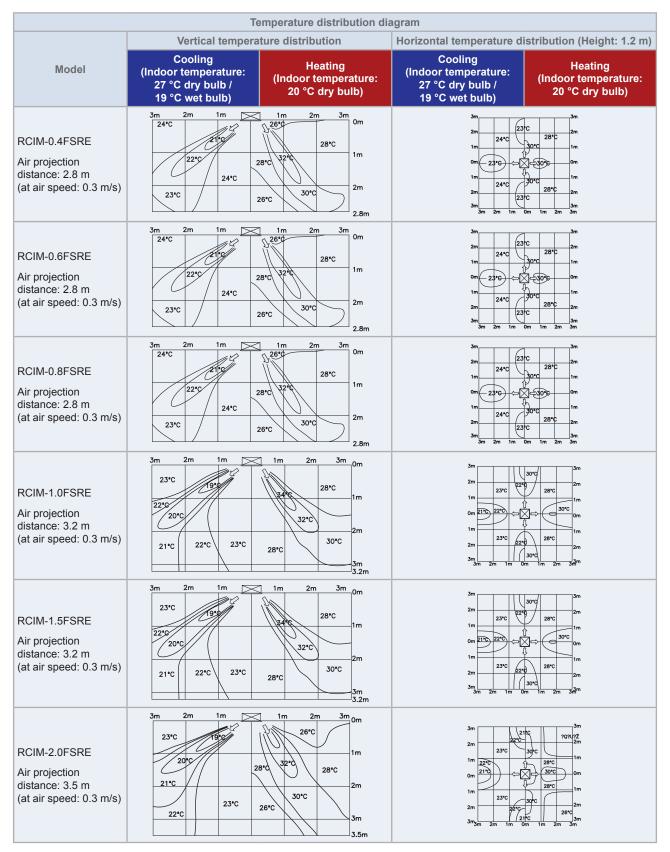


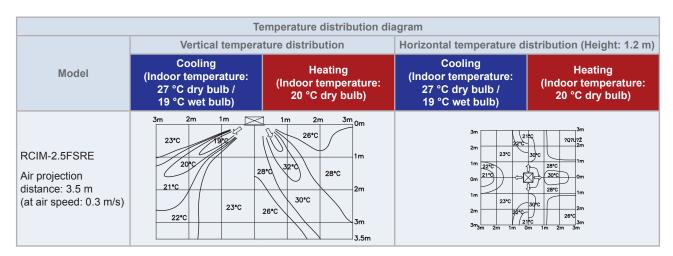




- Louver angle test:
  - cooling 35°
  - heating 60°
- Indoor unit set at High2 speed

#### 4.4.3 RCD-(0.8-6.0)FSR - 2-way cassette

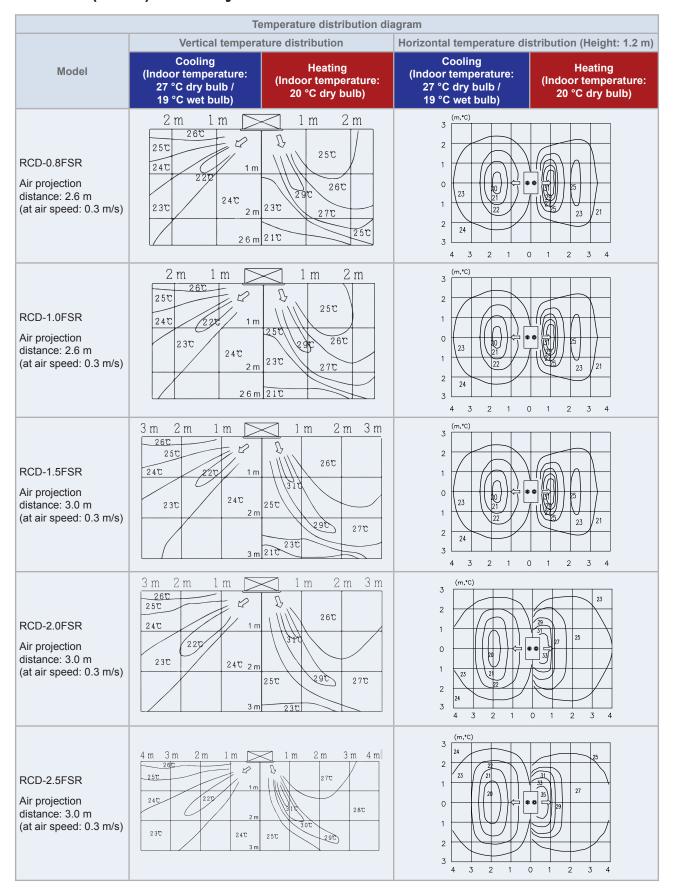


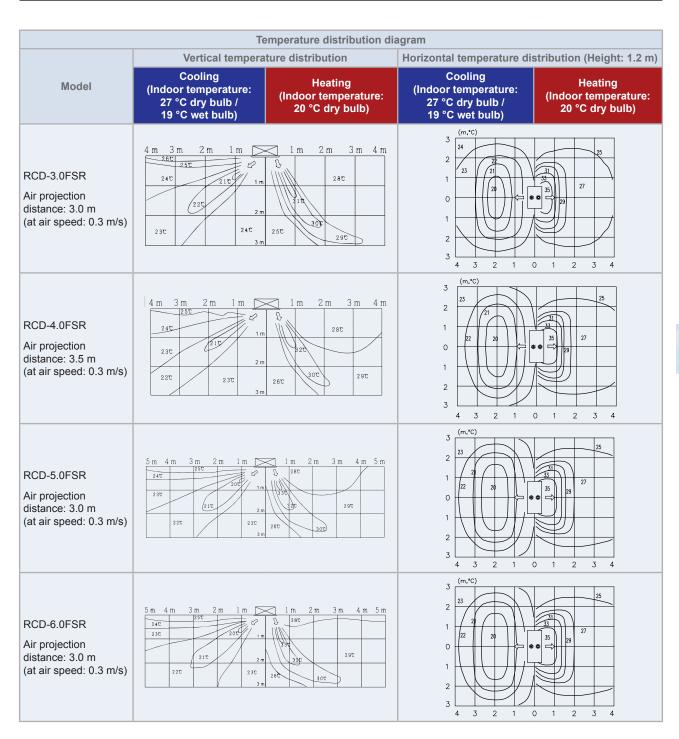



- Louver angle test:
  - cooling 35°
  - heating 60°
- Indoor unit set at High2 speed

#### 4.4.4 RPC-(1.5-6.0)FSR - Ceiling type

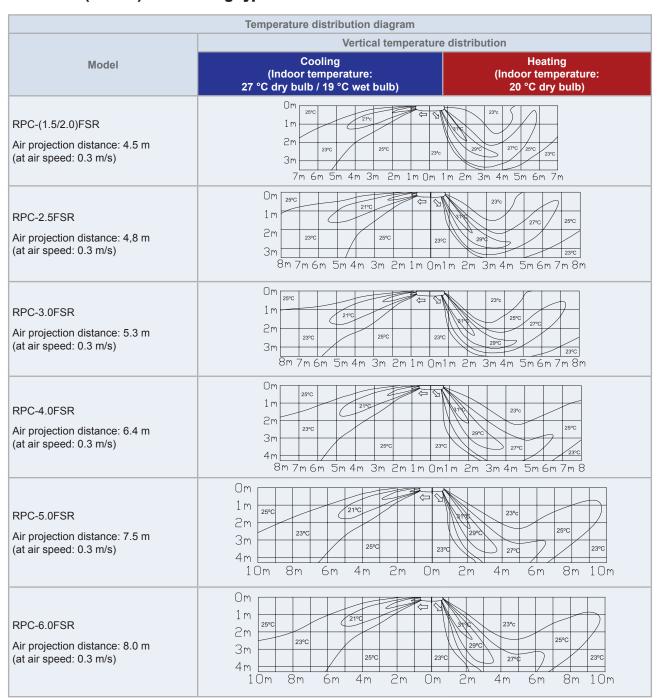



- Louver angle test:
  - cooling 10°
  - heating 35°
- Indoor unit set at High2 speed

#### 4.4.5 RPK-(0.4-4.0)FSR(H)M - Wall type

Standard at ceiling Height 2.4 m (at High speed)

	Temperature distribution diagra	am
	Vertical tempera	ature distribution
Model	Cooling (Indoor temperature: 27 °C dry bulb / 19 °C wet bulb)	Heating (Indoor temperature: 20 °C dry bulb)
RPK-0.4FSR(H)M Air projection distance: 2.7 m (at air speed: 0.3 m/s)	00 00 00 00 00 00 00 00 00 00 00 00 00	0n
RPK-0.6FSR(H)M Air projection distance: 3.0 m (at air speed: 0.3 m/s)	10   10   10   10   10   10   10   10	20 205 205 205 205 205 205 205 205 205 2
RPK-0.8FSR(H)M Air projection distance: 3.5 m (at air speed: 0.3 m/s)	0n	0n
RPK-1.0FSR(H)M Air projection distance: 3.5 m (at air speed: 0.3 m/s)	10 207 107 207 207 207 207 207 207 207 207 207 2	0n
RPK-1.5FSR(H)M Air projection distance: 4.5 m (at air speed: 0.3 m/s)	0n	00
RPK-2.0FSRM Air projection distance: 4.7 m (at air speed: 0.3 m/s)	Dn	0n
RPK-2.5FSRM Air projection distance: 6.0 m (at air speed: 0.3 m/s)	0n	On 200 200 200 200 200 200 200 200 200 20
RPK-3.0FSRM Air projection distance: 6.0 m (at air speed: 0.3 m/s)	0n 2n 4n 5n 6n 7n 8n 1n 24T 22T 22T 22T 22T 22T 22T 22T 22T 22T	0n
RPK-4.0FSRM Air projection distance: 6.5 m (at air speed: 0.3 m/s)	0n	0n



- Louver angle test:
  - cooling 30°
  - heating 55°
- Indoor unit set at High2 speed

#### 4.5 Selection procedure for KPI

#### 4.5.1 Selection guide

There are two methods for calculating the appropriate unit:

- 1 Area method.
- 2 Occupant method.

Local legislation regarding the certification of the end results must be checked.

This is a quick method for calculating ventilation requirements. Remember that the result is only approximate.

The air in the room must be renewed to reduce the CO<sub>2</sub> index in it and eliminate any unpleasant smells, smoke and pollution. In short, the room must be ventilated to provide its occupants with higher comfort levels.

The first point of the analysis consists of determining the type of activity to take place in the room: an office is not the same as a restaurant. The volume of the room in question must then be calculated.

#### Method 1: area method

This method is based on areas and on the quantity of air changes.

Volume  $V(m^3) = A \times B \times C$ 

A x B: area of the room (m2).

C: ceiling height (m).

Consult the table below to ascertain the number of air changes required, depending on the type of room.



This table is not standard to all countries, although the layout will be similar. Consult the specific regulations in force in each country.

Required changes p	per hour		
Cathedral	0		
Modern church (low ceiling)	1-2		
Schools	2-3		
Offices	3-4		
Bars	4-6		
Hospitals	5-6		
Restaurants	5-6		
Laboratories	6-8		
Discos	10-12		
Kitchens	10-15		
Laundries	20-30		

The flow of air to be changed is calculated using the following formula:

Air flow 
$$C(m^3/h) = V \times N$$

V: volume of the room (m3).

N: number of air changes.

Considering an average height of 3 m, the appropriate KPI unit must be selected according to the fan performance curves (Air flow / External static pressure).

#### Method 2: occupant method

Air flow  $(m^3)$   $C = 20 \times (A \times B)/D$ 

 $A \times B$ : area of the room (m<sup>2</sup>).

20: constant.

D: area occupied by each person (m<sup>2</sup>); this area is limited to 10.

#### 4.5.2 Calculation of heat exchanger efficiency

The following process describes the way total efficiency of the KPI unit heat exchanger is obtained and the way of calculating the supply air temperature.


A: heat exchanger.

OA: fresh outdoor air.

EA: exhaust air.

SA: supply air.

RA: return air.



Nominal temperature exchange conditions									
Location	Indoo	r (RA)	Outdoor (OA)						
Temperature (°C)	Dry bulb	Dry bulb Wet bulb		Wet bulb					
Cooling (kW)	27±1	20±2	35±1	29±2					
Heating (kW)	20±1	14±2	5±1	2±2					

The supply and exhaust air flow volume is the same.

The equations used for the necessary parameters to calculate the operating conditions of the KPI unit are given below. It is first necessary to balance energy.

Temperature exchange efficiency (sensible exchange efficiency):

 $\eta t = t(OA) - t(SA) / t(OA) - t(RA) \times 100 (\%)$ 

Humidity exchange efficiency (latent exchange efficiency):

 $\eta x = x(OA) - x(SA) / x(OA) - x(RA) = x \ 100 \ (\%)$ 

Total heat exchange efficiency (enthalpy exchanger efficiency):

 $\eta i = (i(OA)-i(SA)) / i(OA)-i(RA) \times 100 (\%)$ 

The supply air temperature can be deduced by using the temperature exchange efficiency, according to the following formula:


 $t(SA) = t(OA) - \eta t(t(OA) - t(RA))$ 




- ηt can be obtained from the graphs in Chapters "KPI-(252-2002)E4E units" or "KPI-(502-1002)X4E units".
- The temperature exchange efficiency is obtained by determining the air flow required.
- Temperature t is expressed in °C DB (dry bulb).
- Humidity x is expressed in kg, / kg,
- Enthalpy i is expressed in kJ / kg.


#### 4.5.3 KPI energy

#### ♦ KPI-(252-2002)E4E units

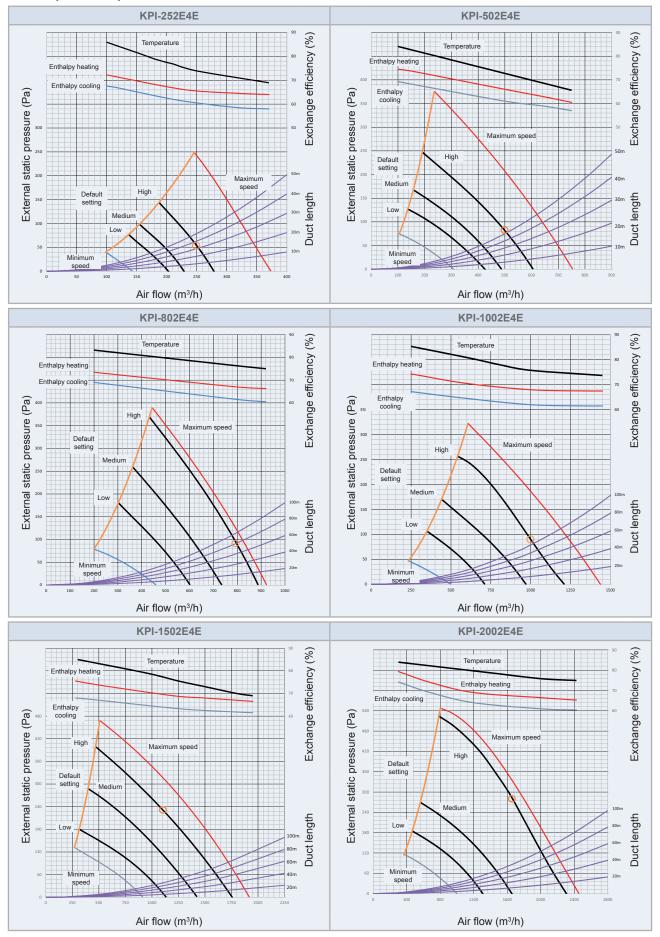


#### ♦ KPI-(502-1002)X4E units

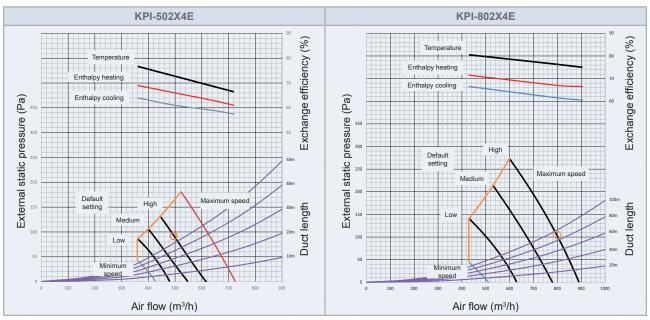

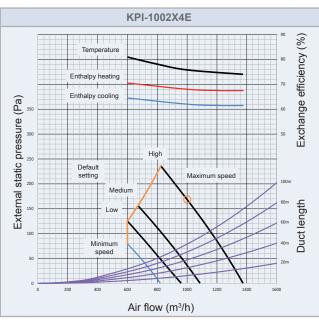

#### 4.6 Selection procedure for Econofresh

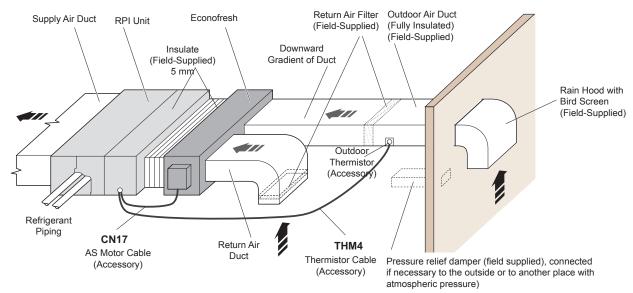



- RPI units are supplied with standard Air Filter at the suction side. This air filter need to be removed, adding a Return air filter (field supplied) in the supply air duct from outside and return air duct front inside.
- The Econofresh unit can only be installed in combination with the RPI-(4.0-6.0)FSN6E-EF units.

The following procedure explains the method for calculating the different parameters to be taken into account for the installation of Econofresh, and its advantages in a natural cooling system and for the renewal of air in the room.

The first factor to be taken into consideration is the existence of a loss of pressure in the ducts, which is different for each installation.

#### 4.6.1 Ducting arrangement

This unit has been designed for positive introduction of outdoor air for free cooling and other controls. Check to ensure that the following points have been designed or arranged beforehand:

1 Pressure Relief Damper

Provide a pressure relief damper when the building has a closed, airtight structure, since positive pressure is going to be created inside the building during the free cooling or All Fresh operation.


2 Outdoor Air Filter

Provide a field-supplied outdoor air filter for the outdoor air duct.

#### 3 Resistance of Outdoor Air Duct

In order to protect against a shortage of outdoor air intake or an excessive intake of outdoor air, which may reduce the capacity of free cooling or produce an uncomfortable change of supply air during free cooling operation, keep the resistance of the outdoor air duct within the following guide range:

1/2 PR < PO < 4 x PR

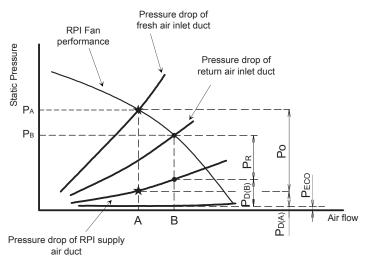

Balance of Air Flow and Resistance of each Duct.

The pressure loss graphs of the ducts must be included in the fan performance chart of the RPI unit. The static pressure generates a performance curve for 0% fresh air airflow rate [B] and for 100% fresh air airflow rate [A] (natural cooling system). The high static pressure calculation for each case is as follows:

$$P_{A} = P_{O} + P_{D(A)} + P_{ECO}$$
$$P_{B} = P_{R} + P_{D(B)} + P_{ECO}$$



: air flow supplied when the fresh outdoor air damper is fully opened (return air damper is fully closed)

: air flow supplied when the fresh outdoor air damper is fully closed (return air damper is fully opened)

: pressure loss due to the supply air duct (air discharge duct)

: pressure loss due to the fresh outdoor air duct, considering supply air volume by design conditions (including the

: pressure loss due to the return air duct, considering supply air volume by design conditions (including the air filter)

 $P_{FCO}$ : pressure level of the Econofresh

#### Example:

 $P_{D(A)}$ : 2 mmH<sub>2</sub>O  $P_{D(B)}$ : 3.5 mmH<sub>2</sub>O;

P<sub>o</sub>: 14 mmH<sub>2</sub>O;  $P_R$ : 6.5 mmH<sub>2</sub>O;  $P_{ECO}$ : 2 mmH<sub>2</sub>O;


 $PA = 14 + 2 + 2 = 18 \text{ mmH}_{2}O$ 

PB= 6.5 + 3.5 + 2 = 12 mmH<sub>2</sub>O

The result of this calculation is an air flow of:

35 m<sup>3</sup>/min for (B) (non fresh air flow) and 25 m<sup>3</sup>/min for (A) (100% fresh air flow).

The calculation of the energy saving for 25 m³/min (free cooling mode) is shown in the next chapter.

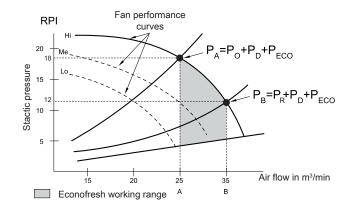

## *i* NOTE

- The balance between the outdoor air volume and the return air volume depends on the arrangement of the ducts.
- Air filters in ducts increase the pressure loss.
- Ducting arrangement must comply with local regulations.

#### **♦** Considerations for duct installation

#### 1 Ducting Connection

Pre-drilled duct flanges are provided at the supply, return and outdoor air intake connections. It is recommended to install a flexible duct connection to minimize noise and the transmission of vibration (between the indoor units and Econofresh).


The duct shall have a downward gradient in order to prevent the entry of dirt or water from the outside.

#### 2 Insulation

All ducts should be insulated.

- Especially the outdoor air duct, which is used to let the cold outdoor air flow in, must be sufficiently insulated.
- The lowest temperature of the outdoor air entering the flow of the outdoor air duct is the lowest temperature that can be achieved in heating operation in that installation.

In the case of using the unit under the following condition, perform additional insulation (\*) or set up a drain pan underneath the unit.



Ambient temperature around the unit

#### 4.6.2 Maximum capacity of the Free Cooling system (Economizer)

The determination of maximum capacity in free cooling is determined with the following formula.

The factors in the formula are:

maximum outdoor air flow rate  $(V_{OMAX})$ , indoor temperature  $(T_i)$ , outdoor temperature  $(T_0)$ 

And they are arranged as:

$$Q_{SHmax} = V_{OMAX} \cdot (1 - \beta) \cdot (T_{I} - T_{O}) \cdot 0.02$$
  
Example:

 $\beta$  = 0.2 bypass factor for RPI  $V_{OMAX} = 25 \text{ m}^3/\text{min}$ T, = 25 °C

$$T_{0} = 15 \, ^{\circ}\text{C}$$

$$Q_{SHmax} = 4 \text{ kW}$$

This is the maximum capacity permitted by the Econofresh to reduce energy supply per hour under these conditions.

#### 4.6.3 Outdoor cooling mode (All Fresh)

The Econofresh can also operate in outdoor cooling mode (All Fresh). To select this mode, use the additional function E, configured on the remote control.

The All Fresh mode enables the Econofresh to operate, just supplying fresh air from outdoors. To do so, the damper remains fully open while the indoor unit is running.

If the outdoor cooling mode is used permanently, it causes a drop in air flow rate. Therefore, the cooling capacity must be calculated by using the minimum air flow rate (Point A in the graphic in the "4.6.1 Ducting arrangement" section).

The minimum opening of the outdoor air damper (adjustable with d7 optional function of the remote control switch) is always applied whenever the control system does not request a full opening.

#### 4.7 Selection procedure for DX-interface

Units to be connected to the DX-Interface series 2 must satisfy the following requirements.

	Allowed Heat e	xchangeı	· Capacity	/ (kW) <sup>(1)</sup>	Heat Ex	changer I	nner Volume (dm³) (2)	Recommended Heat Exchanger Air flow (m³/min)	
DX-Code	Mode	Min	Nom	Max	Min	Max	Max <sup>(2)</sup> (Only UTOPIA RAS-XH(V)NP(1)E)	Min	Max
EXV-2.0E2	Cooling	4.0	5.0	5.6	0.57	1.16	1.64	8.0	21.0
EAV-2.0E2	Heating	4.5	5.6	7.1	0.57	1.10	1.04	0.0	21.0
EXV-2.5E2	Cooling	4.8	6.0	6.3	0.89	1 25	1.83	11 5	26.0
EAV-2.5E2	Heating	5.6	7.0	7.1	0.69	1.35	1.83	11.5	20.0
EXV-3.0E2	Cooling	5.7	7.1	8.0	1.02	1.03 1.57	2.89	12.5	30.0
EAV-3.0E2	Heating	6.4	8.0	9.0	1.03				
EXV-4.0E2	Cooling	8.0	10.0	11.2	1.51	2.37	4.56	20.0	36.0
EAV-4.0E2	Heating	9.0	11.2	12.5	1.51	2.37			
EXV-5.0E2	Cooling	10.0	12.5	14.0	1.92	2.37	4.56	23.0	41.5
EXV-5.0E2	Heating	11.2	14.0	16.0	1.92	2.37	4.50	23.0	41.5
EXV-6.0E2	Cooling	11.2	14.0	16.0	1.92	2.92	5.11	25.0	42.5
EAV-0.0E2	Heating	12.8	16.0	18.0	1.92	2.92	5.11	25.0	42.5
EXV-8.0E2	Cooling	16.0	20.0	22.4	2.02	3 80	6.03	50.0	78.0
EAV-0.UEZ	Heating	17.9	22.4	25.0	2.92 3.89	6.93	59.0	7 0.0	
EXV-10.0E2	Cooling	20.0	25.0	28.0	0.00 1.70	4.76	10.73	00.0	89.0
LAV-10.0E2	Heating	22.4	28.0	31.5	3.89	4.70	10.73	68.0	09.0

(1) Cooling and heating capacity data are based on the following indoor and outdoor temperature conditions, according to the EN14511 standard.

Operation conditions		Cooling	Heating
Indoor air inlet temperature	DB	27.0°C	20.0°C
indoor all inlet temperature	WB	19.0°C	-
Outdoor oir inlet temperature	DB	35.0°C	7.0°C
Outdoor air inlet temperature	WB	-	6.0°C

DB: dry bulb; WB: wet bulb

Pipe length: 7.5 m; pipe height: 0 m.

<sup>(2)</sup> Check the limits of piping length vs HEX volume.



- 1 Check that the unit or device connected to the DX heat exchanger allows the desired operation mode, and use it exclusively in the proper mode.
- 2 Please refer to the Installation Manual and the Technical Catalogue of the connected units and devices, to make sure that installation conditions are within the allowed ranges.

#### 4.7.1 Cycle design evaporating and condensing temperatures

Please make sure that the Heat Exchanger element to be connected to the DX-Interface series 2 satisfies the following installation and design requirements. Failure to satisfy any of the items below may cause unappropriated system response, malfunction of any of the system components, and/or damage to the components.

- The design pressure of the system is 4.15 MPa. The compression strength of the pipes must exceed 12.45 MPa (3 times the design pressure)
- The inner volume of the heat exchanger piping must be within the limits specified in the technical documentation of each DX-Interface series 2. Please make sure the design of the heat exchanger as well as the refrigerant charge follow such limitations.
- The capacity of the heat exchanger must meet the specified nominal capacity of each DX-Interface series 2 under the following temperature conditions. Failure to ensure heat exchanger capacity may lead to system malfunction.

Design temperatures	Heating	Design temperatures	Cooling
Air temperature:	DX-interface HEX (T <sub>in</sub> ): 20°C(DB) Outdoor: 7°C(DB)/6°C(WB)	Air temperature:	DX-Interface HEX (T <sub>in</sub> ): 27°C(DB)/19°C(WB) Outdoor: 35°C(DB)
Condensing Temperature:	40°C ~ 45°C	Evaporation Temperature:	6°C
Subcooling Temperature:	3°C	Superheating Temperature:	5°C

#### 4.7.2 DX-Interface series 2 applications and control mode

The following table summarizes system features for the applications with DX-Interface series 2.

		System		
Application		UTOPIA (IVX, RASC and ES)	UTOPIA DX RAS-XH(V)NP(1)E	SET FREE (5)
	Combinability	Single	-	Multi (6)
Air curtain	Control type	Outlet air temperature control	-	Inlet air temperature control
All Gartain	Air curtain Capacity	2 - 10 HP	-	2 - 10 HP
	Accuracy control level	••••	-	<b>•••</b> (1)
Duct (≤ 10% Fresh Air)	Combinability	Single	Modular	Multi (6)
	Control type	Inlet air temperature control	Inlet air temperature control	Inlet air temperature control
	Duct Capacity	2 - 10 HP	12 - 50 HP (2)(3)	2 - 10 HP
	Accuracy control level	•••••	•••••	<b>•••</b> (1)
Air handling unit (AHU)	Combinability	-	Single or Modular	-
	Control type	-	Outlet air temperature control or duty signal	-
	Capacity	-	4 - 50 HP (3)(4)	-
	Accuracy control level	-	••••	-



<sup>(1)</sup> System control focuses on cycle conditions and performance, not inlet air temperature condition only.

<sup>(5) 1-1</sup> combination with SET FREE series is not allowed.

(6)	DX-Interface series 2 ratio capacity		
	≤ 30 %	30 ~ 100 %	
Total connection ratio capacity against Outdoor Unit Capacity (%)	50 ~ 130 %	50 ~ 100 %	

In case DX-Interface series 2 ratio is less than 30 % of the outdoor units capacity, the total connection ratio against Outdoor Unit Capacity is 50 ~ 130%, Otherwise, total connection ratio is limited to 50 ~ 100%.

<sup>(2)</sup> The power range is obtained by the combination of 3 HP to 10 HP outdoor unit models (RAS-(XH(V)NP(1)E series).

<sup>(3)</sup> In order to ensure balanced working conditions for outdoor units, it is necessary to consider the same capacity outdoor units for a same

<sup>(4)</sup> The power range is obtained by the combination of 4 HP to 10 HP outdoor unit models (RAS-(XH(V)NP(1)E series).

#### 4.8 Communication network compatibility

H-LINK and H-LINK II communication networks are combined with their remote controls in line with the following examples.


- The new H-LINK II communication network system provides for remote control connection, from the PC-P2HTE model and later models.
- Hitachi has a range of individual, centralised or computer-aided remote control systems that can be used with the SYSTEM FREE units. Consult the corresponding technical documentation for controls.



- Several functions are not available in certain Indoor Unit / Remote Control combinations.
- Refer to Remote Control Installation and Operation Manual and Controllers Technical Catalogue for detailed functions.

#### Examples of different H-LINK and H-LINK II systems

#### Example 1. System with outdoor and indoor units, remote control and H-LINK II communication network

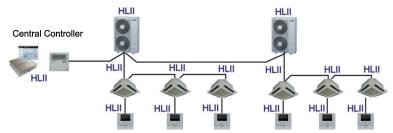




HLII: H-LINK II.

Refrigerant cycle number range	0-63
Indoor unit number range	0-63
Maximum number of indoor units	160
Maximum number of units (*)	200
(1) Units = indoor units + outdoor units + centralised control.	

Example 2. System with outdoor and indoor units, H-LINK II remote control and H-LINK central control

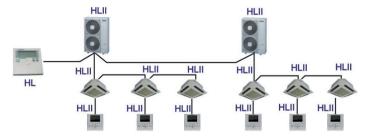




- HL: H-LINK.
- HLII: H-LINK II.

Refrigerant cycle number range	0-15
Indoor unit number range	0-15
Maximum number of indoor units	128
Maximum number of units (*)	145
(*) Units = indoor units + outdoor units + centralised control.	

Example 3. System with outdoor and indoor units, H-LINK remote controls and H-LINK II central control

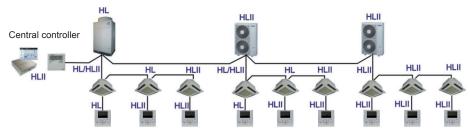


Combination of units	1	2		3
Refrigerant cycle number range	0-15	0-15		0-63
Indoor unit number range	0-15	0-15	0-63	0-63
Maximum number of indoor units	128			
Maximum number of units (*)	145			
(*) Units = indoor units + outdoor units + centralised control.				



- HL: H-LINK
- HLII: H-LINK II

Example 4. System with outdoor and indoor units, H-LINK and H-LINK II remote controls and H-LINK central control

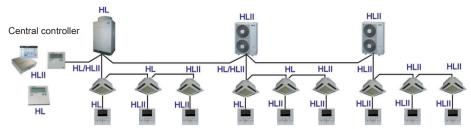




- HL: H-LINK
- HLII: H-LINK II

Refrigerant cycle number range	0-15
Indoor unit number range	0-15
Maximum number of indoor units	128
Maximum number of units (*)	145
(1) Units = indoor units + outdoor units + centralised control.	

#### The following connections are not possible:

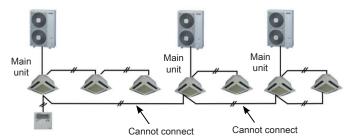

Different indoor units from different systems cannot be connected using the same remote control when the option to not use the remote control operating cable has been selected.

All optional units connected to CN3 may only be used on the main unit using the connected remote control.

# 5. Acoustic characteristic curves

#### Index

5.1	Overall sound level	168
5.2	Sound pressure	169
	5.2.1 RCI-(1.0-6.0)FSR - 4-way cassette	169
	5.2.2 RCIM-(0.4-2.5)FSRE - 4-way cassette (compact)	171
	5.2.3 RCD-(0.8-6.0)FSR - 2-way cassette	173
	5.2.4 RPC-(1.5-6.0)FSR - Ceiling type	176
	5.2.5 RPI(L/H)-FSRE and RPI-FSN(3/6)(P)E-(-f/EF) - Indoor ducted unit	178
	5.2.6 RPK-(0.4-4.0)FSR(H)M - Wall type	184
	5.2.7 RPF-(1.0-2.5)FSN2E - Floor type	188
	5.2.8 RPFI-(1.0-2.5)FSN2E - Floor concealed type	189
	5.2.9 KPI	190
	5.2.9.1 KPI energy recovery series	190
	5.2.9.2 KPI Active series	192
5.3	Sound power	193
	5.3.1 RPI(L/H)-FSRE and RPI-FSN(3/6)(P)E-(-f/EF) - Indoor ducted unit	193



#### 5.1 Overall sound level


The overall sound level has been measured in an anechoic chamber so reflected sound should be taken into consideration when installing the unit.


#### Sound pressure level


The sound pressure level has been measured in an anechoic chamber under the following conditions:

- 1 Distance of the unit from the measuring point:
  - a. RCI(M), RCD indoor units: 1.5 m below the unit.
  - b. RPI indoor units: 1.5 m below the unit (without ceiling under the unit), applying suction duct 1 m. and discharge duct 2m.
  - c. RPC and RPK indoor units: 1 m below the unit, 1 m from the discharge louver.
  - d. RPF and RPFI indoor units: 1 m from floor level, 1 m from the front surface of the unit.
  - e. Additional KPI system: 1.5 m below the unit (with no ceiling below the unit), duct sound insulated.
- 2 Power supply: 230V 50Hz.

#### Sound pressure level measuring positions

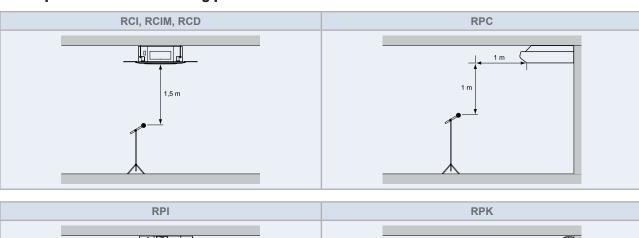

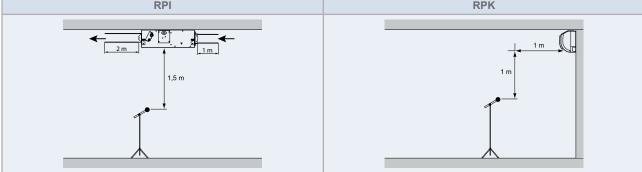

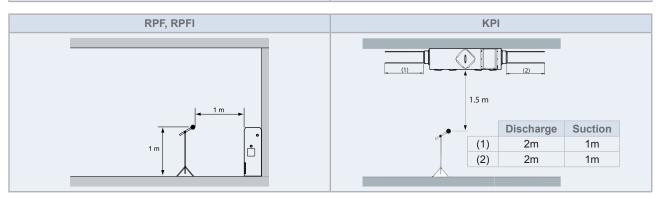



#### Sound power level


Sound power levels were measured in a reverberant room, in accordance with the EN12102 standard. Used environment conditions are the same as specified in EN14511 for performance test.


#### **5.2 Sound pressure**

#### 5.2.1 RCI-(1.0-6.0)FSR - 4-way cassette

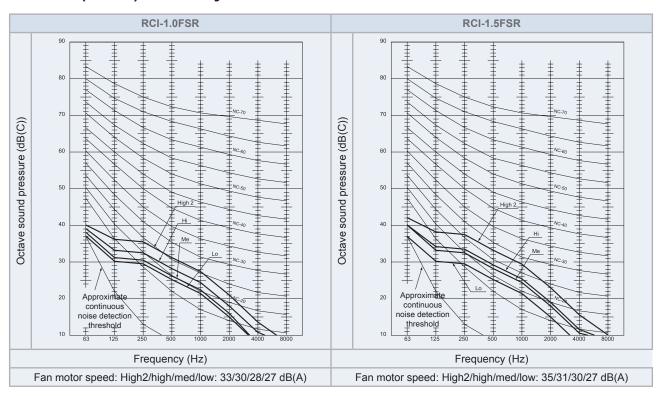


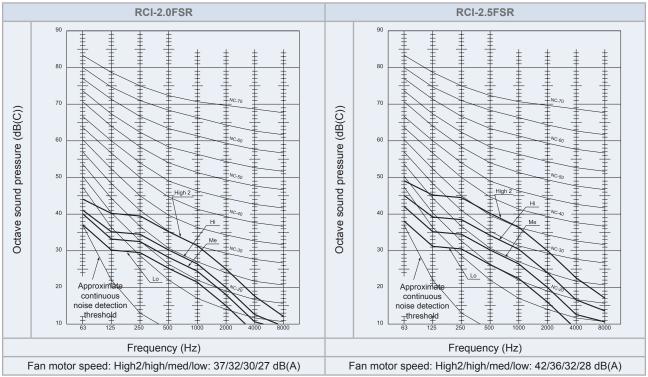


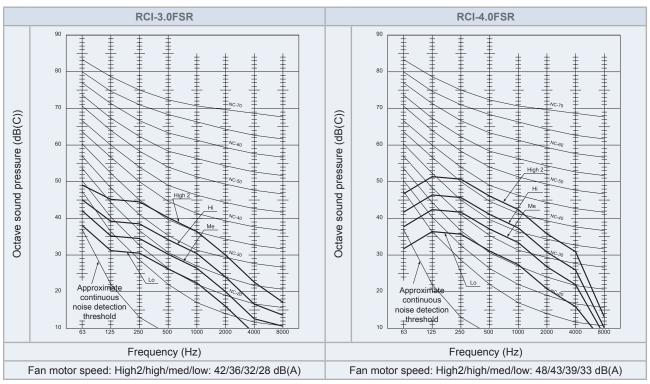


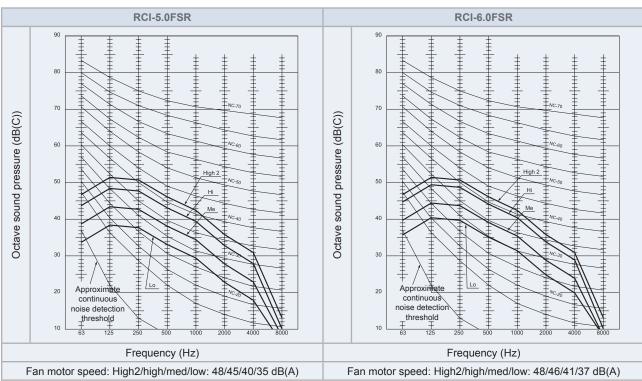


#### 5.2.2 RCIM-(0.4-2.5)FSRE - 4-way cassette (compact)

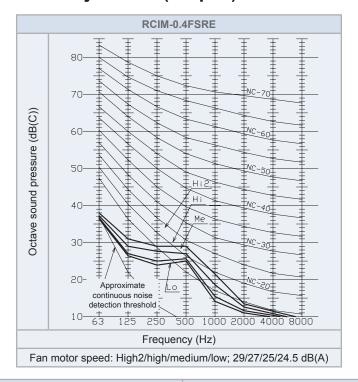


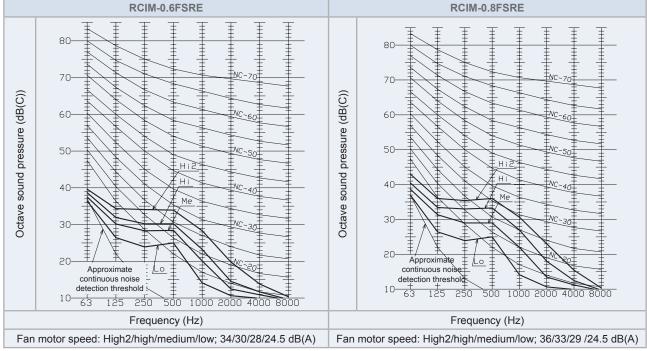


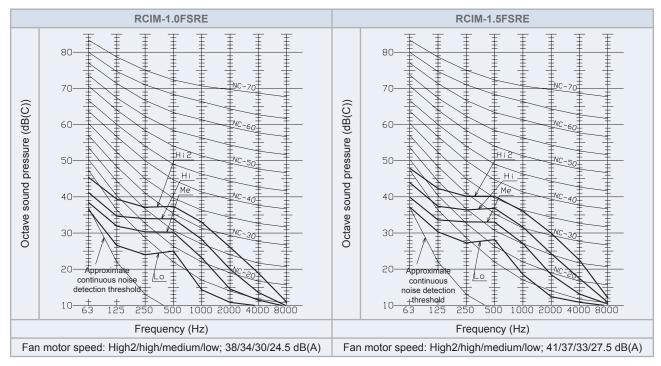


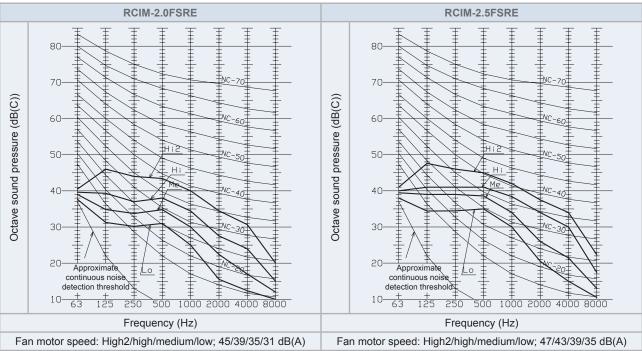



#### 5.2.3 RCD-(0.8-6.0)FSR - 2-way cassette

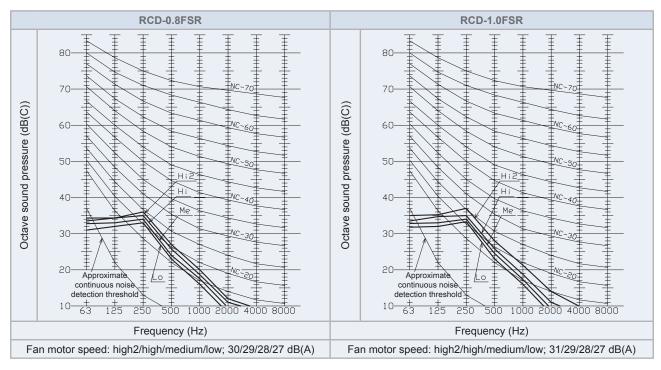

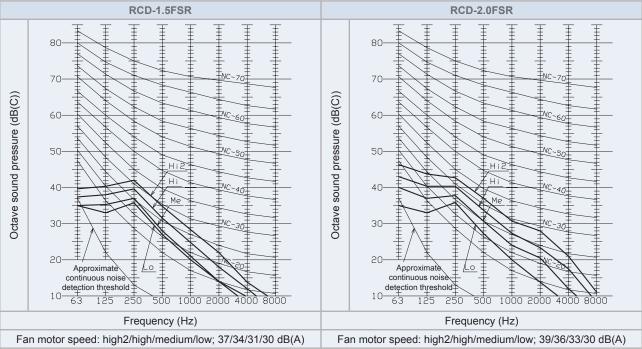


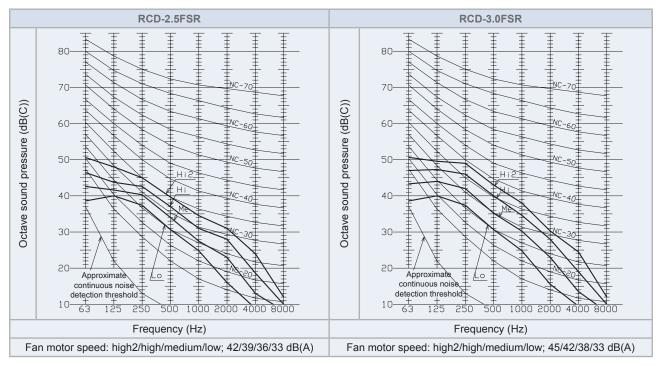


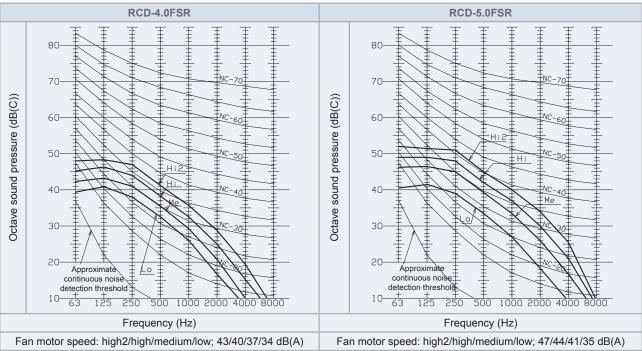


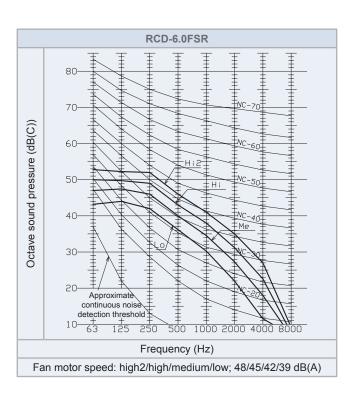


#### 5.2.4 RPC-(1.5-6.0)FSR - Ceiling type

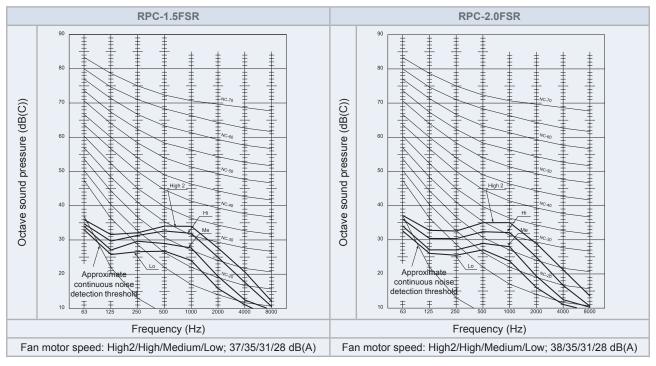


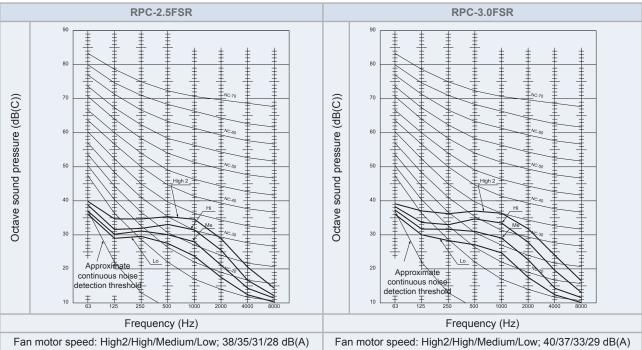


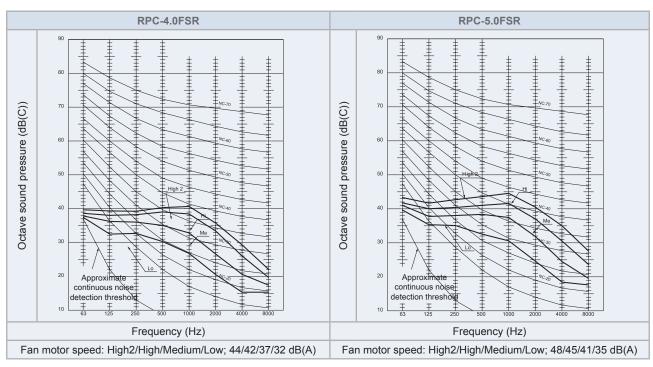


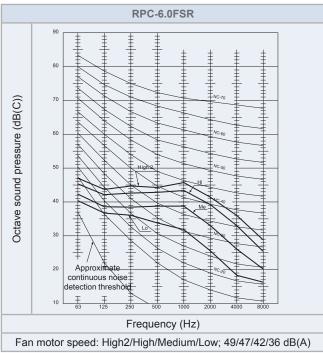



#### 5.2.5 RPI(L/H)-FSRE and RPI-FSN(3/6)(P)E-(-f/EF) - Indoor ducted unit

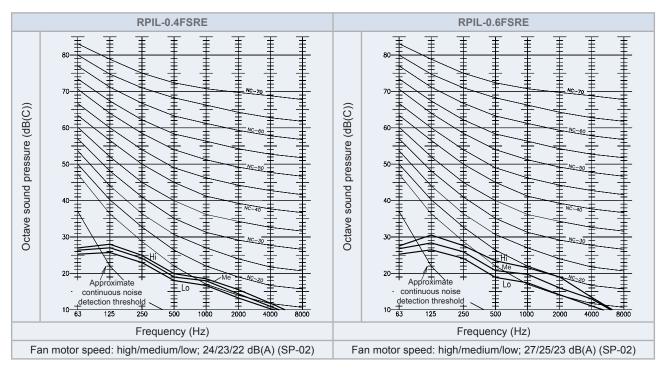


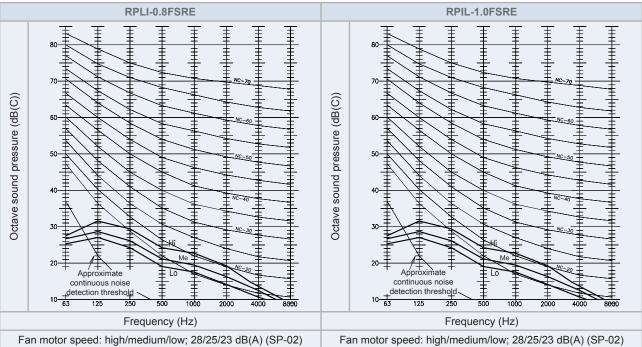


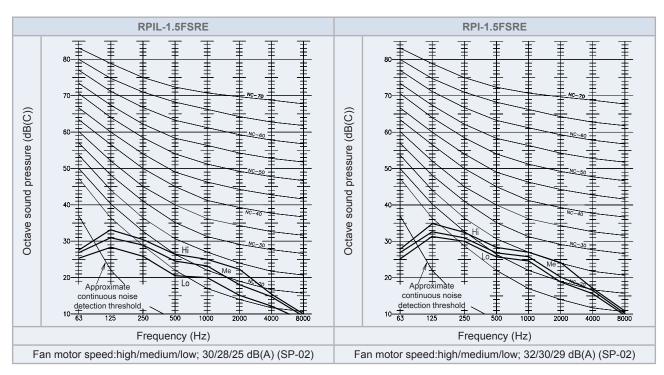


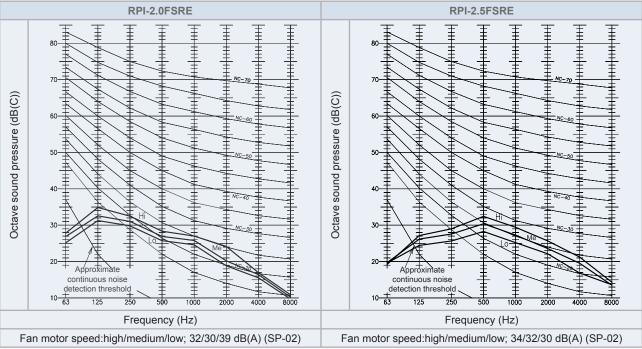


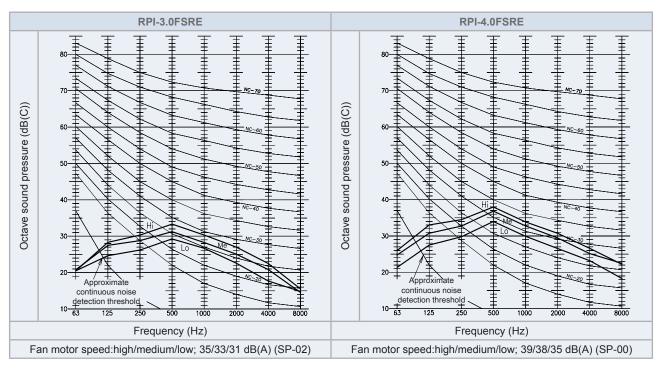


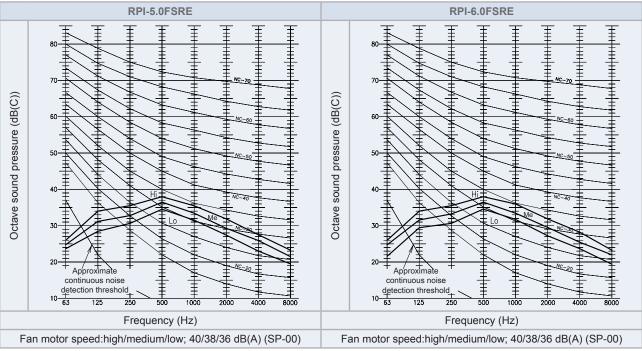


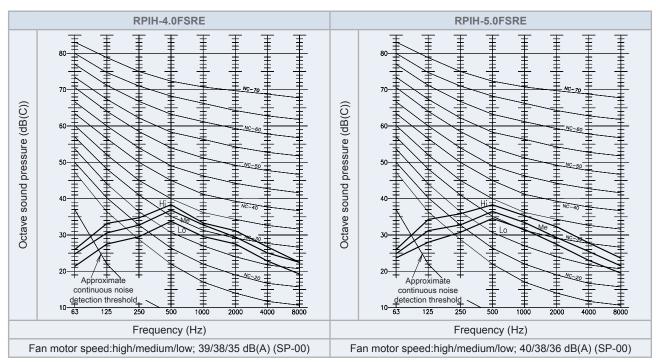


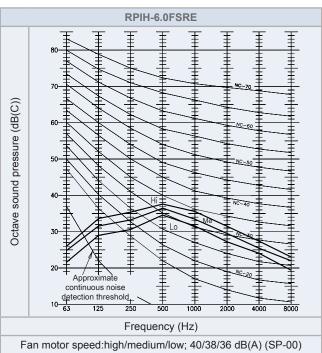

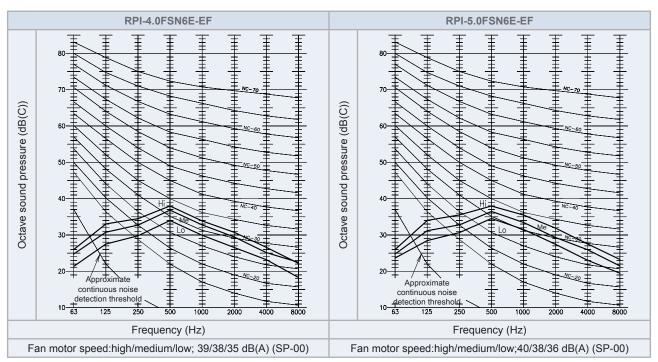


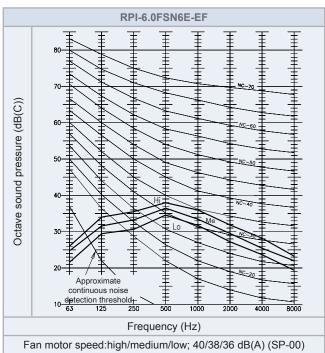


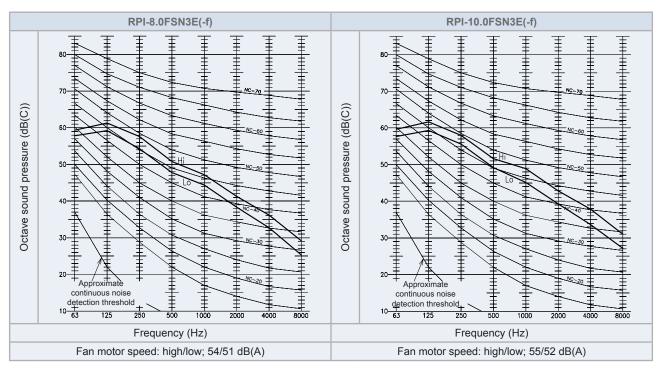


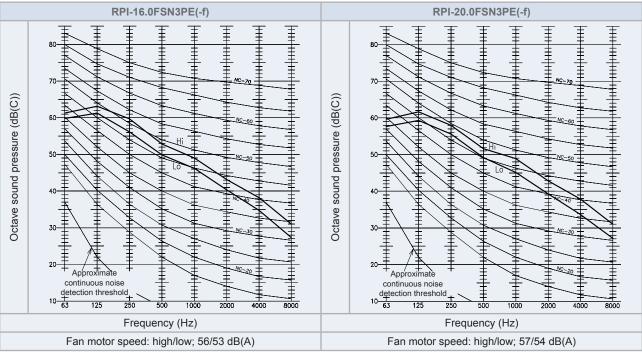



#### 5.2.6 RPK-(0.4-4.0)FSR(H)M - Wall type

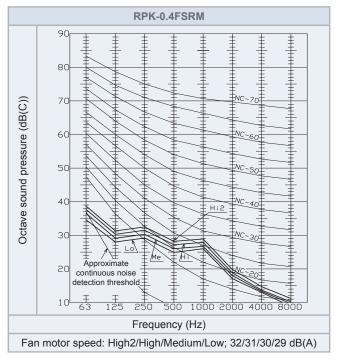


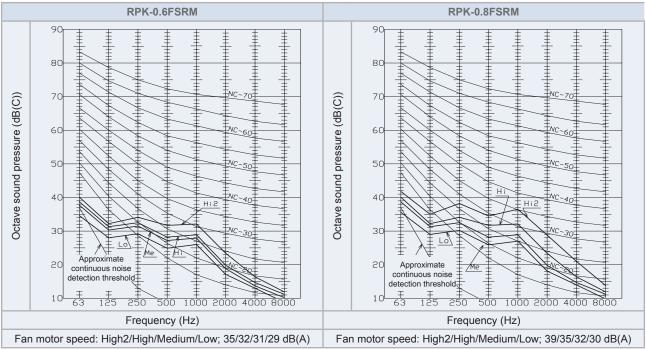


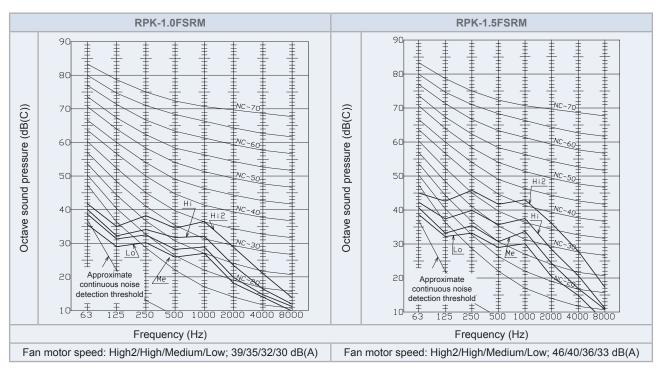


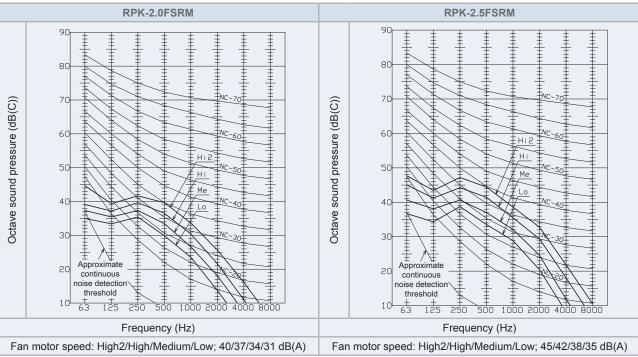

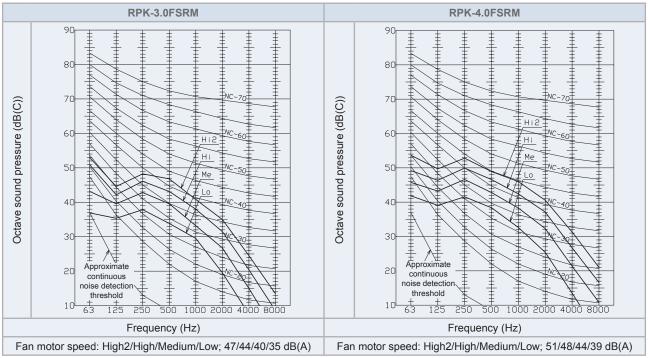


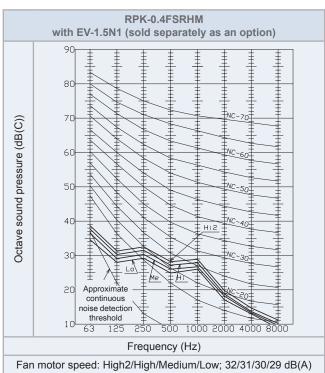


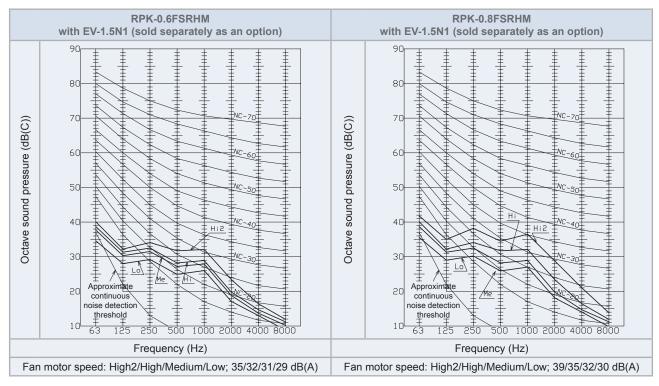

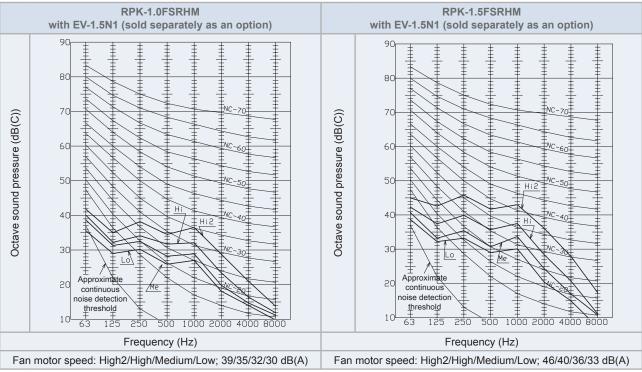



#### 5.2.7 RPF-(1.0-2.5)FSN2E - Floor type

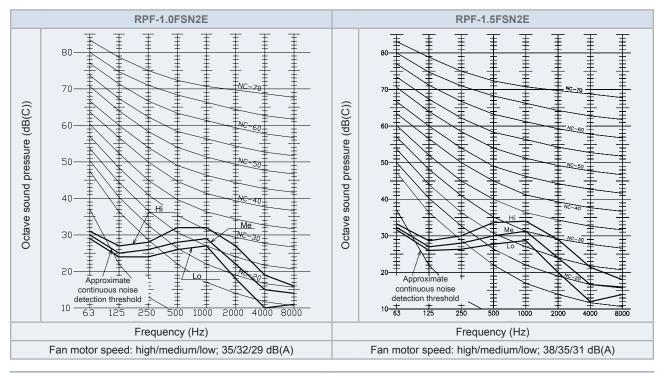

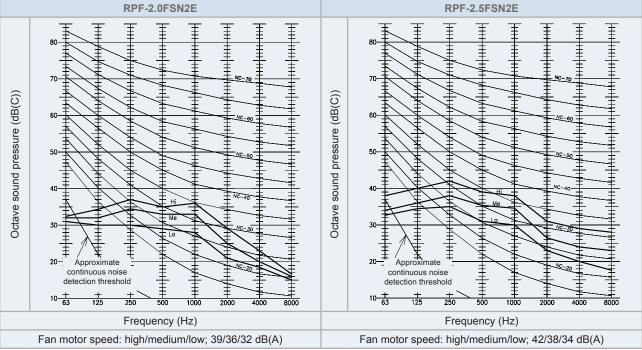


#### 5.2.8 RPFI-(1.0-2.5)FSN2E - Floor concealed type

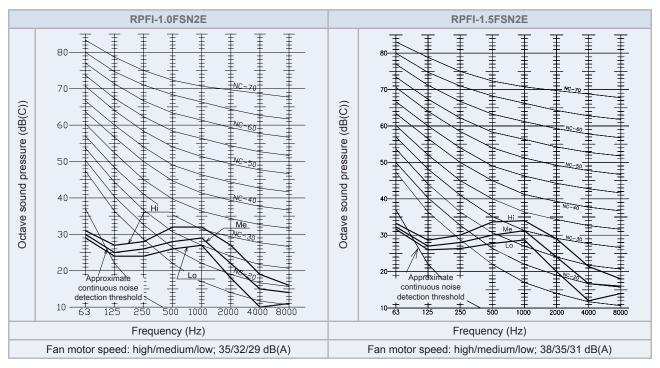


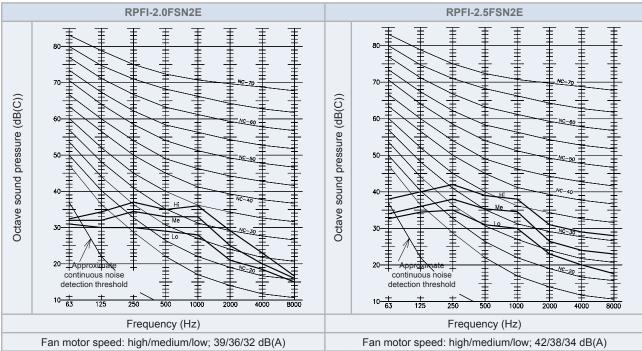


#### 5.2.9 KPI


#### 5.2.9.1 KPI energy recovery series

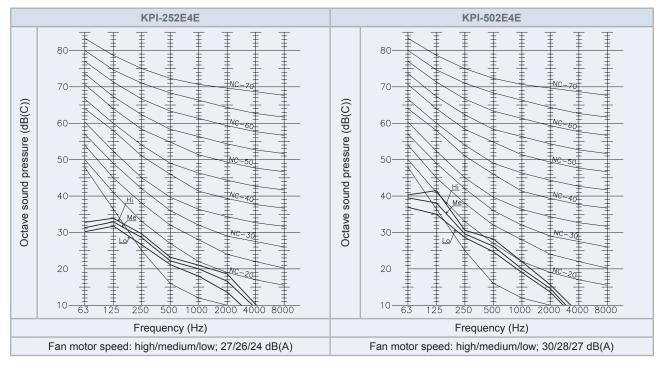


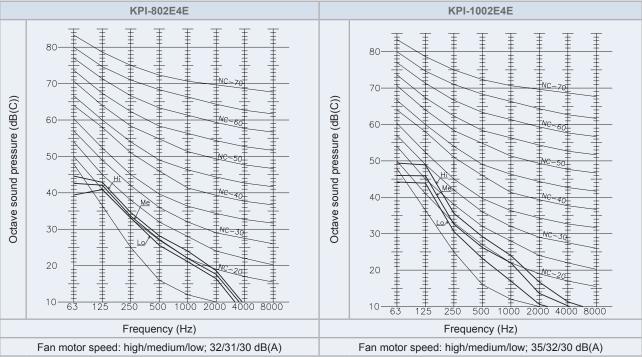

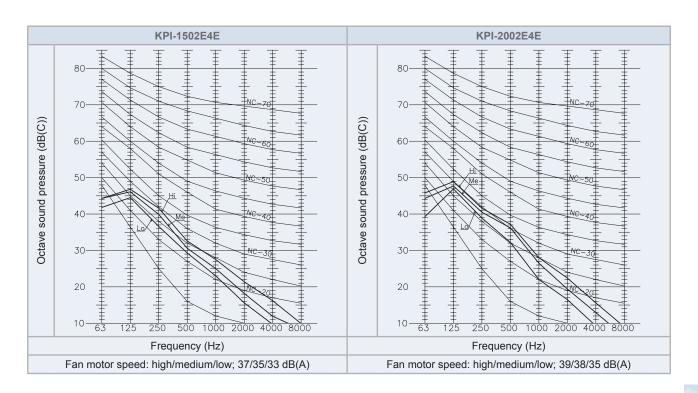


#### 5.2.9.2 KPI Active series

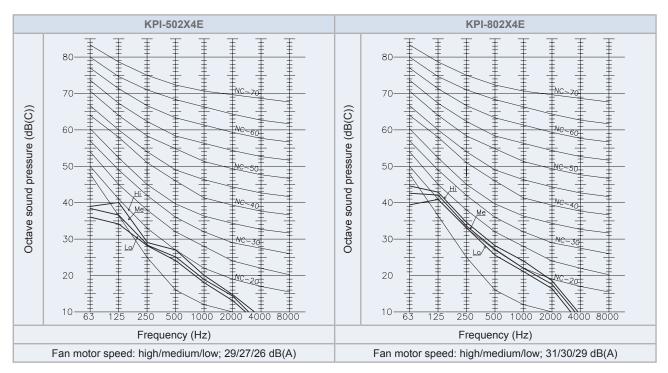


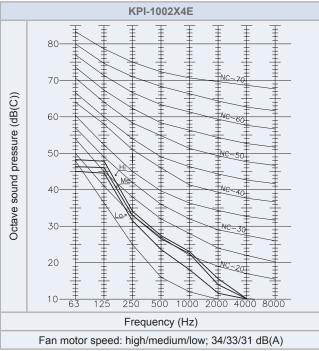



#### 5.3 Sound power


#### 5.3.1 RPI(L/H)-FSRE and RPI-FSN(3/6)(P)E-(-f/EF) - Indoor ducted unit

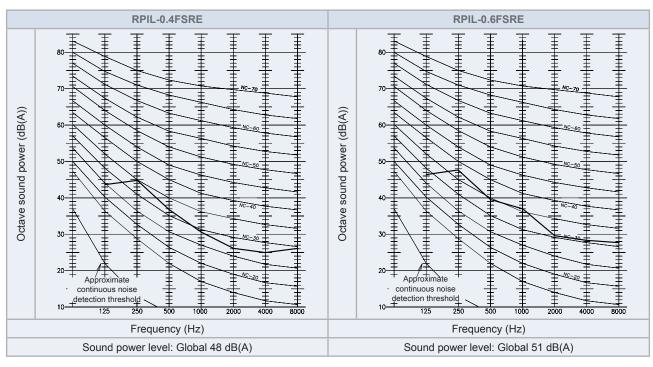


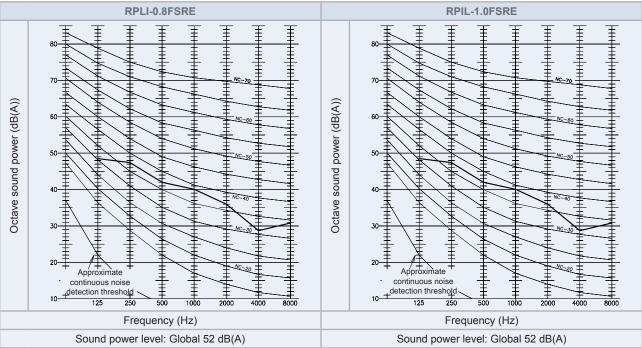


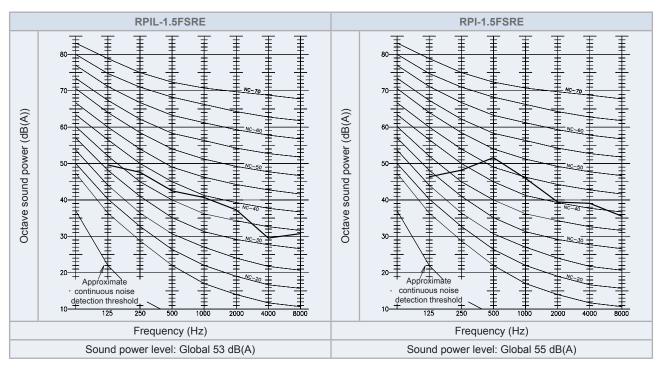


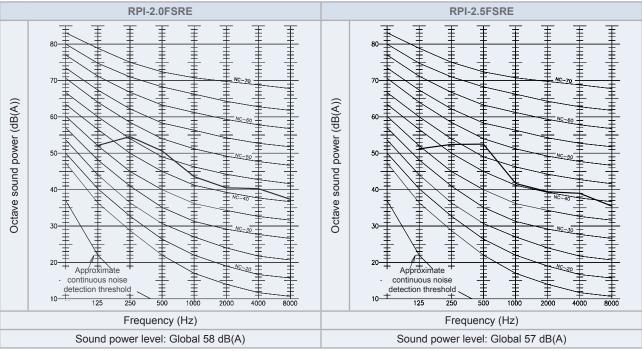


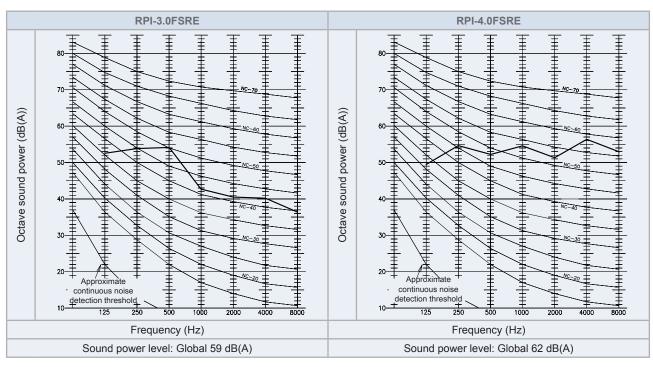


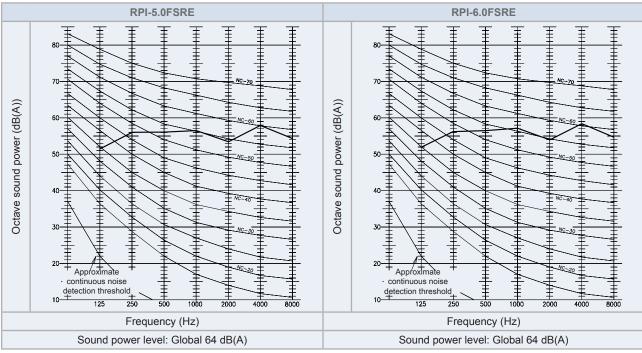

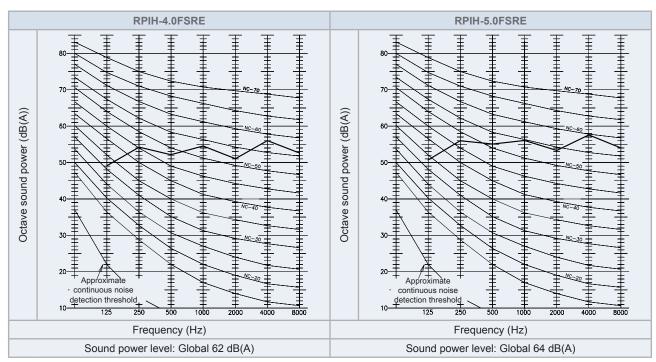

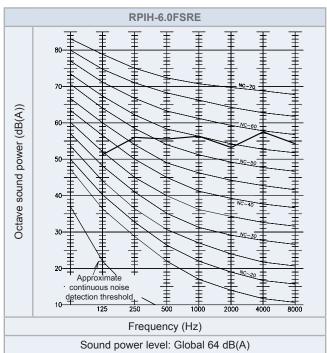

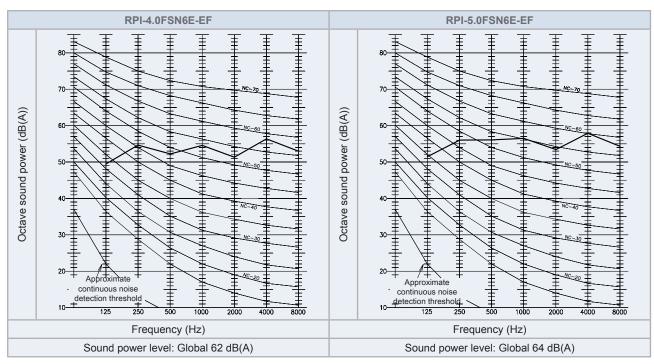

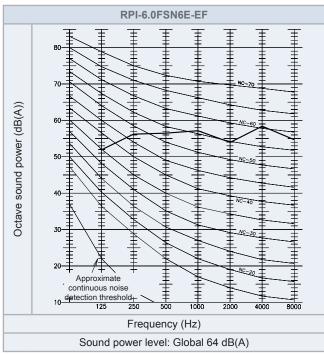

## 6. Working range

### Index

3.1	Working range	. 200
	6.1.1 Power supply	. 200
	6.1.2 Temperature range	. 200
	6.1.3 Relative Humidity limit	. 200
	6.1.4 DV Interface working range	204

#### 6.1 Working range

#### 6.1.1 Power supply

#### **Operating voltage**

Between 90 and 110% of the nominal voltage.

#### Start-up voltage

Over 85% of the nominal voltage.

#### **6.1.2 Temperature range**

The following table indicates the temperature range.

Mode		Cooling	Heating
Indoor temperature	Min.	21°C DB / 15°C WB	15°C DB
	Max.	32°C DB / 23°C WB(*)	27°C DB
Outdoor temperature	Min.	-5°C DB(*)	-10°C WB <sup>(*)</sup>
	Max.	46°C DB(*)	15°C WB <sup>(*)</sup>

<sup>(\*)</sup> The temperature may vary according to the outdoor unit. Consult the Technical Catalogue for outdoor units belonging to the systems UTOPIA or SET FREE.



- DB: dry bulb; WB: wet bulb
- In the case of light cooling load and low temperature suction air of the outdoor unit (lower than 10°C), the operation may stop by thermo-OFF to prevent of the indoor unit frost formation.


#### **6.1.3 Relative Humidity limit**


Lower than 80% (except RPI(L/H)-FSRE)

Lower than 77% (RPI(L/H)-FSRE only)

#### 6.1.4 DX Interface working range

#### ◆ For combinations with the UTOPIA and SET FREE series, the working range is as follows



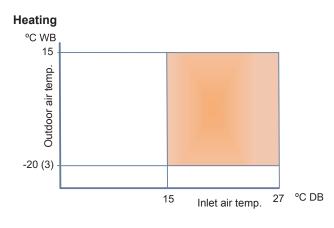





- The temperatures may vary according to the outdoor unit. Consult the Technical Catalogue for outdoor units belonging to the systems UTOPIA or SET FREE.
- (1) UTOPIA and SET FREE Mini: 46°C (DB); SET FREE modular and SET FREE side Flow: 43°C (DB)
- (2) SET FREE Mini in cooling mode: outdoor air temp up to 15°C (DB)
- (3) SET FREE side flow: -12°C (WB)
- · DB: dry bulb; WB: wet bulb
- Inlet air temperature is the point just before the DX-Coil
- The working ranges shown apply under the conditions and restrictions of use described for this product. For any item not covered in this documentation, please refer to the DX-Coil Indoor Units technical documentation.

#### ♦ Working range in applications with Air Handling Units (AHU)

The general working range has been extended in applications with Air Handling Units (AHU) as shown below, for the combination of DX-Interface Series 2 with the new outdoor units of the RAS-XH(V)NP(1)E series, focused on application in Air Handling Units (AHU).

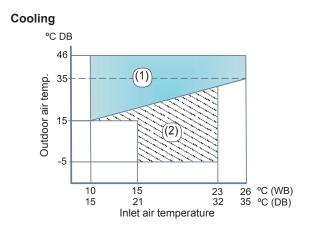

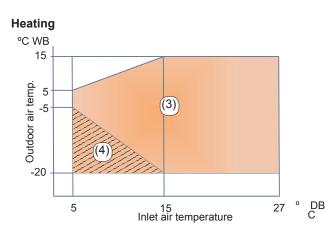



- (1) Air Handling unit in cooling mode in Toutdoor air ≥ Tinlet air working condition only.
- (2) Standard working range operation is allowed.
- (3) Air Handling unit in heating mode in Toutdoor air ≤ Tinlet air working condition only.
- (4) Minimum setting temperature (19°C) is not guaranteed in extreme working conditions. Outlet air might require additional treatment with a heating stage after DX-Coil in order to achieve comfort conditions.
- The working ranges shown apply under the conditions and restrictions of use described for this product. For any item not covered in this documentation, please refer to the Air Handling Unit Technical Documentations.

# 7. General dimensions


### Index


7.1	Dimensions	204
	7.1.1 RCI-(1.0-6.0)FSR - 4 way cassette	204
	7.1.2 RCIM-(0.4-2.5)FSRE - 4-way cassette (compact)	208
	7.1.3 RCD-(0.8-6.0)FSR - 2-way cassette	209
	7.1.4 RPC-(1.5-6.0)FSR - Ceiling type	211
	7.1.5 RPI(L/H)-(0.4-6.0)FSRE - Indoor ducted unit	214
	7.1.6 RPI-(4.0-6.0)FSN6E-EF - Indoor ducted unit for Econofresh assembly	219
	7.1.7 RPI-(8.0-20.0)FSN3(P)E(-f) - Indoor ducted unit for Econofresh assembly	220
	7.1.8 RPK-(0.4-4.0)FSRM / RPK-(0.4/1.5)FSRHM with expansion valve kit EV-1.5N1- Wall type	222
	7.1.9 RPF-(1.0-2.5)FSN2E - Floor type	226
	7.1.10 RPFI-(1.0-2.5)FSN2E - Floor concealed type	229
	7.1.11 KPI-(252-2002)(E/X)4E - Energy recovery and active energy recovery ventilation units	232
	7.1.12 DX-Interface	238
	7.1.13 Econofresh Kit	238
7.2	Operation and service space	239
	7.2.1 RCI-(1.0-6.0)FSR - 4-way cassette	239
	7.2.2 RCIM-(0.4-2.5)FSRE - 4-way cassette	240
	7.2.3 RCD-(0.8-6.0)FSR - 2-way cassette	241
	7.2.4 RPC-(1.5-6.0)FSR - Ceiling type	242
	7.2.5 RPI(L/H)-(0.4-6.0)FSRE - Indoor ducted unit	243
	7.2.6 RPI-(4.0-6.0)FSN6E-EF - Indoor ducted unit for Econofresh assembly	255
	7.2.7 RPI-(8.0-20.0)FSN3(P)E(-f) - Indoor ducted unit	257
	7.2.8 RPK-(0.4-4.0)FSR(H)M - Wall type	258
	7.2.9 RPF-(1.0-2.5)FSN2E - Floor type	260
	7.2.10 RPFI-(1.0-2.5)FSN2E - Floor concealed type	260
	7.2.11 KPI-(252-2002)(E/X)4E - Energy recovery and active energy recovery ventilation units	261
	7.2.12 DX-Interface	262
	7.2.13 Econofresh kit	262


#### 7.1 Dimensions


#### 7.1.1 RCI-(1.0-6.0)FSR - 4 way cassette


#### **♦** RCI-(1.0-2.5)FSR with panel P-N23NA2 / P-AP160KA3

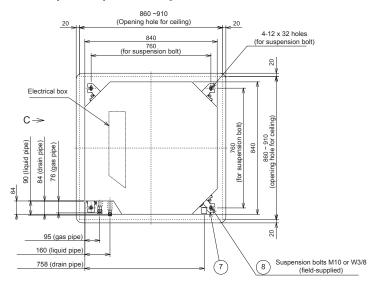















Nº	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut, (1.0/1.5/2.0): ø12.7, (2.5): ø15.88
4	Refrigerant connection (liquid)	Flare nut, (1.0/1.5/2.0): ø6.35, (2.5): ø9.52
5	Drain connection	ø32 (VP25)
6	Wiring hole	Die cut hole ø30
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch


- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.


#### ♦ RCI-(3.0-6.0)FSR with panel P-N23NA2 / P-AP160KA3

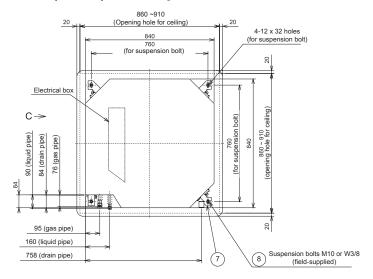











Viewed from C



Nº	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut. ø15,88
4	Refrigerant connection (liquid)	Flare nut. ø9.52
5	Drain connection	ø32 (VP25)
6	Wiring hole	Die cut hole. ø30
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch

- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.

#### ◆ RCI-(1.0-2.5)FSR with panel P-GP160NAP / P-GP160NAPU / P-GP160KAP

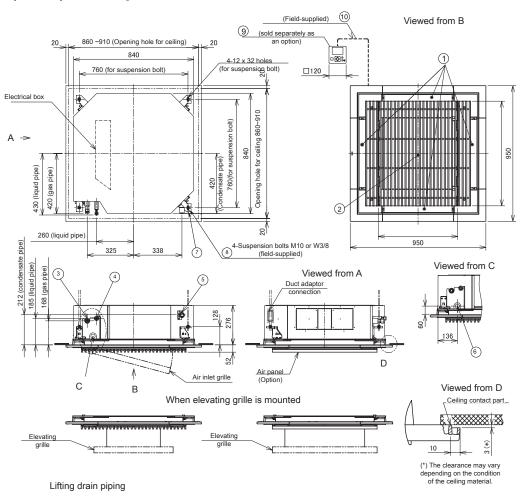




Nº	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut, (1.0/1.5/2.0): ø12.7, (2.5): ø15.88
4	Refrigerant connection (liquid)	Flare nut, (1.0/1.5/2.0): ø6.35, (2.5): ø9.52
5	Drain connection	ø32 (VP25)
6	Wiring hole	Die cut hole ø30
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch

## i NOTE

- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.

#### RCI-(3.0-6.0)FSR with panel P-GP160NAP / P-GP160NAPU / P-GP160KAP

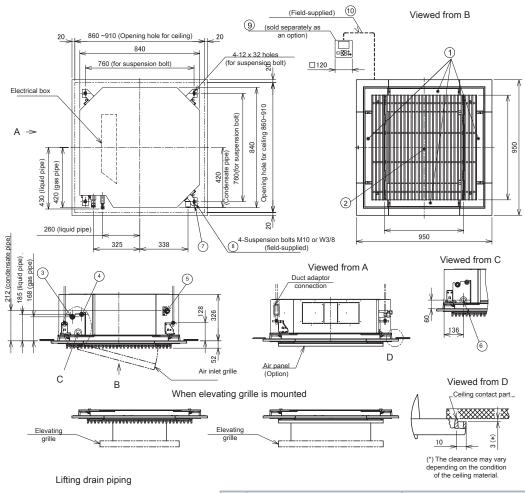




Nº	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut. ø15,88
4	Refrigerant connection (liquid)	Flare nut. ø9.52
5	Drain connection	ø32 (VP25)
6	Wiring hole	Die cut hole. ø30
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch

- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.

#### 7.1.2 RCIM-(0.4-2.5)FSRE - 4-way cassette (compact)

#### RCIM-(0.4-2.5)FSRE with panel P-AP56NAM / P-AP56NAMS / P-AP56NAMR

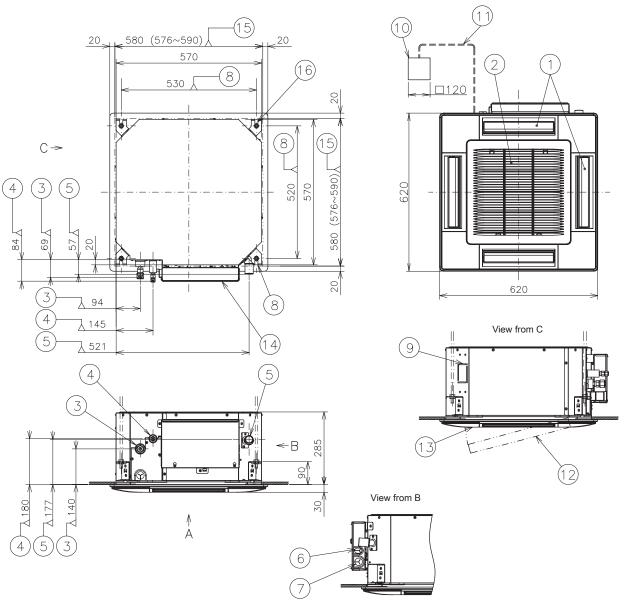



Nº	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas line)	Flare nut, (0.4/0.6/0.8/1.0/1.5/2.0 HP): ø12.7, (2.5 HP): ø15.88
4	Refrigerant connection (liquid line)	Flare nut, (0.4/0.6/0.8/1.0/1.5/2.0 HP): ø6.35, (2.5 HP): ø9.52
5	Drain connection	ø32 (VP25)
6	Wiring hole for air panel and motion sensor cables	ø20
7	Wiring hole for the cables for power source, communication, controller, optional wire controller	ø30
8	Unit suspension bolt	(4x) M10 or W3/8 (field supplied)
9	Fresh air intake position (Duct adapter connection)	100 x 100 knockout hole
10	Wired Remote Control Switch	Sold separately as an option
11	Shielded Twist-Pair Cable	For Remote Control Switch (field supplied)
12	Air inlet grille	
13	Air panel	Sold separately as an option (Required)
14	Electrical control box	
15	Opening hole for ceiling	
16	Hole for suspension bolt	4 - 12

- Distance between the wall and panel edge must be a min.1500mm to prevent short circuiting.
- All measurements are in mm.

#### 7.1.3 RCD-(0.8-6.0)FSR - 2-way cassette

#### RCD-(0.8-3.0)FSR - with Air panel P-AP90DNA

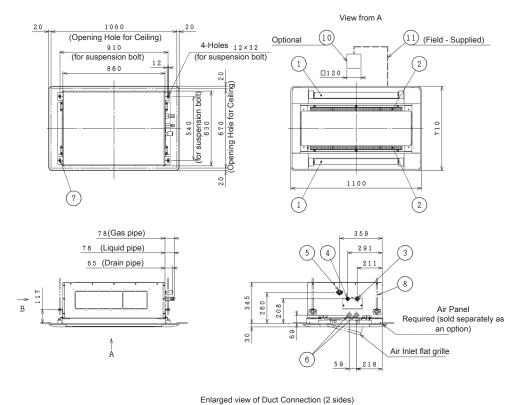

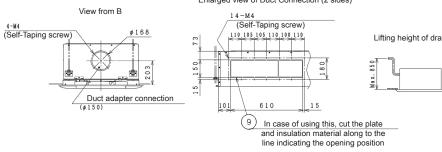


ain	Dimension	а	b
1	0.8	12.7	6.35
Janua .	1.0	12.7	6.35
	1.5	12.7	6.35
	2.0	12.7	6.35
	2.5	15.88	9.52
	3.0	15.88	9.52

Number	Description	Remarks
1	Air Outlet	2-Way
2	Air Inlet	
3	Refrigerant Gas Pipe Connection	with øa Flare Nut
4	Refrigerant Liquid Pipe Connection	with øb Flare Nut
5	Drain Pipe Connection	VP25
6	Wiring Hole	ø26 Hole
7	Suspension Bracket	
8	Suspension Bolt	4-M10 or W3/8
9	Supply Duct Connection	2-150 x 610
10	Remote Control Switch (PC-ARFP1E)	Sold separately as an option
11	Shielded Twist-Pair Cable for PC-ARFP1E	Min 0.75mm <sup>2</sup> . Field-Supplied

- Distance between the wall and panel edge must be a min.1500mm to prevent short circuiting.
- All measurements are in mm.

#### ◆ RCD-(4.0/6.0)FSR with Air panel P-AP160DNA

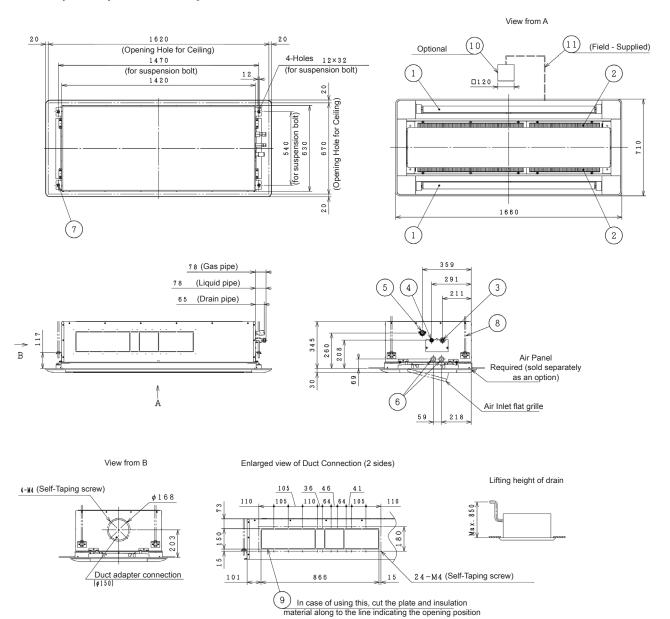


Number	Description	Remarks
1	Air Outlet	2-Way
2	Air Inlet	
3	Refrigerant Gas Pipe Connection	with ø15.88 Flare Nut
4	Refrigerant Liquid Pipe Connection	with ø9.52 Flare Nut
5	Drain Pipe Connection	VP25
6	Wiring Hole	ø26 Hole
7	Suspension Bracket	
8	Suspension Bolt	4-M10 or W3/8
9	Supply Duct Connection	2-150 x 866
10	Remote Control Switch (PC-ARFP1E)	Sold separately as an option
11	Shielded Twist-Pair Cable for PC-ARFP1E	Min 0.75mm². Field-Supplied

- Distance between the wall and panel edge must be a min.1500mm to prevent short circuiting.
- All measurements are in mm.

## 7.1.4 RPC-(1.5-6.0)FSR - Ceiling type


## ♦ RPC-(1.5/2.0)FSR - Ceiling type

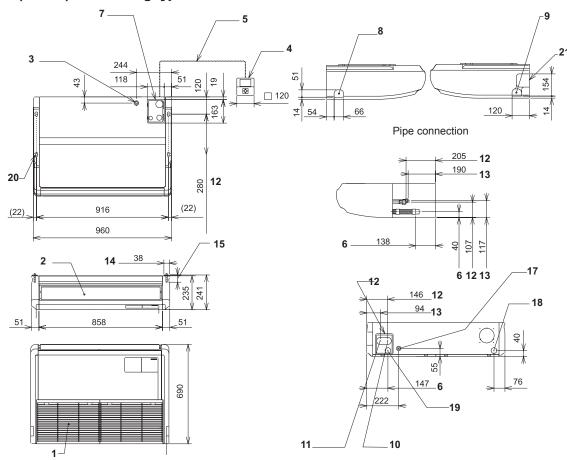

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Cable connection hole of upper side	
4	Remote Control Switch PC-ARFP1E	Sold separately as an option
5	Twist Pair Cable	Min 0.75 mm² (Field Supplied)
6	Drain Pipe	
7	Pipe through cover of upper side	
8	Connection hole of left side drain pipe	(Knockout-hole)
9	Connection hole of right side drain pipe	(Knockout-hole)
10	Refrigerant connection (liquid)	Flare nut ø6.35
11	Refrigerant connection (gas)	RPC-1.5FSR: Flare nut ø12.7 / RPC-2.0FSR: Flare nut ø15.88
12	Gas pipe	
13	Liquid pipe	
14	Unit suspension bracket	
15	Suspension bolt length	Max 50 mm <sup>2</sup>
16	Pipe through cover of rear side	
17	Cable connecting hole of rear side	
18	Drain pipe connecting hole	(VP20) In case of left side drain
19	Drain pipe connecting hole	(VP20) In case of right side drain
20	For suspension bolt	4-12 x 32 holes
21	Pipe through cover of right side	




#### ◆ RPC-(2.5-3.0)FSR - Ceiling type

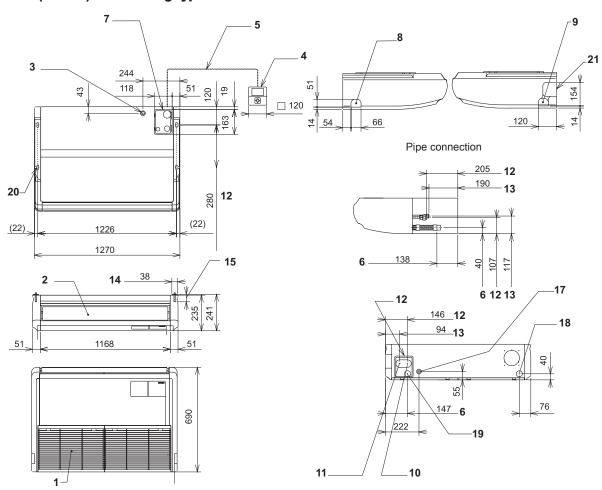

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Cable connection hole of upper side	
4	Remote Control Switch PC-ARFP1E	Sold separately as an option
5	Twist Pair Cable	Min 0.75 mm² (Field Supplied)
6	Drain Pipe	
7	Pipe through cover of upper side	
8	Connection hole of left side drain pipe	(Knockout-hole)
9	Connection hole of right side drain pipe	(Knockout-hole)
10	Refrigerant connection (liquid line)	Flare nut ø9.52
11	Refrigerant connection (gas line)	Flare nut ø15.88
12	Gas pipe	
13	Liquid pipe	
14	Unit suspension bracket	
15	Suspension bolt length	Max 50 mm <sup>2</sup>
16	Pipe through cover of rear side	
17	Cable connecting hole of rear side	
18	Drain pipe connecting hole	(VP20) In case of left side drain
19	Drain pipe connecting hole	(VP20) In case of right side drain
20	For suspension bolt	4-12 x 32 holes
21	Pipe through cover of right side	



#### ◆ RPC-(4.0/5.0/6.0)FSR - Ceiling type

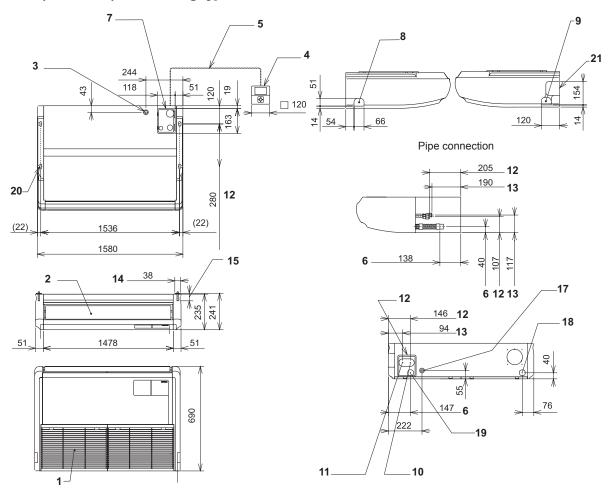



Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Cable connection hole of upper side	
4	Remote Control Switch PC-ARFP1E	(Optional)
5	Twist Pair Cable	Min 0.75 mm² (Field Supplied)
6	Drain Pipe	
7	Pipe through cover of upper side	
8	Connection hole of left side drain pipe	(Knockout-hole)
9	Connection hole of right side drain pipe	(Knockout-hole)
10	Refrigerant connection (liquid line)	Flare nut ø9.52
11	Refrigerant connection (gas line)	Flare nut ø15.88
12	Gas pipe	
13	Liquid pipe	
14	Unit suspension bracket	
15	Suspension bolt length	Max 50 mm <sup>2</sup>
16	Pipe through cover of rear side	
17	Cable connecting hole of rear side	
18	Drain pipe connecting hole	(VP20) In case of left side drain
19	Drain pipe connecting hole	(VP20) In case of right side drain
20	For suspension bolt	4-12 x 32 holes
21	Pipe through cover of right side	





#### 7.1.5 RPI(L/H)-(0.4-6.0)FSRE - Indoor ducted unit


#### ◆ RPIL-(0.4-1.5)FSRE - Indoor ducted unit





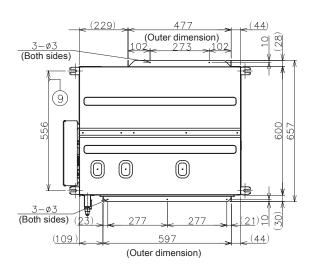

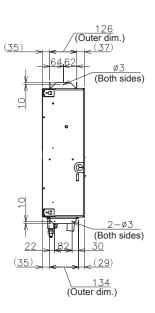





XEKS1990


Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø12.7 (½)
4	Refrigerant connection (liquid line)	Flare nut. ø6.35 (¼)
5	Condensate drain piping	ø32 (inner diameter)
7	Electrical box	
8	Wiring connections	
9	Suspension brackets	(4 locations)





#### ◆ RPI-(1.5-2.0)FSRE - Indoor ducted unit

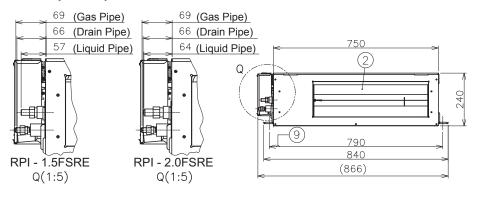










XEKS1991

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø12.7 (½)
4	Refrigerant connection (liquid line)	Flare nut. ø6.35 (¼)
5	Condensate drain piping	ø32 (inner diameter)
7	Electrical box	
8	Wiring connections	
9	Suspension brackets	(4 locations)




#### ◆ RPI-(2.5-3.0)FSRE - Indoor ducted unit

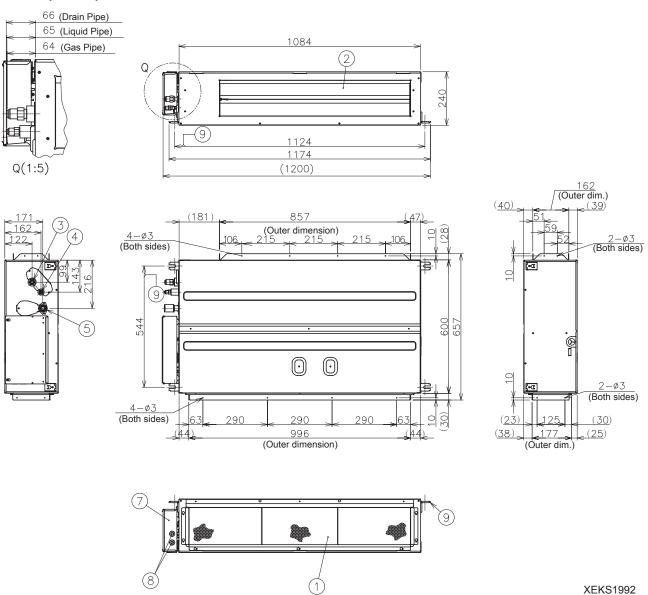



Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø15.88 (5%)
4	Refrigerant connection (liquid line)	Flare nut. ø9.52 (%)
5	Condensate drain piping	ø32 (inner diameter)
7	Electrical box	
8	Wiring connections	
9	Suspension brackets	(4 locations)




#### ◆ RPI-(4.0-6.0)FSRE - Indoor ducted unit

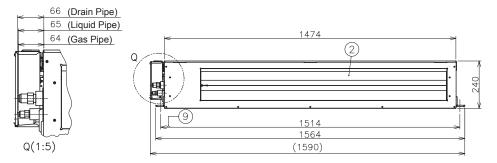

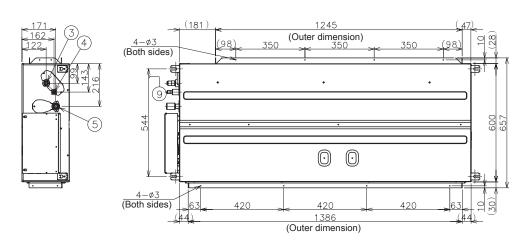





XEKS1993

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø15.88 (%)
4	Refrigerant connection (liquid line)	Flare nut. ø9.52 (%)
5	Condensate drain piping	ø32 (inner diameter)
7	Electrical box	
8	Wiring connections	
9	Suspension brackets	(4 locations)





(39)


2-ø3 (Both sides)

 $\frac{2-\emptyset \Im}{\text{(Both sides)}}$ 

#### ◆ RPIH-(4.0-6.0)FSRE - Indoor ducted unit

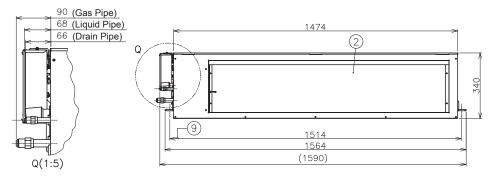

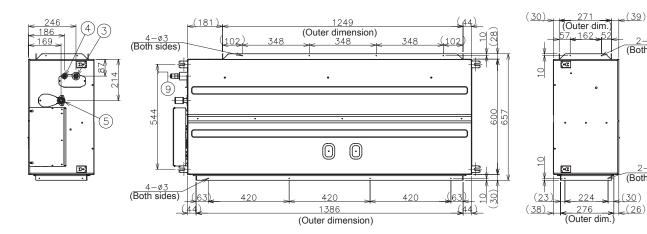





XEKS1994


Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø15.88 (%)
4	Refrigerant connection (liquid line)	Flare nut. ø12.7 (½)
5	Condensate drain piping	ø32 (inner diameter)
7	Electrical box	
8	Wiring connections	
9	Suspension brackets	(4 locations)




#### 7.1.6 RPI-(4.0-6.0)FSN6E-EF - Indoor ducted unit for Econofresh assembly

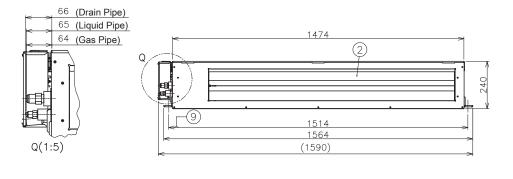

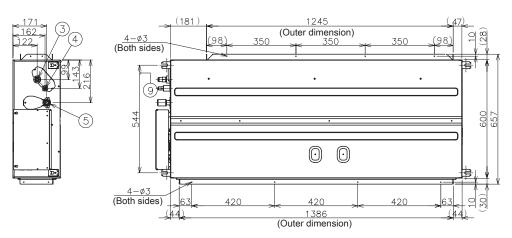






XEKS1993

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø15.88 (5%)
4	Refrigerant connection (liquid line)	Flare nut. ø9.52 (%)
5	Condensate drain piping	ø32 (inner diameter)
7	Electrical box	
8	Wiring connections	
9	Suspension brackets	(4 locations)



## 7.1.7 RPI-(8.0-20.0)FSN3(P)E(-f) - Indoor ducted unit for Econofresh assembly


#### ◆ RPI-(8.0/10.0)FSN3E(-f) - Indoor ducted unit

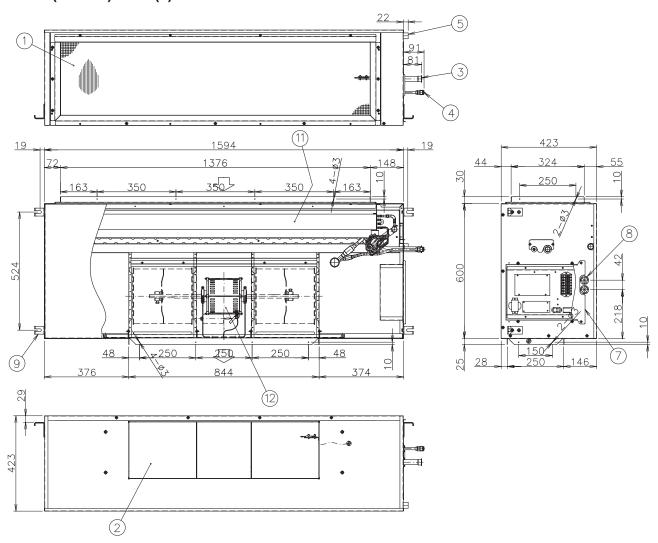

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	ø19.05 RPI-(8.0), ø22.2 RPI-(10.0)
4	Refrigerant connection (liquid line)	Flare nut. ø9.52 RPI-(8.0/10.0)
5	Drain connection	ø25 (outer diameter)
7	Electrical box	
8	Wiring hole	
9	Unit suspension bracket	(4x)
11	Heat Exchanger	
12	Fan motor	



#### ◆ RPI-(16.0/20.0)FSN3PE(-f) - Indoor ducted unit

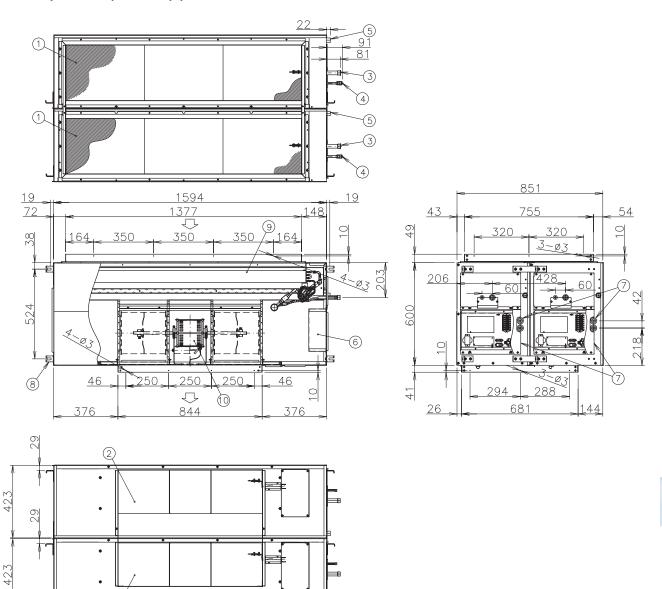

XEKS1630


Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	ø19.05 RPI-(16.0), ø22.2 RPI-(20.0)
4	Refrigerant connection (liquid line)	Flare nut. ø9.52 RPI-(16.0/20.0)
5	Drain connection	ø25 (outer diameter)
6	Electrical box	
7	Wiring Connection	ø25x4
8	Unit suspension bracket	(8 Locations)
9	Heat Exchanger	
10	Fan motor	

All measurements are in mm.

**Ø** 


## 7.1.8 RPK-(0.4-4.0)FSRM / RPK-(0.4/1.5)FSRHM with expansion valve kit EV-1.5N1- Wall type

#### ◆ RPK-(0.4-1.0)FSR(H)M - Wall type

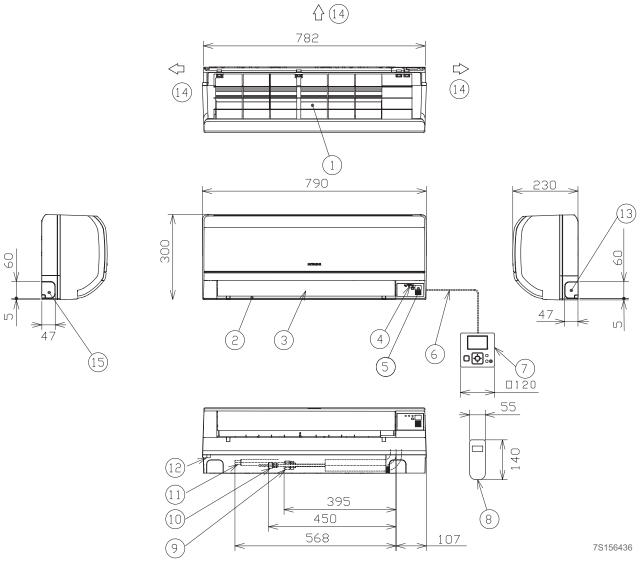

Number	Description	Number	Description
1	Air Inlet	10	Refrigerant connection (liquid line) (6.35 mm)
2	Air Outlet	11	Drain Pipe Connection (VP16)
3	Auto lover	12	Drain Pipe Connection (left side)
4	Display part	13	Wiring and piping hole (right side)
5	IR receiver part (included on indoor units as standard)	4.4	Piping installation: back side, right side, bottom side,
6	Twisted pair cable (0.75 mm²) (field supplied)	14	or left side
7	Wired remote control switch (sold separately)	15	Wiring and piping hole (left side)
8	Wireless remote control switch (sold separately)		
9	Refrigerant connection (gas line) (12.7 mm)	]	




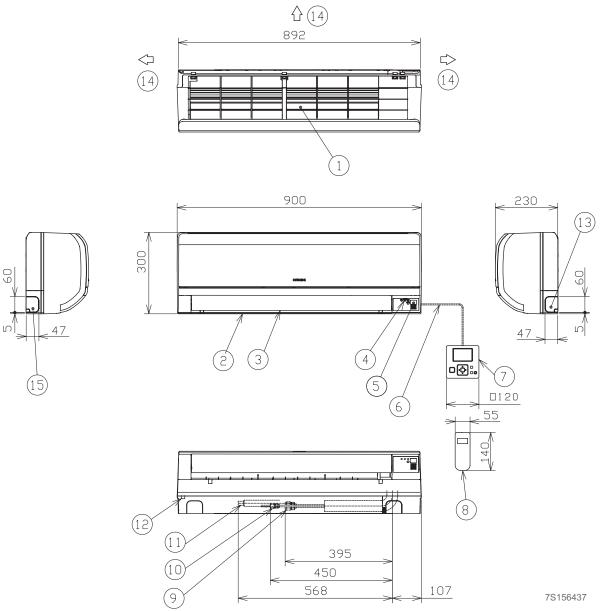

Number	Description	Number	Description
1	Air Inlet	10	Refrigerant connection (liquid line) (6.35 mm)
2	Air Outlet	11	Drain Pipe Connection (VP16)
3	Auto lover	12	Drain Pipe Connection (left side)
4	Display part	13	Wiring and piping hole (right side)
5	IR receiver part (included on indoor units as standard)	14	Piping installation: back side, right side, bottom side, or left side
6	Twisted pair cable (0.75 mm²) (field supplied)	14	
7	Wired remote control switch (sold separately)	15	Wiring and piping hole (left side)
8	Wireless remote control switch (sold separately)		
9	Refrigerant connection (gas line) (12.7 mm)		




#### ◆ RPK-(2.0-4.0)FSRM - Wall type

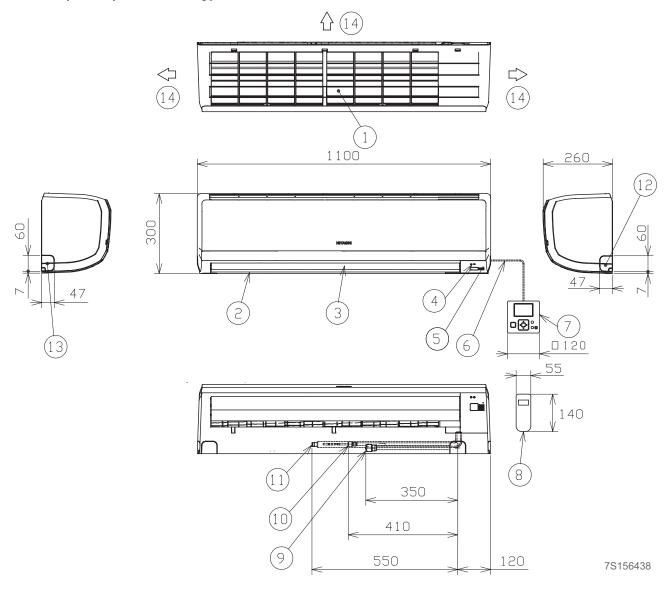

Number	Description	Number	Description
1	Air Inlet	10	Refrigerant connection (liquid line) (2 HP: 6.35 mm / 2.5~4.0HP: 9.52 mm)
2	Air Outlet	11	Drain Pipe Connection (VP16)
3	Auto lover	12	Wiring and piping hole (right side)
4	Display part	13	Wiring and piping hole (left side)
5	IR receiver part (included on indoor units as standard)	14	Piping installation: back side, right side, bottom side, or left side
6	Twisted pair cable (0.75 mm²) (field supplied)	14	
7	Wired remote control switch (sold separately)		
8	Wireless remote control switch (sold separately)		
9	Refrigerant connection (gas line) (2HP: 12.7 mm / 2.5~4.0HP: 15.88 mm)		



#### **♦** Expansion valve kit EV-1.5N1

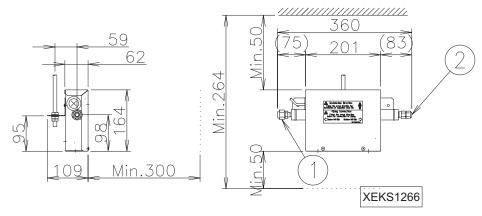


Number	Description	Remarks
1	Refrigerant liquid pipe connection (indoor unit side)	With ø9.52 flare nut
2	Refrigerant liquid pipe connection (outdoor unit side)	With ø6.35 flare nut




## 7.1.9 RPF-(1.0-2.5)FSN2E - Floor type

#### ♦ RPF-1.0FSN2E - Floor type

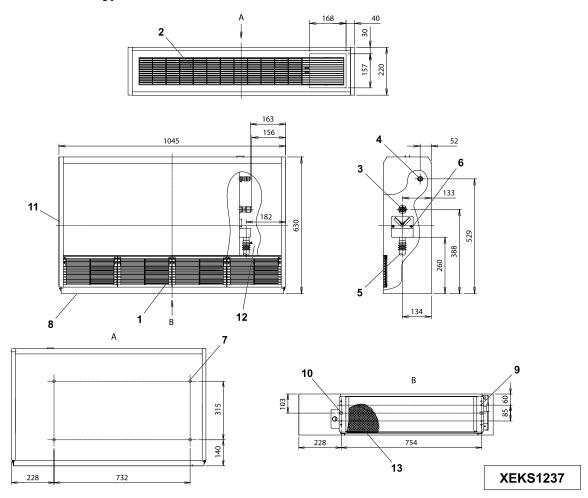

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø12.7
4	Refrigerant connection (liquid line)	Flare nut. ø6.35
5	Drain connection	
6	Drain pan	
7	Holes to fix the unit to the wall	(4x) ø14 (behind)
8	Adjusting screw	For the installation
9	Holes to fix the unit to the floor	(4x) ø7, bolts for wood (4x) M5
10	Holes to fix the unit to the floor	(2x) ø12.5x18, bolts (2x) M8
11	Wiring hole	Left-hand side
12	Space for pipe connection	Right-hand side
13	Filter	




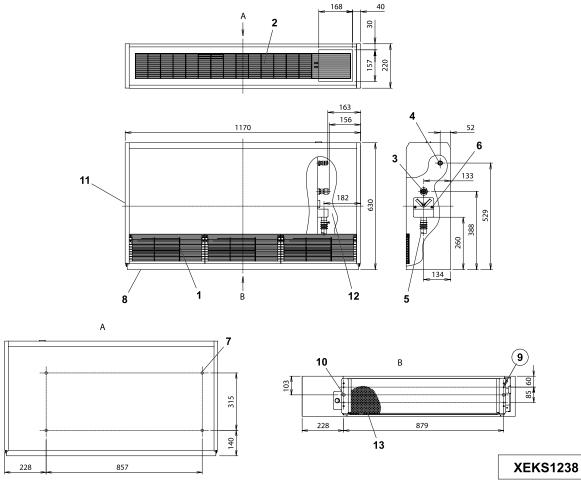

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø12.7
4	Refrigerant connection (liquid line)	Flare nut. ø6.35
5	Drain connection	
6	Drain pan	
7	Holes to fix the unit to the wall	(4x) Ø14 (behind)
8	Adjusting screw	For the installation
9	Holes to fix the unit to the floor	(4x) ø7, bolts for wood (4x) M5
10	Holes to fix the unit to the floor	(2x) ø12.5x18, bolts (2x) M8
11	Wiring hole	Left-hand side
12	Space for pipe connection	Right-hand side
13	Filter	



#### **♦** RPF-(2.0/2.5)FSN2E - Floor type

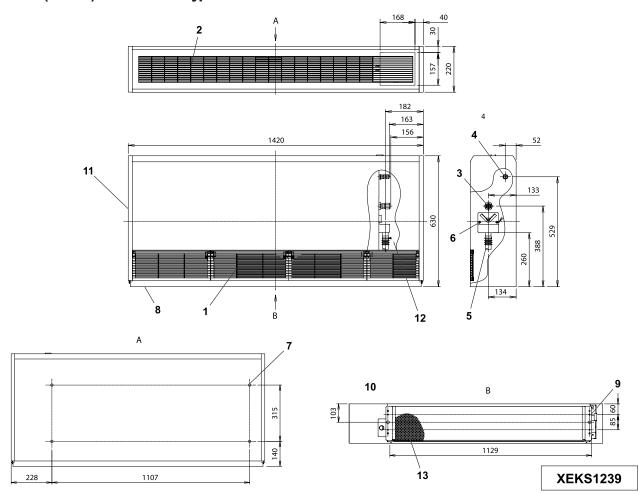


Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø15.88
4	Refrigerant connection (liquid line)	Flare nut. ø6.35 RPF-(2.0), ø9.52 RPF-(2.5)
5	Drain connection	
6	Drain pan	
7	Holes to fix the unit to the wall	(4x) Ø14 (behind)
8	Adjusting screw	For the installation
9	Holes to fix the unit to the floor	(4x) ø7, bolts for wood (4x) M5
10	Holes to fix the unit to the floor	(2x) ø12.5x18, bolts (2x) M8
11	Wiring hole	Left-hand side
12	Space for pipe connection	Right-hand side
13	Filter	



## 7.1.10 RPFI-(1.0-2.5)FSN2E - Floor concealed type


#### **♦ RPFI-1.0FSN2E - Floor concealed type**

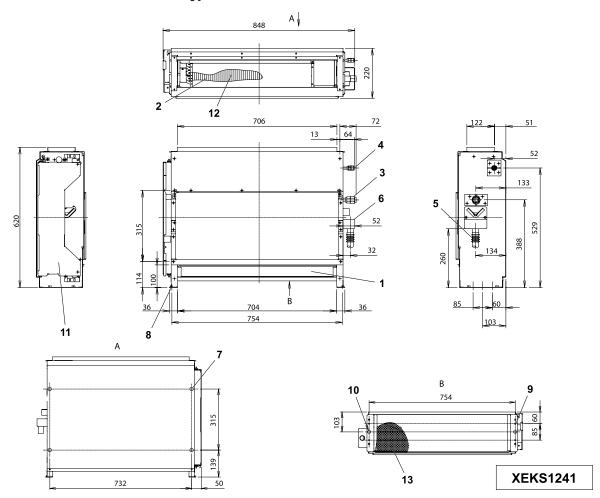

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø12.7
4	Refrigerant connection (liquid line)	Flare nut. ø6.35
5	Drain connection	
6	Drain pan	
7	Holes to fix the unit to the wall	(4x) ø14 (behind)
8	Adjusting screw	For the installation
9	Holes to fix the unit to the floor	(4x) ø7, bolts for wood (4x) M5
10	Holes to fix the unit to the floor	(2x) ø12.5x18, bolts (2x) M8
11	Electrical box	
12	Evaporator	
13	Filter	




#### **♦ RPFI-1.5FSN2E - Floor concealed type**

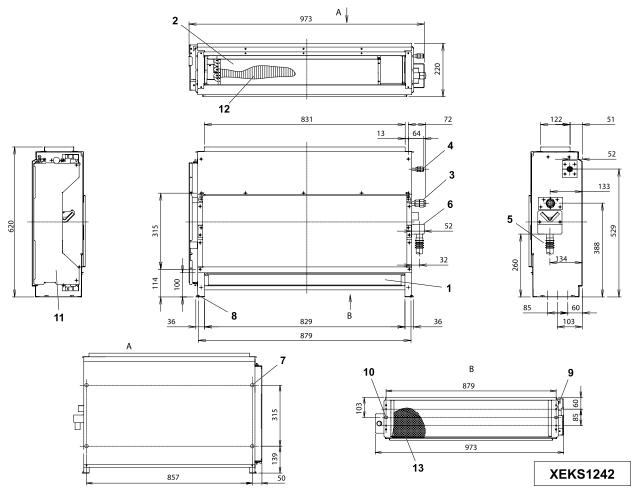

Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø12.7
4	Refrigerant connection (liquid line)	Flare nut. ø6.35
5	Drain connection	
6	Drain pan	
7	Holes to fix the unit to the wall	(4x) ø14 (behind)
8	Adjusting screw	For the installation
9	Holes to fix the unit to the floor	(4x) ø7, bolts for wood (4x) M5
10	Holes to fix the unit to the floor	(2x) ø12.5x18, bolts (2x) M8
11	Electrical box	
12	Evaporator	
13	Filter	



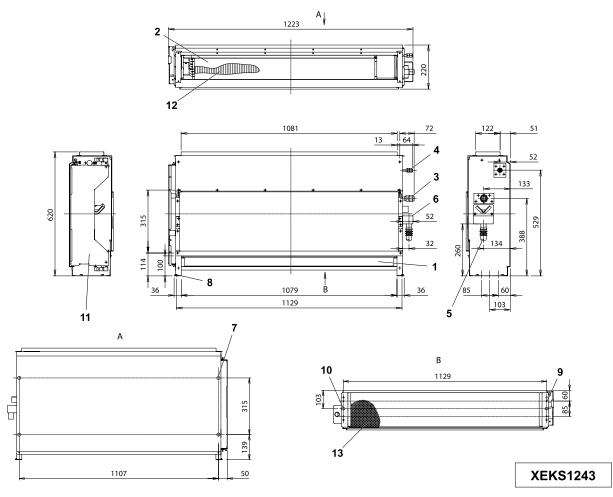



Number	Description	Remarks
1	Air inlet	
2	Air outlet	
3	Refrigerant connection (gas line)	Flare nut. ø15.88
4	Refrigerant connection (liquid line)	Flare nut. ø6.35 RPFI-(2.0), ø9.52 RPFI-(2.5)
5	Drain connection	
6	Drain pan	
7	Holes to fix the unit to the wall	(4x) ø14 (behind)
8	Adjusting screw	For the installation
9	Holes to fix the unit to the floor	(4x) ø7, bolts for wood (4x) M5
10	Holes to fix the unit to the floor	(2x) ø12.5x18, bolts (2x) M8
11	Electrical box	
12	Evaporator	
13	Filter	

# i NOTE

# 7.1.11 KPI-(252-2002)(E/X)4E - Energy recovery and active energy recovery ventilation

#### ♦ KPI-252E4E - Energy recovery unit

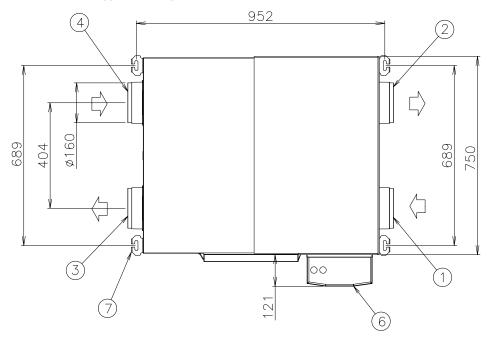

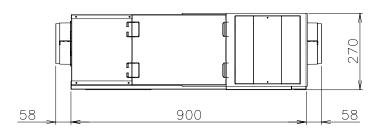


XEKS1535 r1

Number	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)

i NOTE

## ♦ KPI-(502-802)E4E - Energy recovery unit

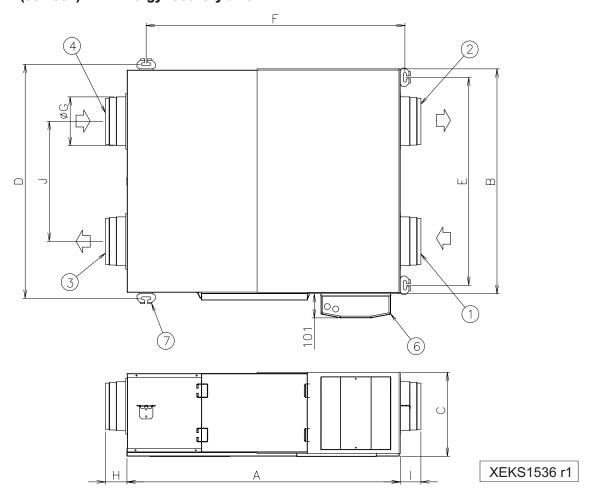


Number	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)

Models	Α	В	С	D	Е	F	G	Н	I	J
KPI-502E4E	1130	920	330	972	864	1075	200	90	85	499
KPI-802E4E	1210	1015	385	1066	954	1165	250	90	85	589




## ♦ KPI-(1002-2002)E4E - Energy recovery unit

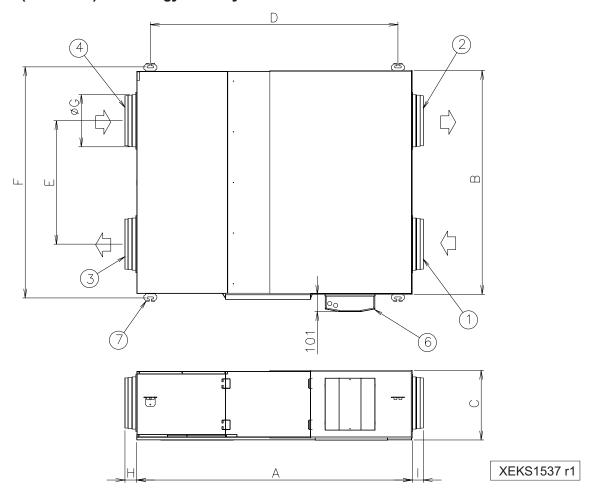

Number	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)

Models	Α	В	С	D	Е	F	G	Н	I
KPI-1002E4E	1600	1295	385	1442	719	1346	300	68	64
KPI-1502E4E	1800	1130	525	1622	623	1180	355	90	85
KPI-2002E4E	1800	1430	525	1622	921	1480	355	90	85




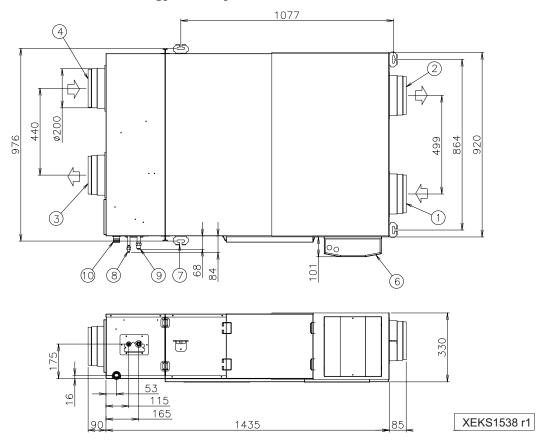

Number	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)




#### **♦ KPI-802X4E - Active energy recovery ventilation units**

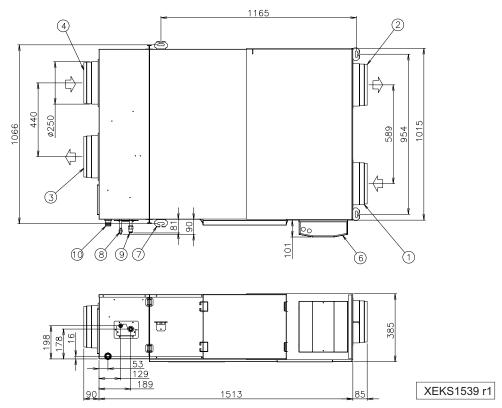


Number	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)



#### **♦ KPI-1002X4E - Active energy recovery ventilation units**

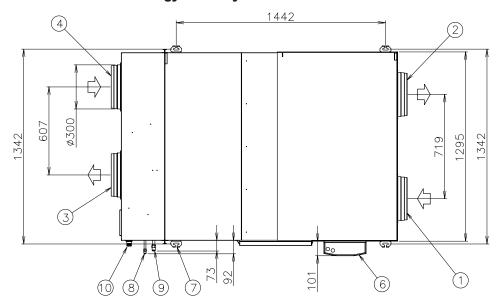


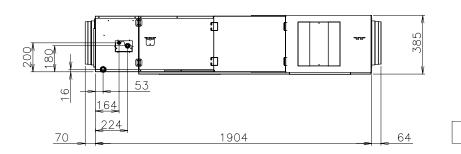


XEKS1540 r1

Number	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)

#### 7.1.12 DX-Interface







(\*) For installation.

All measurements are in mm.

#### 7.1.13 Econofresh Kit

#### ♦ Econofresh kit EF-456N1E

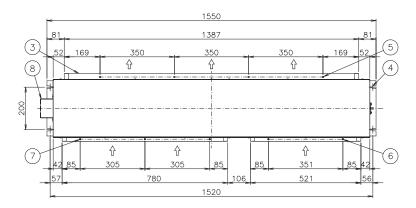

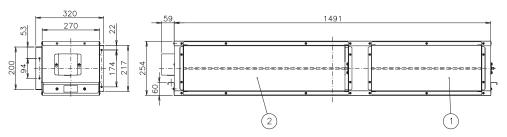

Number	Description	Remarks
1	Air inlet	Outdoor air
2	Air inlet	Return air
3	Air outlet	
4	Holes for suspension bolt	(4x) ø12
5	Holes for unit connection	(12x) ø7
6	Holes for outdoor duct connection	(8x) ø7
7	Holes for return duct connection	(10x) ø7
8	Cover protection for motor	

#### 7.2 Operation and service space


#### 7.2.1 RCI-(1.0-6.0)FSR - 4-way cassette

#### **♦** Operation space

Single installation 200 λ >1500 >1500

1500


Combined installation

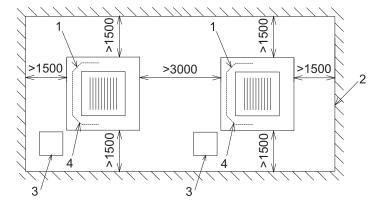

# i NOTE

- 1 Drain piping connection.
- 2 Walls close to the unit.
- 3 Service access door for unit inspection and maintenance access.
- 4 Piping connection.

#### **Service space**

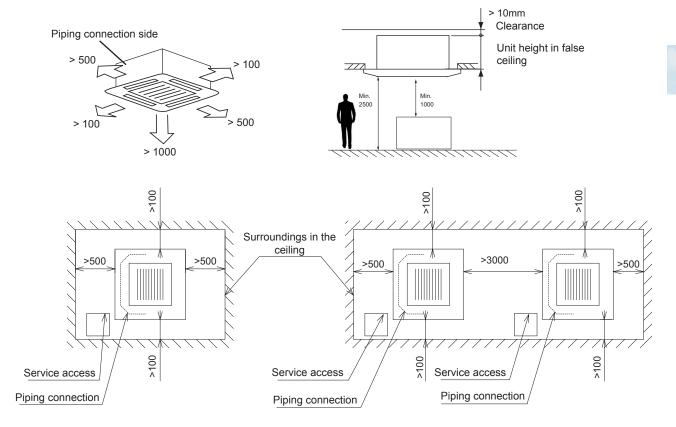




#### 7.2.2 RCIM-(0.4-2.5)FSRE - 4-way cassette

#### **♦** Operation space

Single installation

# >1500 >1500


Combined installation

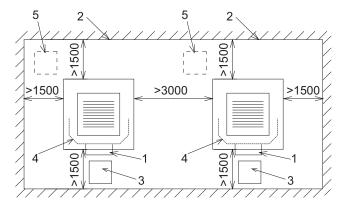



# i NOTE

- 1 Electrical box.
- 2 Walls close to the unit.
- 3 Service access door for unit inspection and maintenance access.
- 4 Piping connection.
- 5 Access door for duct adapter (Sold separately as an option)

#### **Service space**





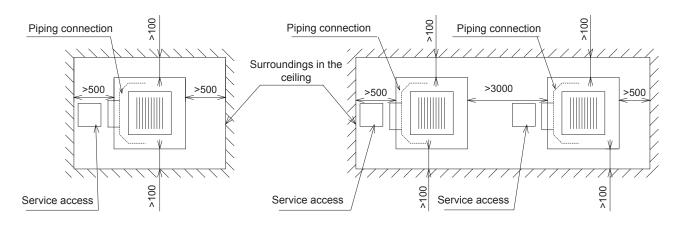





#### 7.2.3 RCD-(0.8-6.0)FSR - 2-way cassette

#### **♦** Operation space

#### Single installation




#### Combined installation

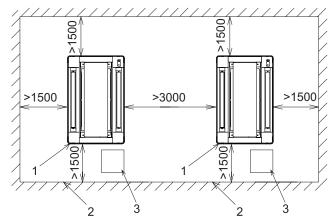


# i NOTE


- 1 Piping connection.
- 2 Walls close to the unit.
- 3 Service access door for unit inspection and maintenance access.

#### **Service space**

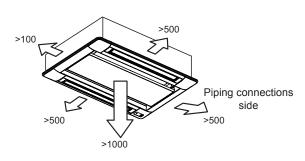




Single installation



Combined installation




## **i** NOTE

- 1 Piping connection.
- 2 Walls close to the unit.
- 3 Service access door for unit inspection and maintenance access.


#### 7.2.4 RPC-(1.5-6.0)FSR - Ceiling type

#### ♦ Operation and service space

#### Single installation

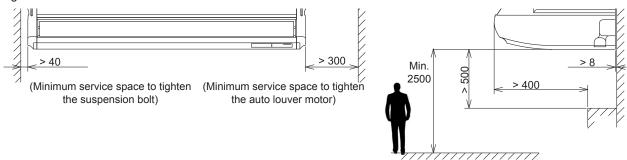

#### Combined installation






# 7.2.5 RPI(L/H)-(0.4-6.0)FSRE - Indoor ducted unit

# **♦** RPIL-(0.4-1.5)FSRE




Install the unit in a place not accessible by the general public.

### Service space for electrical box on left side configuration

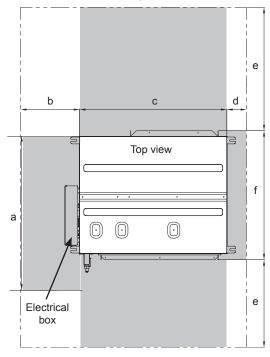


Service space (mm)						
а	b	С	d	е	f	
800	300	750	100	1000	657	

# Service space for electrical box on right side configuration

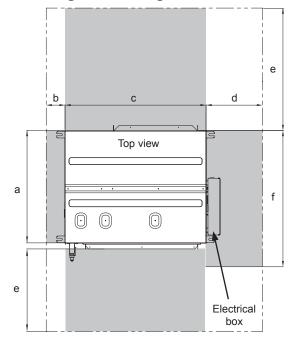


Service space (mm)						
a b c d e f						
1150	100	750	300	1000	657	

# Service space for wall mounted electrical box configuration

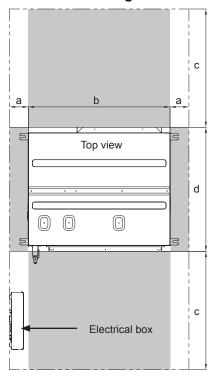


Service space (mm)						
a b c d						
100 750 1000 657						

# Service space for lower extraction of the air filter

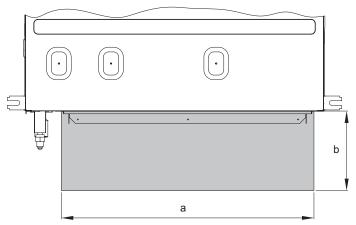

Service space (mm)				
a b				
635 200				

# Service Space for lateral extraction of the air filter

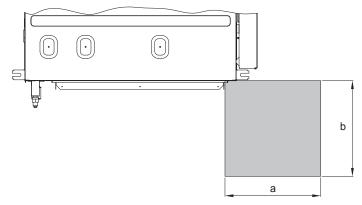


Service space (mm)				
a b				
340	340			


# **Operation space**




# ⚠ CAUTION

- If the suction of the indoor unit is through a plenum, there must be no obstacle less than 1000 mm.
- If the indoor unit is discharged freely, there must be no obstacle less than 1000 mm.
- In case of suction or discharge of the indoor unit through ducts, ducts must be straight 1000mm span from the unit.

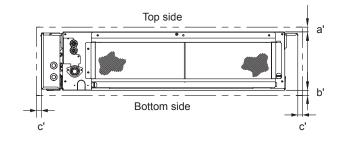

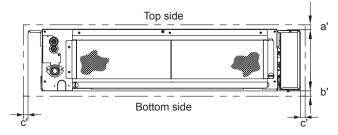

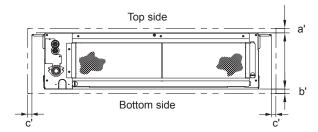


Operation space (mm)					
a' b' c'					
20	10	10			

# **♦** RPI-(1.5-2.0)FSRE




Install the unit in a place not accessible by the general public.

### Service space for electrical box on left side configuration

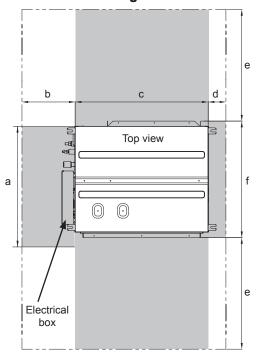


Service space (mm)						
a	b	С	d	е	f	
800	300	750	100	1000	657	

# Service space for electrical box on right side configuration

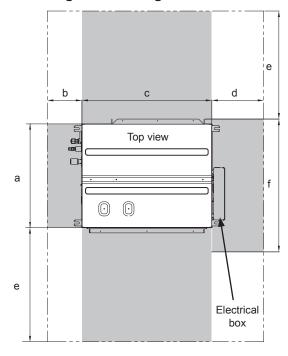


Service space (mm)						
a b c d e f						
657	200	750	300	1000	800	

# Service space for wall mounted electrical box configuration

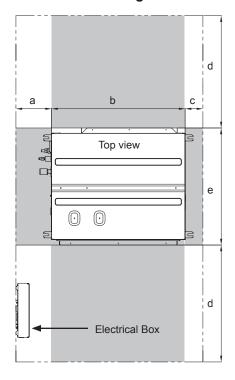


	Service space (mm)						
a b c d					е		
	200	750	100	1000	657		

# Service space for lower extraction of the air filter

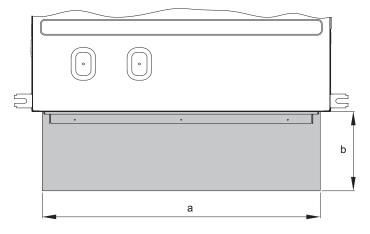

Service space (mm)					
a b					
700	200				

# Service space for lateral extraction of the air filter

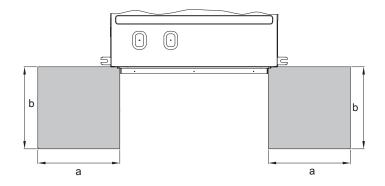



Service space (mm)				
a b				
370	370			


# **Operation space**



- If the suction of the indoor unit is through a plenum, there must be no obstacle less than 1000mm.
- If the indoor unit is discharged freely, there must be no obstacle less than 1000mm.
- In case of suction or discharge of the indoor unit through ducts, ducts must be straight 1000mm span from the unit.

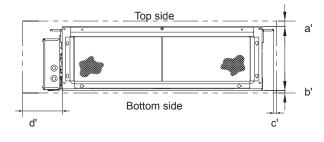

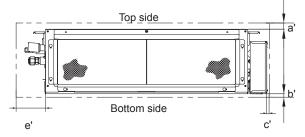

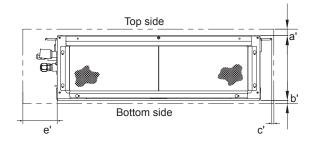


Operation space (mm)						
a' b' c' d' e'						
20	10	10	300	200		




Install the unit in a place not accessible by the general public.

# Service space for electrical box

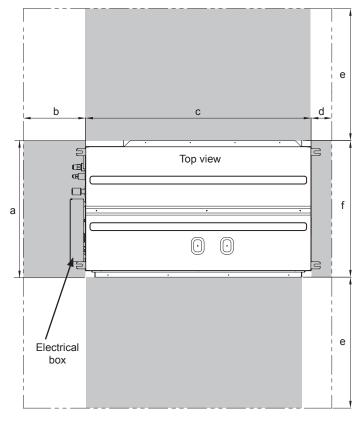


	Service space (mm)					
a b c d e f						f
	800	300	1084	100	1000	657

### Service space for lower extraction of the air filter

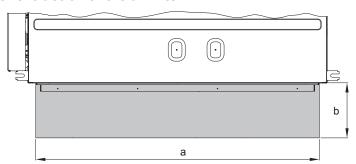

Service sp	pace (mm)	
а	b	
1030	200	

# Service space for lateral extraction of the air filter

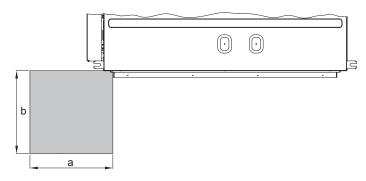


Service space (mm)		
a	b	
370	370	

# **Operation space**



# **A** CAUTION

- If the suction of the indoor unit is through a plenum, there must be no obstacle less than 1000 mm.
- If the indoor unit is discharged freely, there must be no obstacle less than 1000 mm.
- In case of suction or discharge of the indoor unit through ducts, ducts must be straight 1000mm span from the unit.

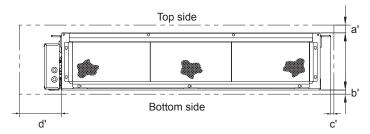


Operation space (mm)				
a'	d'			
20	10	10	300	




Install the unit in a place not accessible by the general public.

# Service space for electrical box

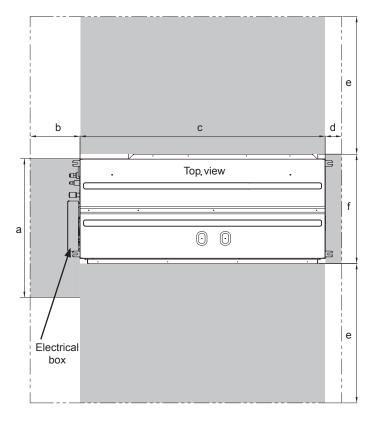


	Service space (mm)					
a b c d e						f
	800	300	1474	100	1000	657

# Service space for lower extraction of the air filter

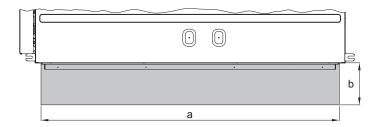

Service sp	pace (mm)
а	b
1420	200

# Service space for lateral extraction of the air filter

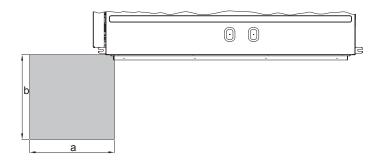


Service space (mm)		
a b		
500	500	

# **Operation space**



- If the suction of the indoor unit is through a plenum, there must be no obstacle less than 1000mm.
- If the indoor unit is discharged freely, there must be no obstacle less than 1000mm.
- In case of suction or discharge of the indoor unit through ducts, ducts must be straight 1000mm span from the unit.




Operation space (mm)				
a'	b'	c'	d'	
20	10	10	300	




Install the unit in a place not accessible by the general public.

# Service space for electrical box

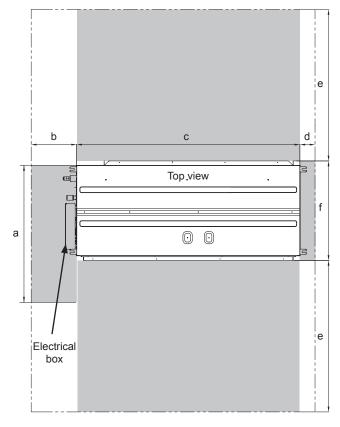


Service space (mm)					
а	b	е	f		
800	300	100	1000	657	

# Service space for lower extraction of the air filter

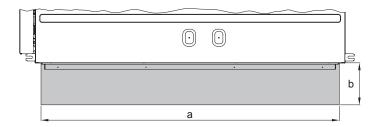

Service sp	pace (mm)
а	b
1420	200

# Service space for lateral extraction of the air filter

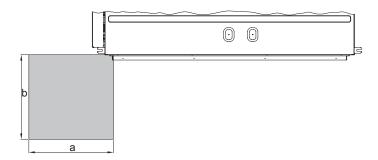


Service space (mm)		
а	b	
500	500	

# **Operation space**



- If the suction of the indoor unit is through a plenum, there must be no obstacle less than 1000mm.
- If the indoor unit is discharged freely, there must be no obstacle less than 1000mm.
- In case of suction or discharge of the indoor unit through ducts, ducts must be straight 1000mm span from the unit.




Operation space (mm)						
a' b' c' d'						
20 10 10 300						




Install the unit in a place not accessible by the general public.

# ♦ Service space for electrical box

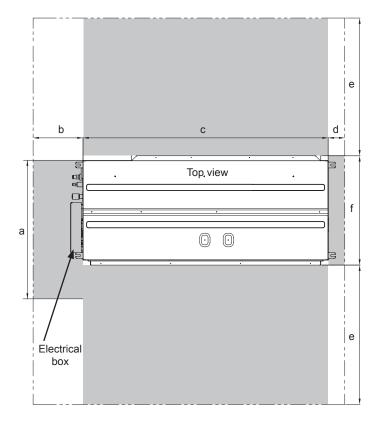


Service space (mm)					
а	b	С	d	е	f
800	300	1474	100	1000	657

## Service space for lower extraction of the air filter

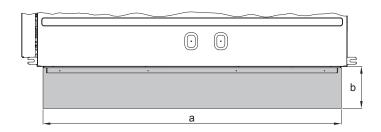

Service sp	pace (mm)	
а	b	
1420	200	

# ◆ Service space for lateral extraction of the air filter

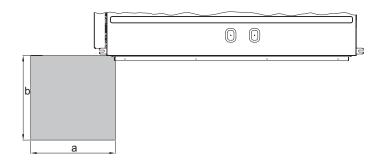


Service space (mm)		
а	b	
500	500	

# **♦** Operation space



# **A** CAUTION

- If the suction of the indoor unit is through a plenum, there must be no obstacle less than 1000mm.
- If the indoor unit is discharged freely, there must be no obstacle less than 1000mm.
- In case of suction or discharge of the indoor unit through ducts, ducts must be straight 1000mm span from the unit.




Operation space (mm)				
a' b' c' d'				
20	10	10	300	


# 7.2.7 RPI-(8.0-20.0)FSN3(P)E(-f) - Indoor ducted unit

# ◆ RPI-(8.0/10.0)FSN3E(-f) - Indoor ducted unit (Operation and service space)



Install the unit in a place not accessible by the general public.







A service access from the bottom side is required for servicing and maintenance (in order to reach the filter, fan motor, etc.).

# ♦ RPI-(16.0/20.0)FSN3PE(-f) - Indoor ducted unit (Operation and service space)

i NOTE

Install the unit in a place not accessible by the general public.

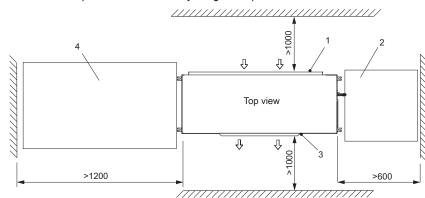






- 1 Rear
- 2 Service access door for unit inspection and maintenance access
- 4 Service access door for fan motor servicing

All measurements are in mm.

# 7.2.8 RPK-(0.4-4.0)FSR(H)M - Wall type

### ♦ Operation and service space

HP	а	b	С	d	е
0.4-1.5	150	100	100	1000	2300
2.0-4.0	100	200	100	1000	2300

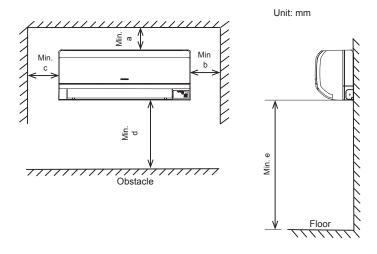




b: for servicing electrical parts

c: for servicing bearing

e : for rooms with a high ceiling


# Unit suspension bracket - RPK-(0.4-1.0)FSR(H)M

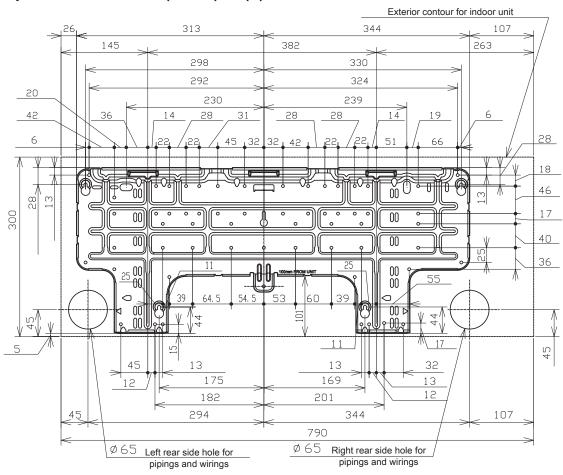




All measurements are in mm.

#### Unit suspension bracket - RPK-1.5FSR(H)M

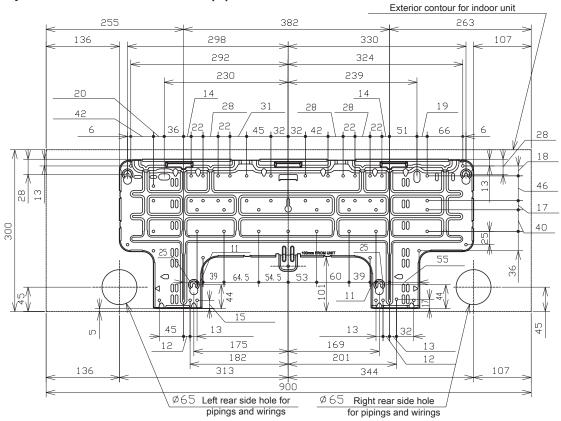

#### Unit suspension bracket - RPK-(2.0-4.0)FSR(H)M

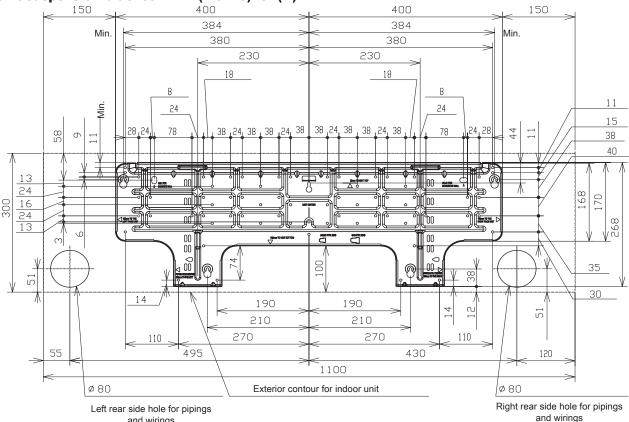


- i NOTE
- All measurements are in mm.
- The suspension bracket for RPK has different types of fixing hole, to be used depending on the characteristics of the wall.
- For gypsum boards (4 positions), using board anchors (field supplied).

and wirings


- : For concrete walls (2 positions).
- o o o : Additional holes (multiple positions), for other types of wall, to be used according to the requirements of the installation.

# 7.2.9 RPF-(1.0-2.5)FSN2E - Floor type




# 7.2.10 RPFI-(1.0-2.5)FSN2E - Floor concealed type

1 Vertical air outlet.



1 Horizontal air outlet.







All measurements are in mm.

# 7.2.11 KPI-(252-2002)(E/X)4E - Energy recovery and active energy recovery ventilation units

# KPI-(252-2002)E4E - Energy recovery ventilation units

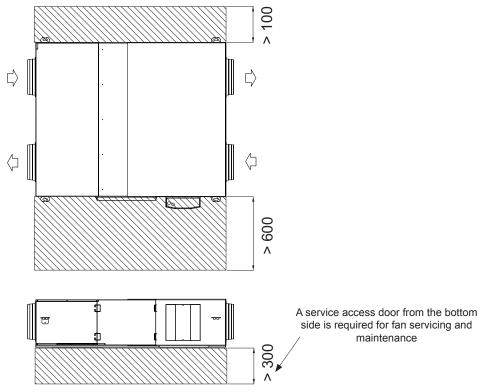


# KPI-(502-1002)X4E - Active energy recovery ventilation units

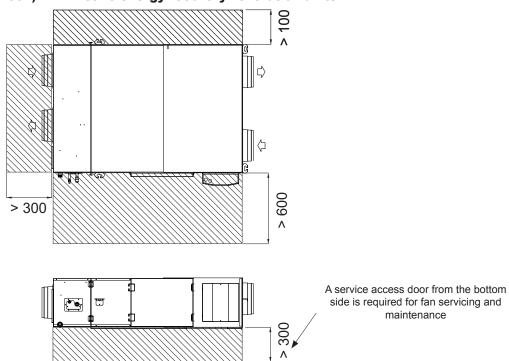



All measurements are in mm.


# 7.2.12 DX-Interface

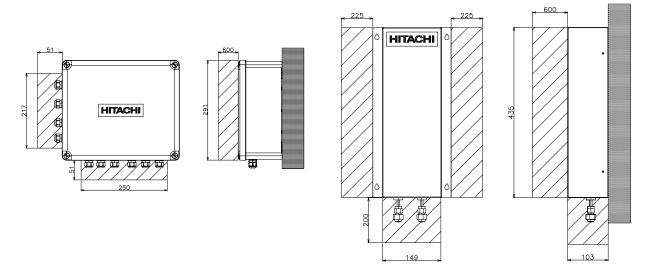



All measurements are in mm.

### 7.2.13 Econofresh kit






- Air flow direction:
  - SA: Suction air (RPI suction)
  - RA: Retruns air (from the room)
  - OA: Outlet air
- All measurements are in mm.

# 8. Refrigerant cycle


# Index

8.1	All models except RPK-FSRHM	. 264
8.2	RPK-FSRHM only	.264

# 8.1 All models except RPK-FSRHM

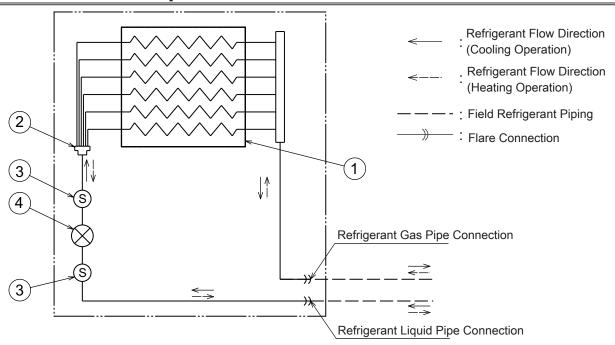

# 8.2 RPK-FSRHM only

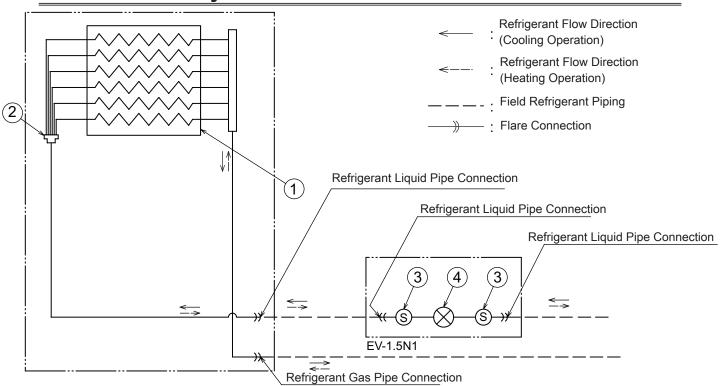

Mark	Part name	
1	Heat Exchanger	
2	Distributor	
3	Strainer	
4	Micro-Computer Control Expansion Valve	

# 9. Piping work and refrigerant charge

# Index

9.1	Refrigerant	266
	9.1.1 Refrigerant charge	266
9.2	Refrigerant piping selection	266
9.3	Multikits and distributors	267
	9.3.1 For Heat Pump system (2 pipes) - Line branch	267
	9.3.2 For Heat Pump system (2 pipes) - Header branch	269
	9.3.3 For Heat recovery system (3 pipes) - Line Branch	269
	9.3.4 For Heat recovery system (3 pipes) - Header branch	270
9.4	Copper pipes, sizes, connection and insulation	271
	9.4.1 Copper pipes and sizes	271
	9.4.2 Pipe connection	271
	9.4.3 Insulation of the Multi-Kits and/or branches	272
9.5	Precautions in the event of gas refrigerant leaks	273
	9.5.1 General notes R32 refrigerant	273
	9.5.2 General notes R410A refrigerant	274
9.6	General remarks for drain pipe connection	275
9.7	DX-Interface refrigerant charge and piping length limits	277

# 9.1 Refrigerant

#### 9.1.1 Refrigerant charge



#### DANGER

R32 refrigerant



#### **RISK OF EXPLOSION**

The compressor must be stopped before removing the refrigerant pipes.

All service valves must be fully closed after pumping down operation.

 Make sure that unit installation and refrigerant piping installation comply with applicable legislation in each country. Also, in Europe, EN378 must be complied, as it is the applicable standard. R410 refrigerant

Use the specified non-flammable refrigerant (R410A) to the outdoor unit in the refrigerant cycle. Do not charge the unit with materials other than R410A, such as hydrocarbon refrigerants (propane, etc.), oxygen, flammable gases (acetylene, etc.) or poisonous gases when installing, maintaining and moving the unit. Contamination of these are extremely dangerous and may cause an explosion, a fire, and an injury.



For matters relating to the refrigerant charge in the installation, consult the technical documentation corresponding to the outdoor units of the UTOPIA or SET FREE systems.

# 9.2 Refrigerant piping selection

# **♦** Pipe size selection

As a general rule, select the pipe size in line with the following instructions:

- 1 Between the outdoor unit and the branch pipe (Multi-Kit): select the same pipe connection size as for the outdoor unit.
- 2 Between the branch pipe (Multi-Kit) and the indoor unit: select the same pipe connection size as for the indoor unit.



Consult the corresponding technical documentation for outdoor units from the UTOPIA or SET FREE series for gas refrigerant pipe selection.



- Do not use refrigerant pipe sizes other than those indicated in the corresponding technical documentation for outdoor units. The diameter of the refrigerant pipes depends directly on the power of the outdoor unit.
- If larger diameter refrigerant pipes are used instead the one specified, the circuit lubrication oil tends to separate from the gas carrying it. The compressor will be seriously damaged due to a lack of lubrication.
- If smaller diameter refrigerant pipes are used instead the one specified, the gas or liquid refrigerant will have serious difficulties in circulating. System performance will be affected. The compressor will run under more severe conditions than foreseen and will be damaged in a short space of time.

#### ♦ Selection of the Multi-Kit or distributor



- Pipe connection size on outdoor units, indoor units and the Multi-Kit or distributor vary according to the system. Consult the technical documentation for the UTOPIA or SET FREE series.
- The sizes of the indoor and outdoor units are different. Adjust the flare adapter (accessory) to the indoor pipe connection.


# 9.3 Multikits and distributors




- All measurements are in mm.
- ID: Inner Diameter
- OD: Outer diameter


Α	To indoor unit
В	To outdoor unit
С	To main piping


# 9.3.1 For Heat Pump system (2 pipes) - Line branch

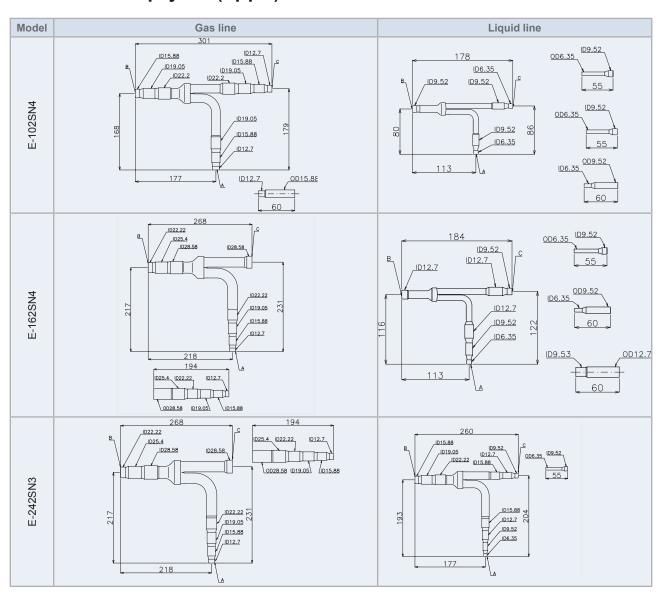

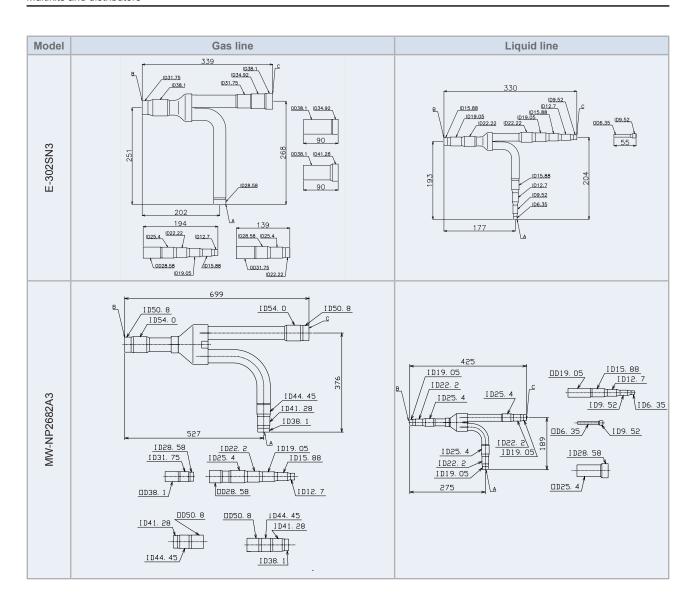



## 9.3.2 For Heat Pump system (2 pipes) - Header branch

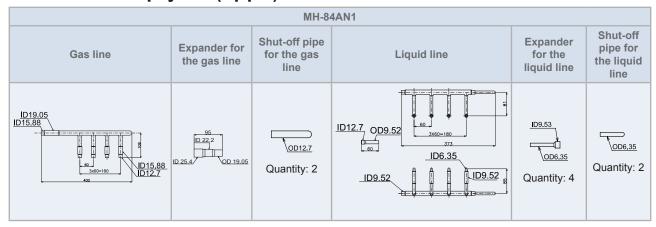

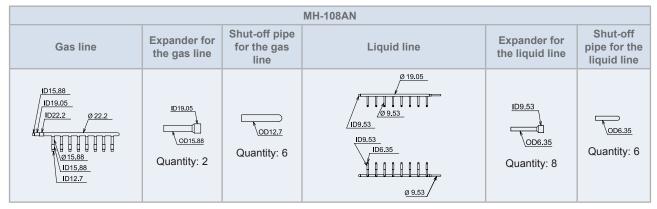


## 9.3.3 For Heat recovery system (3 pipes) - Line Branch

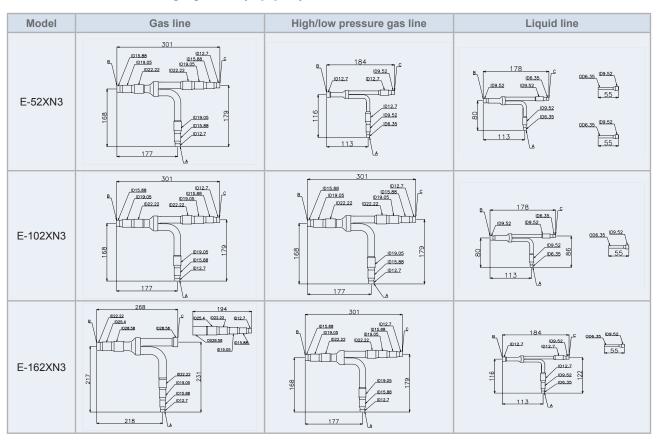

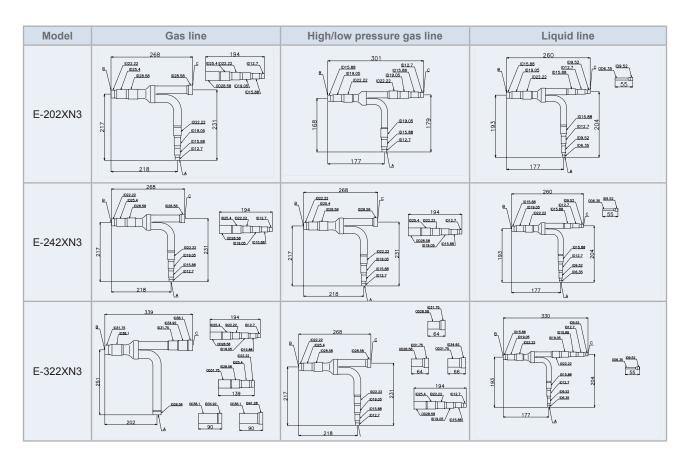

# 9.3.4 For Heat recovery system (3 pipes) - Header branch

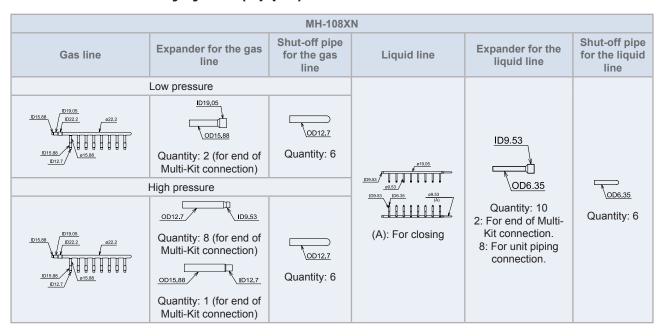

# 9.4 Copper pipes, sizes, connection and insulation

#### 9.4.1 Copper pipes and sizes

# ✓!\ CAUTION

- The copper pipe used in the refrigeration installations is different to the copper pipe used in installations carrying domestic or heating
- The copper pipe for refrigeration installations is especially treated for outdoors and indoors. The interior surface finish makes it easier for the gas refrigerant to circulate and withstands the action of the lubricant oil applied to outdoor equipment.
- Do not use hand saws, circular saws, abrasive grinders or other tools that generate shavings.
- Strictly follow national or local regulations regarding occupational health and safety. Wear appropriate means of protection during cutting or welding operations and installation (gloves, eye protection, etc).

Prepare the copper pipes provided by the supplier.

Select the pipe with the appropriate diameter and thickness. Use the table below to select the most appropriate pipe:

Nominal di	iameter	Thickness	Recommended supply type	
mm	inches	mm		
Ø6.35	1/4	0.80	Coil (Soft)	
Ø9.52	3/8	0.80	Coil (Soft)	
Ø12.70	1/2	0.80	Coil (Soft)	
Ø15.88	5/8	1.00	Coil (Soft)	
Ø19.05	3/4	1.00	Coil (Soft)	
Ø22.22	7/8	1.00	Coil (Soft)	
Ø25.4	1	1.00	Straight lengths (half hard)	
Ø28.58	1 1/8	1.00	Straight lengths (half hard)	
Ø31.75	1 1/4	1.10	Straight lengths (half hard)	
Ø38.1	1 1/2	1.35	Straight lengths (half hard)	
Ø41.3	1 5/8	1.45	Straight lengths (half hard)	
Ø44.45	1 3/4	1.55	Straight lengths (half hard)	
Ø50.8	2	1.78	Straight lengths (half hard)	

Always use clean copper pipes with no signs of knocks or cracks. Make sure there is no dust or dampness on the inside. Before you install the pipes, clean the inside with oxygen-free nitrogen gas to eliminate any remains of dust or other substances.



If copper pipe is used for piping bigger than Ø19.05, flaring work can not be performed. If necessary, use a joint adapter.


#### 9.4.2 Pipe connection

End of refrigerant pipe protected correctly.

Keep the ends of the pipes covered while other installation work is being carried out to avoid the entry of dampness or dirt.

Fix the connecting pipe as shown in the figure. Use field supplied insulations.

- A. Flare nut on the indoor unit
- B. Insulation material for insulation of the connection with the indoor unit (field supplied)
- C. Part to be fixed with brackets, plastic bands or adhesive tape (field supplied)
- D. Refrigerant pipe of the installation
- Insulation of the installation (field supplied) E.
- F.
- G. Flares made after attaching the flare nut to the connecting pipe in the Multikit package
- Η. Insulation attached to the indoor unit
- I. Indoor unit side





- Contamination caused by moisture and oil in the pipes reduces the overall performance and lifetime of the system. To avoid this, make sure that all copper piping is clean and dry internally, blowing oxygen-free nitrogen through the pipes.
- Where polyethylene foam insulation is used, the thickness of the insulation layer shall be at least 10 mm for the liquid pipe and at least 15~20 mm for the gas pipe.
- Foam insulation shall be installed after the surface temperature of the pipe has cooled down to room temperature; otherwise the insulation material may melt.

# CAUTION

- If the ends of the piping system are open after finishing the installation work, securely attach caps or vinyl bags to the ends of the piping to prevent moisture or dust entering.
- Cap the end of the pipe when the pipe is to be inserted through a hole (in walls, roofs, etc).



Do not place pipes directly on the ground without a cap or vinyl tape covering the end, as shown in the figure.



- If the installation of piping cannot be completed within the day, the ends of the piping shall be sealed by soldering, and the pipes charged with oxygen-free nitrogen using an access device such as a Schrader valve, in order to avoid contamination by moisture and foreign bodies.
- Do not use insulation material containing NH3 (ammonium), as it can damage the copper material of the pipes and cause subsequent leakage.
- Where the installer provides their own branch pipes, these must be insulated appropriately in accordance with environmental conditions in order to avoid a decrease of capacity and dew condensation on the surface of the pipes due to low pressure.

#### 9.4.3 Insulation of the Multi-Kits and/or branches

Attach insulation package with the Multikit to each branch (field-supplied or package with each one depending on model) using vinyl tape. Also attach insulation to field-supplied piping to prevent capacity decrease due to ambient air conditions and dewing on pipe surface caused by low pressure.



When polyethylene foam is applied, a thickness of 10 mm for the liquid piping and from 15 mm to 20 mm for the gas piping is recommended.



Perform insulation work after the surface temperature decreases to the room temperature, If not, the insulation material may melt.

# 9.5 Precautions in the event of gas refrigerant leaks



#### DANGER

The installers and those responsible for installation design must strictly abide by local and national regulations and local codes relating to safety requirements in the event of gas refrigerant leaks.

#### 9.5.1 General notes R32 refrigerant

This appliance can be filled with R32, an odourless flammable refrigerant gas with low burning velocity (A2L class pursuant to ISO 817). If the refrigerant is leaked, there is a possibility of ignition if it enters in contact with an external ignition source.

Make sure that unit installation and refrigerant piping installation comply with applicable legislation in each country. Also, in Europe, EN378 must be complied, as it is the applicable standard.


The unit installation and refrigerant piping should comply with the relevant local and national regulations for the designed

Due to R32 refrigerant and depending on final refrigerant charge amount, a minimum floor area for installation must be considered.

- If total refrigerant charge amount <1.84kg, there are no additional minimum floor area requirements.
- If total refrigerant charge amount ≥1.84kg, there are additional minimum floor area requirements to be checked.

#### Minimum area requirements

In case of total refrigerant amount ≥1.84 kg, the unit should be installed, operated and stored in a room with a floor area larger than the minimum criteria. Use following graphic and table to determine these minimum criteria:

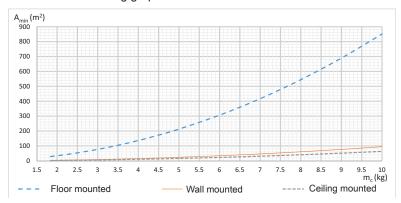

 $A_{min} = (m_0^*/(2.5*LFL^{(5/4)}*h_0)^2$ 

Minimum floor area for equipment installed inside				
	A <sub>min</sub> (m <sup>2</sup> )	A <sub>min</sub> (m <sup>2</sup> )	A <sub>min</sub> (m <sup>2</sup> )	
m <sub>c</sub> (kg)	Floor mounted	Wall mounted	Ceiling mounted	
1.84	28.81	3.20	2.14	
1.9	30.72	3.41	2.29	
2.0	34.04	3.78	2.53	
2.1	37.53	4.17	2.79	
2.2	41.19	4.58	3.06	
2.3	45.02	5.00	3.35	
2.4	49.02	5.45	3.65	
2.5	53.19	5.91	3.96	
2.6	57.53	6.39	4.28	
2.7	62.04	6.89	4.61	
2.8	66.72	7.41	4.96	
2.9	71.58	7.95	5.32	
3.0	76.6	8.51	5.70	

Minimum floor area for equipment installed inside					
	A <sub>min</sub> (m <sup>2</sup> )	A <sub>min</sub> (m <sup>2</sup> )	A <sub>min</sub> (m <sup>2</sup> )		
m <sub>c</sub> (kg)	Floor	Wall mounted	Ceiling		
	mounted		mounted		
3.1	81.79	9.09	6.08		
3.2	87.15	9.68	6.48		
3.3	92.68	10.30	6.89		
3.4	98.39	10.93	7.32		
3.5	104.26	11.58	7.75		
4.0	136.17	15.13	10.13		
4.5	172.34	19.15	12.82		
5.0	212.77	23.64	15.83		
6.0	306.39	34.04	22.79		
7.0	417.03	46.34	31.02		
8.0	544.69	60.52	40.51		
9.0	689.38	76.60	51.28		
10.0	851.08	94.56	63.30		



- Floor mounted: Refrigerant parts not sealed installed <0.6m height.
- Wall mounted: Refrigerant parts not sealed installed >1.8m height.
- Ceiling mounted: Refrigerant parts not sealed installed >2.2m height.



- In case of not achieving the minimum floor area, contact with your dealer.
- A mil.: Minimum installation area of an Indoor unit for a given refrigerant charge mc (kg) and considering the installation height h0 (m²)
- h<sub>o</sub>: Installation height of the bottom side of the indoor unit + distance from the indoor unit bottom side to the lowest part for which a refrigerant leak may release to the indoor area.
- m.: total system refrigerant charge that could be released to the indoor area in case of undetected refrigerant leak.
- LFL: Lower Flammability Limit for R32, 0,307 kg/m3 as established by EN 378-1:2016 and ISO 817.

An unventilated area where the appliance using flammable refrigerants is installed shall be so constructed that should any refrigerant leak, it will not stagnate so as to create a fire or explosion hazard.

- The appliance shall be stored in a well-ventilated area where the room size corresponds to the room area as specified for operation.
- The appliance shall be stored in a room without continuously operating open flames (for example an operating gas appliance) and ignition sources (for example an operating electric heater).

#### 9.5.2 General notes R410A refrigerant

This appliance can be filled with R410A refrigerant gas. R410A included in the units is non-combustible and non-toxic.



#### DANGER

In the event of a leak, the gas spreads around the room and displaces the air, which could cause suffocation.

According to Standard EN378-1, the maximum permitted concentration of HFC R410A gas in the air is 0.44 kg/m<sup>3</sup>. Therefore, effective measures must be adopted to maintain the concentration of R410A gas in the air below 0.44 kg/m³ in the event of a leak.

#### Calculation of the concentration of gas refrigerant

- 1 Calculate the total quantity of refrigerant R (kg) charged in the system. To do so, connect all indoor units in the rooms in which air conditioning is to be provided.
- 2 Calculate the volume  $V(m^3)$  of each room.
- 3 Calculate the refrigerant C (kg/m³) concentration in the room according to the following formula:

C=R/V

R: total quantity of refrigerant charged (kg).

V: volume of the room (m3).

C: gas refrigerant concentration ( ≤ 0.44 kg/m³ for R410A gas).

#### Countermeasures in the event of gas refrigerant leaks

The room must have the following characteristics should there be a gas refrigerant leak:

- 1 Opening with no outside shutter for fresh air circulation around the room.
- 2 Opening with no door to a size of 0.15% or above of the floor area.
- 3 A fan with a capacity of at least 0.4 m³/minute per ton of Japanese refrigeration (= volume moved by the compressor / 5.7 m³/h) or above, connected to a gas sensor in the air conditioning system that uses gas refrigerant. (Refer to outdoor unit technical catalogue.)




### 🔼 DANGER

Pay special attention to places such as basements and similar where the gas refrigerant may lie and settle, as it is heavier than air.

# 9.6 General remarks for drain pipe connection

- The drain piping work and the attachment of insulations must be completed before starting the refrigerant piping work.
- Refer to the Installation and Operation Manual corresponding to the indoor units for the details regarding the installation of the drain pipe, such as the position of the connectors.
- Arrange a polyvinyl chloride (PVC) pipe with the proper outer diameter according to the details in the Installation and Operation Manual.
- Fasten the tubing to the drain hose with an adhesive and a clamp, following the steps below.
  - Make sure that the surface of the connection end of the drain pipe is clean, and apply the PVC adhesive.
  - Insert the drain hose completely into the connection end of the drain pipe. Water leakage may occur if it is not inserted properly, or if it is bent or twisted.
  - Attach the hose clamp on top of the section of drain hose inserted into the connection part of the drain pipe. The hose clamp shall be at least 20 mm away from the end of the drain hose.
  - Tighten the hose clamp and make sure that the distance from the screw to the end of the hose clamp is approximately 28 mm.





# DANGER

- Do not connect the drain piping of the indoor unit into a drainage trench where corrosive gases occur. Otherwise, poisonous gases might flow into the room leading to poisoning.
- Do not connect condensate drainage with sanitary or sewer lines or sewage or any other condensate piping.
- Install the drain piping in accordance with national and local codes.




#### CAUTION

If the clearance between the drain pipe connection and the drain hose is excessive, then add a sealing material between both parts in order to make them fit and avoid deformation of the drain hose.




#### NOTE

- It is possible to connect the drain hose and the drain pipe without adhesive, if future relocation is intended. In that case, attach the hose clamp to the vinyl tape on the drain hose.
- Use the designated drain hose and hose clamp only. The use of other parts may cause water leakage.
- Do not bend or twist the drain hose, or use an already bent or twisted drain hose. It may cause water leakage.
- Do not apply an excessive force to the drain pipe connection. It may cause damage.
- Insulate the drain pipe after connecting the drain hose.
- Install the drain pipe, taking the following points into account:
  - The drain pipe must be installed with a downward slope of 1/25 to 1/100, as shown in the figure below.
  - Support parts must be installed at intervals of 1 m to 1.5 m, in order to avoid bending of the drain pipe.
  - The drain hose must by installed horizontally or with a slight upward, to prevent the formation of air pockets inside it. If air pockets appear inside the drain hose, the drain water will flow back into the unit, causing abnormal noise and leakage in the room when unit operation is stopped.



- In case of raising the drain pipe, it shall be installed according to the dimensions detailed in the corresponding Installation and Operation manual.
- Connect the drain pipe and the drain hose with gaskets, and then cover those completely with an insulation material. Dew condensation may occur as a result of improper insulation.






Pay attention to the thickness of the insulation material being used. If it is too thick, it might not be possible to install the piping in the unit.

- Install the common drain pipe, taking the following points into account:
  - The common drain pipe must be installed with a downward slope, to make sure that it is lower than the rising part of each drain pipe from an indoor unit.
  - When several indoor units are connected to the common drain pipe, the connection of each of the indoor units must be at a position higher than that of the common pipe.
  - The size of the common drain pipe must be large enough according to the number and capacity of the installed indoor units, being at least VP30 (nominal diameter: 30 mm, outer diameter: 38 mm)

Example of a system with drain-up mechanism

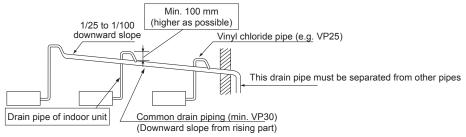

- Drain piping requires insulation if the drain is installed in a location where condensation forming outside the drain pipe may drop and cause damage. The insulation material for the drain pipe must be selected to ensure vapour sealing and to prevent condensation.
- A drain trap should be installed next to each indoor unit. This trap must be designed to good practice and be checked with water (charged) and tested for correct flow.
- The drain pipe and the refrigerant pipe must not be tied or clamped together.

# iINOTE

- The drain pipe must not have any upward slope or rising section. Otherwise, drain water may flow back into the units, causing water leakage when the operation of the units is stopped.
- After performing drain piping and electrical wiring work, check to ensure that water flows smoothly.

# 9.7 DX-Interface refrigerant charge and piping length limits

DX-Interface refrigerant charge calculation and limits of piping length vs HEX volume is described in the following procedure, that only applies to 1 to 1 system with UTOPIA IVX RAS-XH(V)NP(1)E series and DX-Interface series 2. For any other system the standard calculation procedure applies. Refer to the technical documentation of each system for further information.

The amount of refrigerant to be added to the system must be calculated according to pipe length and the volume of the heat exchanger (HEX), as well as the relation between these.

The following calculation procedure is applied only for 1-to-1 systems with UTOPIA IVX RAS-XH(V)NP(1)E series.

Total amount of refrigerant charge:

MTotal= mL+mHEX


Whereas charge due to increased pipe length is calculated as follows:

 $mL=(L-L0)*\alpha$ 

And charge due to the volume of the heat exchanger (HEX) is calculated as follows:

mHEX=(VHEX-V0 )\*β

There are different areas defined according to the length of piping and the volume of the heat exchanger (HEX), as shown in the following graphic. Depending on the area, it may be necessary to calculate mL, mHEX or both.

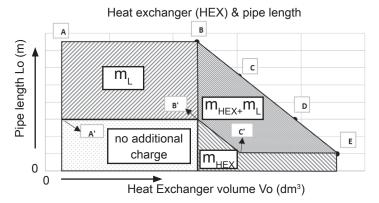



The heat exchanger expansion volume is restricted to certain applications. For those applications where it is not allowed, standard volume and piping restrictions apply.


Each DX-Interface series 2 model has its own graphic, as shown in the following page.


#### **♦** Table of values for area boundaries


		DX-Interface HP							
Concept		2 HP	2.5 HP	3 HP	4 HP	5 HP	6 HP	8 HP	10 HP
А	HEX Volume [dm³]	0.57	0.89	1.03	1.51	1.92	1.92	2.92	3.89
	Pipe length [m]	50	50	50	75	75	75	100	100
A'	HEX Volume [dm³]	0.57	0.89	1.03	1.51	1.92	1.92	2.92	3.89
	Pipe length [m]	30	30	30	30	30	30	30	30
В	HEX Volume [dm³]	1.16	1.35	1.57	2.37	2.37	2.92	3.89	4.76
	Pipe length [m]	50	50	50	75	75	75	100	100
B'	HEX Volume [dm³]	1.16	1.35	1.57	2.37	2.37	2.92	3.89	4.76
	Pipe length [m]	30	30	30	30	30	30	30	30
С	HEX Volume [dm³]	1.4	1.59	2.23	3.03	3.03	3.58	4.55	6.06
	Pipe length [m]	30	30	30	55	55	55	80	80
C'	HEX Volume [dm³]	1.4	1.59	2.23	3.03	3.03	3.58	4.55	6.06
	Pipe length [m]	10	10	10	10	10	10	10	10
D	HEX Volume [dm³]	1.64	1.83	2.89	3.9	3.9	4.45	6.27	9.43
	Pipe length [m]	10	10	10	30	30	30	30	30
Е	HEX Volume [dm³]	-	-	-	4.56	4.56	5.11	6.93	10.73
	Pipe length [m]	-	-	-	10	10	10	10	10
α	-	0.03	0.03	0.04	0.06	0.06	0.06	0.06	0.12
β	-	1.26							
L_0 [m]		30m if HEX Volume ≤ $V_B$ .  Interpolation with points $V_B$ , & $V_C$ , if $V_B$ , < HEX Volume < $V_C$ .							
	-								
		10m if HEX Volume ≥ V <sub>C'</sub>							
V_0 [dm <sup>3</sup> ]	-	1.16	1.35	1.57	2.37	2.37	2.92	3.89	4.76

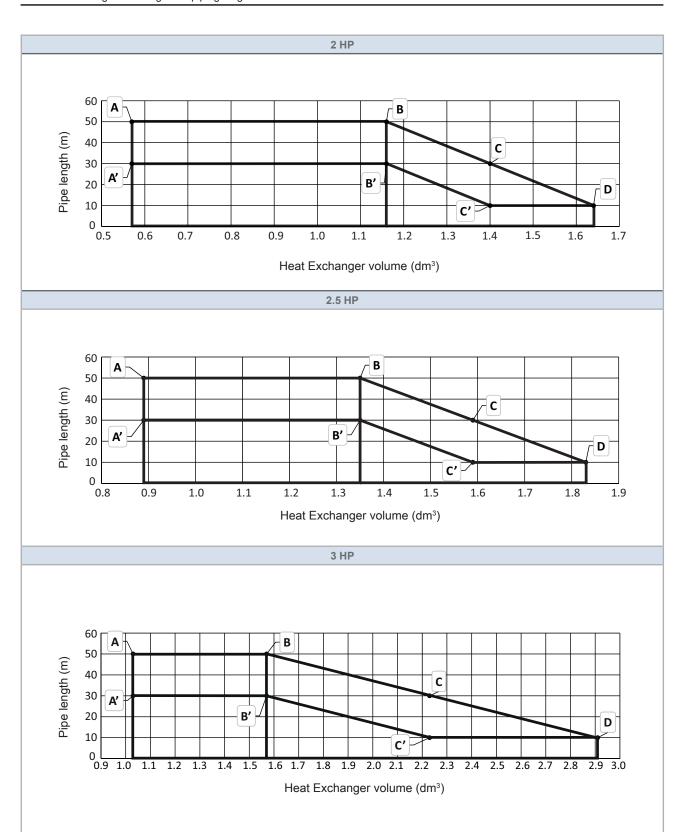


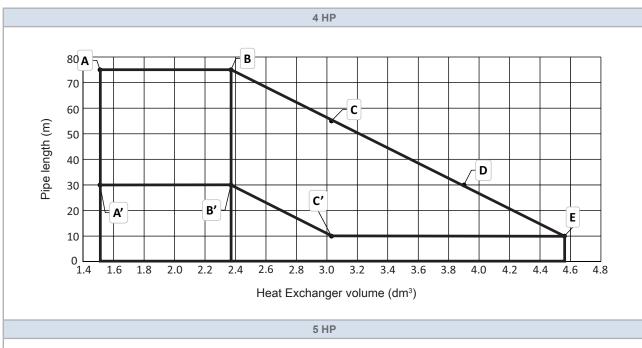

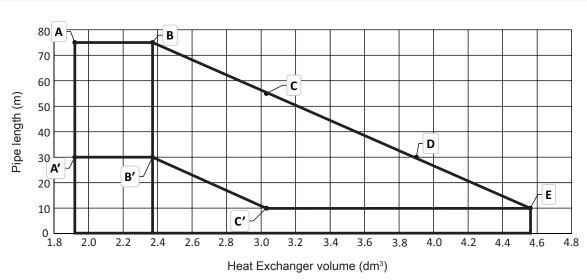

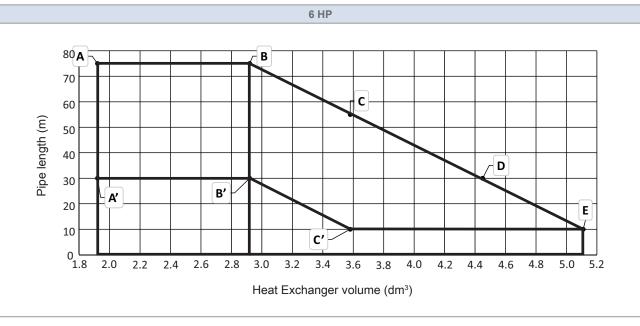

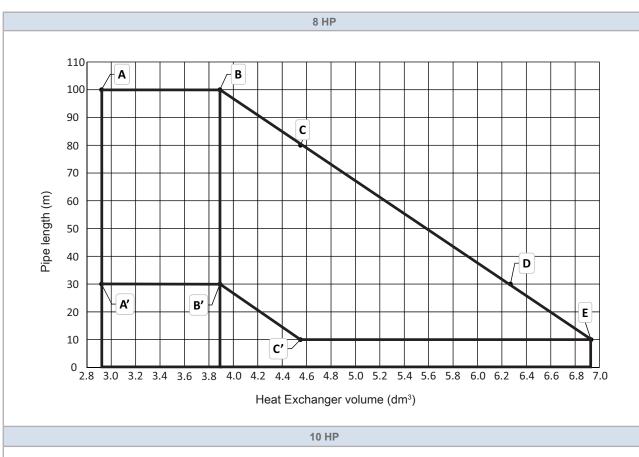

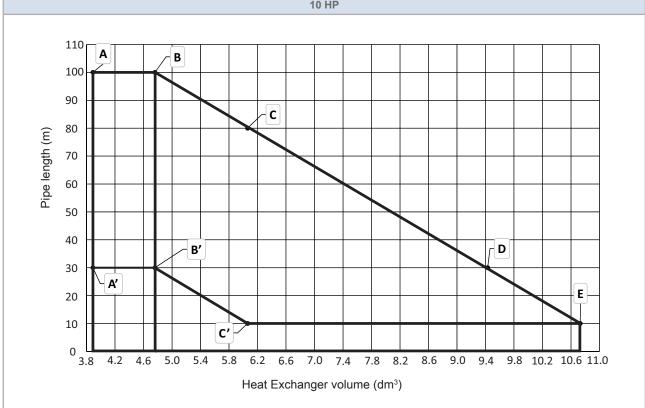

# 0 Electrical and control settings

# Index

10.1	General instructions	282
10.2	DIP switches settings and functions	283
	10.2.1 Considerations	283
	10.2.2 Indoor units	283
	10.2.3 KPI units	287
	10.2.4 DX-Interface settings	288
10.3	Setting of remote control switch for RPI-(16.0/20.0)FSN3PE(-f)	291
10.4	Outdoor and indoor units wiring	291
	10.4.1 Outdoor and Indoor units layouts for UTOPIA	292
	10.4.2 Outdoor and Indoor units layouts for SET FREE	294
	10.4.3 Connection diagram of SET FREE and RPI-(16.0/20.0)FSN3PE(-f) Indoor Unit	295
10.5	Power circuit sizing	296
	10.5.1 Minimum requirements of the wiring size and protection devices	296
10.6	DX-Interface electrical wiring	297
	10.6.1 Control box terminal board	297
	10.6.2 Expansion valve box terminal board	298
	10.6.3 Terminal board connections and remarks	298
	10.6.4 Remote temperature thermistor (THM-R2AE) for DX-Interface	300
	10.6.5 Installation of the remote controller (PC-ARFP1E)	300
10.7	Econofresh electrical wiring connection	301
	10.7.1 Input signal ports	301
	10.7.2 Optional sensor connection	301
	10.7.3 RPI-(4.0-6.0)FSN6E-EF Printed circuit board details	302
	10.7.4 Sensors position	303
10.8	Motion Sensor control conditions	304
	10.8.1 Motion sensor setting through PC-ARFP1E Remote Control switch	305
	10.8.2 Descriptions of Motion Sensor Control Condition	306
	10.8.3 Detecting Area for Human Activity	307
	10.8.4 Restrictions on the Connection of Motion Sensor and Indoor Units	308
	10.8.5 Restrictions on the Connection of Motion Sensor and Remote Control Switch	309
10.9	System Control	310
	10.9.1 Individual Operation	310
	10.9.2 Simultaneous Operation	311
	10.9.3 Different Refrigerant Cycles control	
	10.9.4 Wiring Examples	312

#### 10.1 General instructions



#### DANGER

- Make sure to install an ELB (Earth Leakage Breaker) and a CB (circuit breaker) or fuse as protection devices to properly protect all the units in the installation, in accordance with local or national safety regulations.
- Should these protection devices (ELB, CB) activate repeatedly, stop the system immediately and contact your service

# ∠!\ CAUTION

- Turn off the main power switch on the indoor and outdoor unit prior to any wiring work or regular inspections.
- Make sure the indoor and outdoor fan have come to a complete standstill before carrying out any wiring work or regular inspections.
- Protect wires, drain pipe and electric parts, etc. from rodents and insects, as they could bite unprotected parts and even cause a fire.
- Prevent wires from touching the gas refrigerant pipes, metal edges, printed circuit boards (PCB), electrical box or electrical parts on the inside of the unit as the wires could be damaged and even cause a fire or an electrical shock.
- Secure the wires firmly inside the indoor unit using plastic ties.



Secure the rubber bushes with adhesive when the outdoor unit ducts are not used.

- 1 Make sure the electric components supplied by the fitter (main power switches, circuit breakers, wires, connectors and connection terminals) have been selected correctly in line with the electrical data.
- 2 Local or national regulations must be followed at all times during the preliminary work to prepare the electric power line for the equipment.



For further information, consult the current regulations in the country where the unit is to be installed.

- 3 Check that the voltage is within the margin.
- Check the electric power line capacity for the unit. Where the voltage capacity is too low, it will not be possible to start the system due to the drop in voltage.
- 5 Check that the earth cable is correctly connected.

# 10.2 DIP switches settings and functions

# 10.2.1 Considerations




# **!** CAUTION


Disconnect the power supply before modifying the DIP switch settings. Otherwise the new settings will not be valid.



The "" mark indicates the position of the DIP switches. The figures show the position of the DIP switch once the position has been set.

# ◆ Example of setting (DSW(5/6) - RSW (1/2))





#### 10.2.2 Indoor units

# ◆ SW1 (RCI-FSR and RPC-FSR only)

No settings are required. Factory setting:



# **♦** SW2 (RPK-(0.4-4.0)FSR(H)M only)

Factory setting	Wired remote control
Wired	Wired
Wireless	Wireless



In case of using the wired remote control, a receiver kit PC-ALHZ1 or if there is installed a HARC-BXE (A/B), set the SW2 to "Wired".

### ◆ DSW2 / DSW9 (Optional function setting) (RPK-FSR(H)M only)

No setting is required. Setting positions before shipment are all OFF.

DSW9	DSW2
ON	ON 1 2 3 4

For example, set the number 1 pin of DSW9 to "ON" side when indoor unit C is set as "Identifying indoor units installed fro side by side".

	Indoor Unit A	Indoor Unit B	Indoor Unit C	Indoor Unit D
DSW2-3	OFF	ON	OFF	ON
DSW9-1	OFF	OFF	ON	ON

Factory setting for DSW2-3 and DSW9-1 is "OFF".




When using the receiver kit, setting DSW2 and DSW9 on the PCB for the indoor unit is not required. Set the function "Identifying indoor units installed side by side" with the receiver kit instead. For details on this setting, refer to the "Installation manual" for the receiver kit.


#### ◆ DSW3: Capacity code setting

No settings are required. This DIP switch with 4 or 6 switches (depending on Indoor Units) is used to set the capacity code corresponding to the power of the indoor unit.


Indoor Unit capacity 2 HP and 2.5 HP can be set to a lower capacity (1.8 HP and 2.3 HP) using the DIP switch.

Indoor Unit capacity 1.0 HP can be set to a higher capacity (1.3 HP) using the DIP switch.





Power (HP)				
5.0	8.0	10.0		
ON 1 2 3 4 5 6	ON 1 2 3 4 5 6	ON 1 2 3 4	ON 1 2 3 4	






- (\*) Capacity available with DSW3 setting.
- In those models with switch number 5 and 6 (shown in grey color), both switches are not used (except 0.4 and 0.6 HP models).

#### **DSW4: Model code setting**

No settings are required. This DIP switch is used to set the model code corresponding to the type of indoor unit. Follow the instructions given in the Service Manual.





DSW4 Not assembled in the RPK-FSR(H)M models.

# ◆ DSW5 and RSW(1/2): Refrigerant cycle number setting

It is required to change factory default setting, with a value of up to 63. In the same refrigerant cycle, set the same refrigerant cycle number for the outdoor unit and the indoor unit.

DIP switch an (Factory	Indoor unit model	
DSW5  ON  1 2 3 4 5 6	DSW5 RSW1 Refrigerant cycle number setting	RPK-(0.4-4.0)FSR(H)M  RCD-(0.8-6.0)FSR  RCI-(1.0-6.0)FSR  RPC-(1.5-6.0)FSR  RCIM-(0.4-2.5)FSRE  RPI-(0.4-6.0)FSRE
DSW5  RSW2  ON  1 2 3 4 5 6	DSW5 RSW2 Refrigerant cycle number setting	RPF(I)-(1.0-2.5)FSN2E  RPI-(4.0-6.0)FSN6E-EF  RPI-(8.0-10.0)FSRE (-f)  RPI-(16.0/20.0)FSN3PE(-f)



RPI-(16.0/20.0)FSN3PE(-f): Set both modules to the same cycle number.

# ◆ DSW6 and RSW(1/2): Unit number setting

It is strongly recommended to change factory default setting, with any value from 0 up to 63. The address number must be unique for each unit (in the same refrigerant cycle).

• All indoor units except RPI-(16.0/20.0)FSN3PE(-f):

DIP switch an (Factory	Indoor unit model	
		RPK-(0.4-4.0)FSR(H)M
DSW6 RSW2_		RCD-(0.8-6.0)FSR
		RCI-(1.0-6.0)FSR
	DSW6 RSW2 Unit number setting	RPC-(1.5-6.0)FSR
1 2 3 4 5 6		RCIM-(0.4-2.5)FSRE
		RPI-(0.4-6.0)FSRE
		RPI-(4.0-6.0)FSN6E-EF
DSW6 RSW1_		RPF(I)-(1.0-2.5)FSN2E
	DSW6 RSW1 Unit number setting	RPI-(8.0-10.0)FSN3E(-f)
1 2 3 4 5 6		RPI-(16.0/20.0)FSN3PE(-f)



It is recommended to assign a number from "1"

# • RPI-(16.0/20.0)FSN3PE(-f) only:

No setting is required.

	RSW1	
DSW6	PCB1 (Upper E-box)	PCB2 (Lower E-box)
1 2 3 4 5 6	(20 0 7 N) (20 0 7 N)	00 1 N 00 N 00 S N



When further connecting indoor units, make sure to set a number other than one or two for each indoor unit.

#### **◆ DSW7: Fuse recover**

No settings are required.

	All models
Factory setting	
In case of applying high voltage to the terminal 1-2 of TB (Transmitting wires), the fuse on the PCB is cut. In such a case, firstly correct the wiring to TB and then turn ON switch 1 (as show in the figure).	ON III




DSW7 Not assembled in the RPC-FSR models.

#### **◆ DSW8**

No settings are required.

	Only: RPI-(8.0/10.0)FSN3E(-f), RPI-(16.0/20.0)FSN3PE(-f)
Factory setting	ON 1 2 3

#### ◆ DSW9: Optional function

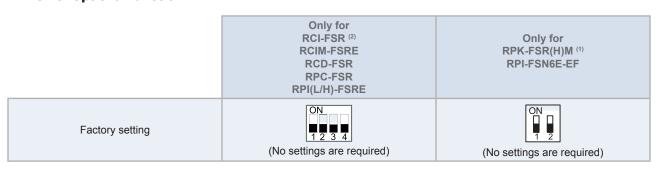



(1) In order to identify one indoor unit (RPK-FSR(H)M) with its own wireless remote control, set DSW2 pin3, DSW9 pin 1 and the wireless remote control at "a" "b" "c" "d" mode.

	Indoor unit A	Indoor unit B	Indoor unit C	Indoor unit D
DSW2-3	OFF	ON	OFF	ON
DSW9-1	OFF	OFF	ON	ON

For more information, please refer to the corresponding Installation and Operation Manual.

(2) Only for RCI-FSR: set DSW9 pin3 ON when Iconic Panel (P-AP160NAP, P-AP160KAP and P-GP160NAPU) is installed

#### 10.2.3 KPI units

#### **♦ PCB1 settings**


#### **DSW1** and **DSW2**

No settings are required.

DSW1	DSW2
All units	All units
1 2 3 4 5 6 7 8	ON IIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIII

#### **DSW3: Capacity code setting**

No setting is required, due to setting before shipment. This dip switch is utilized for setting the capacity code.



#### **DSW4: Unit model code setting**

No settings are required. This DIP switch is used to set the model code corresponding to the type of indoor unit. Follow the instructions given in the Service Manual.

DS	W4
KPI (E4E)	Active KPI (X4E)
ON 12 3 4	ON 1 2 3 4

# **DSW5** and **RSW2**: Refrigerant cycle number setting

It is required to change factory default setting, with a value of up to 63. In the same refrigerant cycle, set the same refrigerant cycle number for the outdoor unit, indoor unit and KPI unit.

Factory	setting
DSW5	RSW2
ON	(20) (20) (20) (20)

Example of system setting with a value of: 5	
DSW5	RSW2
ON	

# **DSW6** and **RSW1**: Unit number setting

It is required to change factory default setting, with any value from 0 up to 63. The number allocated to each KPI unit must be set as standard. Follow the instructions given in the Service Manual.

Factory	setting
DSW6	RSW1
ON 1 2 3 4 5 6	

Example of system setting with a value of: 16	
DSW6	RSW1
1 2 3 4 5 6	


#### **DSW7: Fuse recover**

No settings are required.

	All models (Except RPK-(0.8-1.5)FSR(H)M)
Factory setting	
In case of applying high voltage to the terminal 1-2 of TB (Transmitting wires), the fuse on the PCB is cut. In such a case, firstly correct the wiring to TB and then turn ON switch 1 (as showing beside).	

#### PCB2 settings

#### **DSW1: Optional functions**





If there is an indoor unit connected in the same RCS line as DX-Interface EXV-(2.0-10.0)E2 or KPI-(E/H/X)3E, then pin 7 must be ON to disable the power supply to RCS line. If there is no indoor unit connected to the same RCS line but there are more than one DX-Interface EXV-(2.0-10.0)E2 or KPI-(E/H/X)3E, then only one DX-Interface EXV-(2.0-10.0)E2 or KPI-(E/H/X)3E should have pin 7 OFF while all other units must have pin 7 set to ON. Failure to perform this setting correctly will result in bad communication and can even cause physical damage to the PCB.

#### **DSW2: End resistance**

In case that only KPI units are connected in the same HLINK (no outdoor unit connected in the same HLINK) set pin1 ON. Other case, no setting is required for DSW2.




# 10.2.4 DX-Interface settings

#### PCB1 settings

# **DSW3: Capacity code setting**

No settings are required. This DIP switch is used to set the capacity code corresponding to the DX-Interface power (HP).




#### **DSW4: Unit model code setting and optional setting**

No settings are required.

Factory setting	ON 1 2 3 4
Enabled EC fan motor alarm by tachometer input (Set pin 4 to ON position)	ON 1 2 3 4


# **DSW5** and **RSW2**: Refrigerant cycle number setting

It is required to change factory default setting, with a value of up to 63. In the same refrigerant cycle, set the same refrigerant cycle number for the outdoor unit and DX-Interface.



# **DSW6** and **RSW1**: Unit number setting

It is required to change factory default setting, with any value from 0 up to 63. The number allocated to each KPI unit must be set as standard. The setting must be done so that it does not overlap the setting of other indoor units in the same refrigerant cycle. If the setting is not done manually, the automatic address function is enabled instead.



# **DSW7: Fuse recover**

No settings are required.

Factory setting	ON D D D D D D D D D D D D D D D D D D D
In case of applying high voltage to the control terminal 1-2 of TB2 (Transmitting wires)(position 17–18), the fuse on the PCB is cut. In such a case, firstly correct the wiring to TB and then turn ON switch 1.	ON D

# **♦ PCB2 settings**

DSW1: Optional functions

Factory setting		ON 1 2 3 4 5 6 7 8
	Discharge air control (Control by outlet temperature)	ON 1 2 3 4 5 6 7 8
Pins 1 and 2: Capacity control setting	Indoor air control (Control by inlet temperature)	ON 1 2 3 4 5 6 7 8
	External duty control (*1)	ON 1 2 3 4 5 6 7 8
	4~20 mA (Internal 100Ω load impedance)	ON 1 2 3 4 5 6 7 8
Pins 3 and 4: Duty signal setting (*1)	0~10 V (Internal 47kΩ pull-down resistor)	ON 1 2 3 4 5 6 7 8
	0~5 V (Internal 47kΩ pull-down resistor)	ON 1 2 3 4 5 6 7 8
Pin 5: Duty mode selection (*2)		ON
Pin 6: Thermo ON/OFF external input enabled (*3)		ON
Pin 7: Group controller (*4)		ON
Pin 8: Not used		ON



- (\*1): If external duty control is selected (pins 1-2), then check the proper selection for the duty signal (pins 3-4).
- (\*2): If external duty control is selected (pins 1-2-3-4), then turn pin 5 OFF for absolute reference or ON for incremental reference
- (\*3): The thermo ON/OFF control can be driven externally by an input signal connected to the CN3 socket of the PCB1. The pin 6 of DSW1 in PCB2 must be switched on, and then the "i1" input of CN3 is automatically set for Thermo ON/OFF control. The setting of "i2" input is kept as set on the remote controller.
- (\*4) Pin 7: ON: group controller OFF: individual controller
- Please refer to the Service Manual of Hitachi Indoor Units for further information about the setting and connection of the auxiliary inputs.

#### **DSW2: End resistance**

No setting is required.



# 10.3 Setting of remote control switch for RPI-(16.0/20.0)FSN3PE(-f)

This unit is factory set with the Optional function: Output 2 = 02 "Alarm Signal" activated.

Indication	Output signal	Application	Port
02	Alarm signal	When an alarm occurs in one of the modules, the alarm signal generated in that module becomes the stop signal for the other one.	CN7



Make sure that this configuration is set after installing / wiring the indoor unit. If not, set this Optional Function as indicated above.

# 10.4 Outdoor and indoor units wiring

# **A** CAUTION


- · An incorrect connection of the power line or the service line cables may lead to breakdown of the printed circuit board (PCB).
- Wiring shall not touch gas refrigerant pipes, metal edges, printed circuit boards or electrical parts inside the unit, at it could be damaged, leading to failure and even the occurrence of fire.
- Wiring shall be protected from rodents and insects, as they could bite unprotected parts leading to failure and even the occurrence
  of fire.
- · Wiring inside indoor units shall be secured firmly using plastic ties.
- All the installed equipment and wiring must be in line with the applicable local regulations, codes and standards and with international codes.

#### General instructions to bear in mind when connecting the shared wiring between the outdoor and indoor units

- 6 Units are installed together in groups belonging to the same cooling cycle. Refrigerant pipes and control wiring are also connected in groups to the units belonging to the same cooling cycle.
- 7 A 2-core shielded twisted pair cable with a cross-section of over 0.75 mm² (equivalent to KPEV-S) shall be used for communications between the outdoor and the indoor unit and between the indoor units; in case that the length of control wiring exceeds 300 m, an optional signal amplifier supplied by Hitachi (sold separately) shall be attached.
- 8 All the electric components supplied on site (main power switches, circuit breakers, wiring, connectors and connection terminals) must have been selected correctly in line with the electrical data provided in the corresponding chapter of this manual, and must comply with the applicable local regulations, codes and standards, which might be stricter than the suggested specifications in this manual.
- 9 Connect the wiring of the indoor and outdoor units as shown in the figure. Rubber bushes shall be secured with adhesive when the outdoor unit ducts are not used.

# *i* NOTE


· Depending on the Indoor Unit series the terminal position for Control Line and Remote Control can differ:

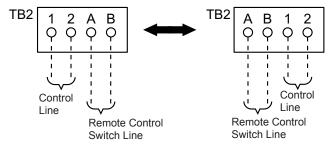

10


# 10.4.1 Outdoor and Indoor units layouts for UTOPIA

♦ Connection diagram of the UTOPIA Series: outdoor unit and single indoor units powered by a shared line

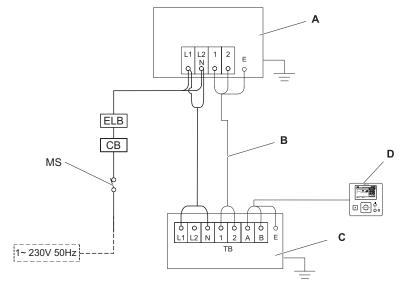

Α	Outdoor unit
В	Transmission wiring H-LINK (shielded twisted pair cable), 5 Vdc non-polarity (Field supplied)
С	Indoor units (max 1 indoor unit)
D	Remote control
MS	Main switch (Field supplied, follow the local regulations)
СВ	Circuit breaker or/and fuse (Field supplied, follow the local regulations)
ELB	Earth leakage circuit breaker (Field supplied, follow the local regulations)

# ♦ Connection diagram of the UTOPIA Series: outdoor unit and indoor units powered by independent lines

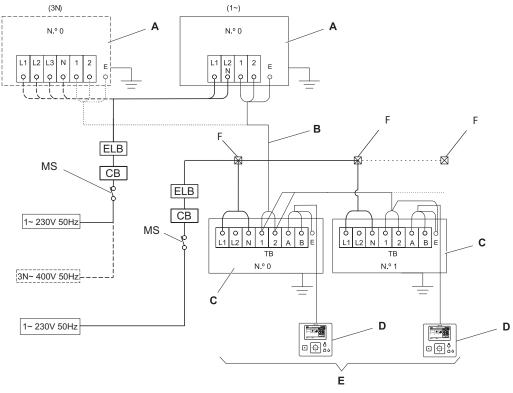


Α	Outdoor unit number 0 (3N or 1~)
В	Transmission wiring H-LINK (shielded twisted pair cable), 5 Vdc non-polarity (Field supplied)
С	Indoor units
D	Remote control
Е	The maximum number of indoor units according to outdoor unit combinability
F	Pull box
MS	Main switch (Field supplied, follow the local regulations)
СВ	Circuit breaker or/and fuse (Field supplied, follow the local regulations)
ELB	Earth leakage circuit breaker (Field supplied, follow the local regulations)

This connection diagram is an example for individual operation.

# 10.4.2 Outdoor and Indoor units layouts for SET FREE

◆ Connection diagram of SET FREE Modular FSXN(S/P)E Series: outdoor unit and indoor units powered by independent lines

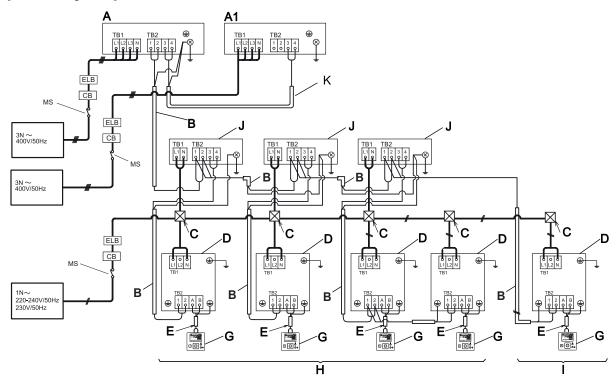


Α	Main outdoor unit
A1	Secondary outdoor unit
В	Transmission wiring H-LINK (shielded twisted pair cable), 5 Vdc non-polarity (Field supplied)
С	Distribution box (field-supplied)
D	Indoor units
Е	Remote controller operation wiring (shielded twisted pair cable) (field-supplied)
G	Remote control
Н	Indoor unit system Number 0
I	Indoor unit system Number 1
J	CH unit
K	Transmission wire between A and A1
MS	Main switch (Field supplied, follow the local regulations)
СВ	Circuit breaker or/and fuse (Field supplied, follow the local regulations)
ELB	Earth leakage circuit breaker (Field supplied, follow the local regulations)

# i NOTE

This connection diagram is an example for heat recovery system.

# 10.4.3 Connection diagram of SET FREE and RPI-(16.0/20.0)FSN3PE(-f) Indoor Unit

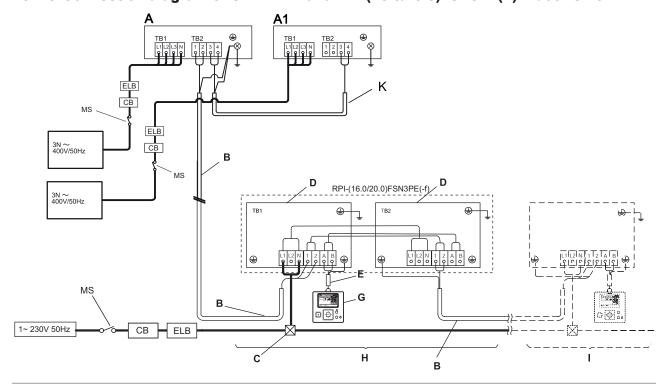

Α	Main SET FREE outdoor unit
A1	Secondary SET FREE outdoor unit
В	Transmission wiring H-LINK (shielded twisted pair cable), 5 Vdc non-polarity (Field supplied)
С	Distribution box (Field supplied).
D	Indoor Unit terminal boards (TB1,TB2)
Е	Remote controller operation wiring (shielded twisted pair cable) (field-supplied)
G	Remote control
Н	Indoor unit RPI-(16.0/20.0)FSN3PE(-f)
I	Other Indoor unit system
K	Transmission wire between outdoor units (A and A1 in the example)
MS	Main switch (Field supplied, follow the local regulations)
СВ	Circuit breaker or/and fuse (Field supplied, follow the local regulations)
ELB	Earth leakage circuit breaker (Field supplied, follow the local regulations)

# 10.5 Power circuit sizing



# CAUTION

Check to ensure that the field supplied electrical components (main power switches, circuit breakers, wires, connectors and wire terminals) have been properly selected according to the electrical data indicated in this chapter and that they comply with the applicable national and local codes. If necessary, contact your local authority in regard to standards, rules, regulations, etc.

#### 10.5.1 Minimum requirements of the wiring size and protection devices

Use wires which are not lighter than the polychloroprene sheathed flexible cord with code designation 60245 IEC 57.

		Size of the power	Size of the		ELB	
Model	Power supply	supply cable EN60 335-1	transmission cable EN60 335-1	(A)	Number of poles / A / mA	
0.4-6.0 HP Indoor units	1~ 230V 50Hz	2x0.75 mm <sup>2</sup> +GND		5		
RPI-(8.0/10.0)FSN3E(-f)	or	2x1.5 mm <sup>2</sup> +GND	0 0 75	10	0.440.400	
RPI-16.0FSN3PE(-f)	1~ 220-240V 50Hz	2x4.0 mm <sup>2</sup> +GND	2x 0.75 mm <sup>2</sup>	20	2 /40 /30	
RPI-20.0FSN3PE(-f)	(depending on the model)			20		



# ⚠ CAUTION

- If the installation is already equipped with an Earth Leakage Breaker (ELB), ensure that its rated current is large enough to hold the current of the units.
- Indicated wire and CB sizes are for the protection of a the power supply circuit of a single indoor unit. When connecting several indoor units to the same power supply line, select the wire and CB sizes according to the total current (MC Operation) in the power supply line. A CB with a slightly larger size than the calculated value must be selected in order to prevent its activation during normal operation in extreme system conditions (such as voltage drop or high temperatures).



- CB: Circuit breaker; ELB: Earth leakage breaker
- Electric fuses can be used instead of magnetic Circuit Breakers (CB). In that case, select fuses with similar rated values as the CB.
- The Earth Leakage Breaker (ELB) mentioned on this document is also commonly known as Residual Current Device (RCD) or Residual Current Circuit Breaker (RCCB).
- The Circuit Breakers (CB) are also known as Thermal-Magnetic Circuit Breakers or just Magnetic Circuit Breakers (MCB).

# 10.6 DX-Interface electrical wiring

- Connect the electrical wires between the indoor unit and the outdoor unit, as shown in the next diagram.
- Follow the local codes and regulations when performing the electrical wiring.
- Use shielded wires for intermediate wiring to protect the units from noise obstacle at length of less than 300 m and size in compliance with local codes.
- In the event that a conduit tube for field-wiring is not used, fix rubber bushes to the panel with adhesive.
- All the field wiring and equipment must comply with local and international codes.
- When a cable gland is not used, it must be sealed properly in order to ensure the correct control box sealing.




Pay attention to the connection of the operating line. Incorrect connection may cause PCB failure.



Packing gland diameter specification: 6.0 mm (min) to 12.0 mm (max). If needed, install additional tube insulation or wind with insulation tape around the wire to make the wire thicker.


#### 10.6.1 Control box terminal board

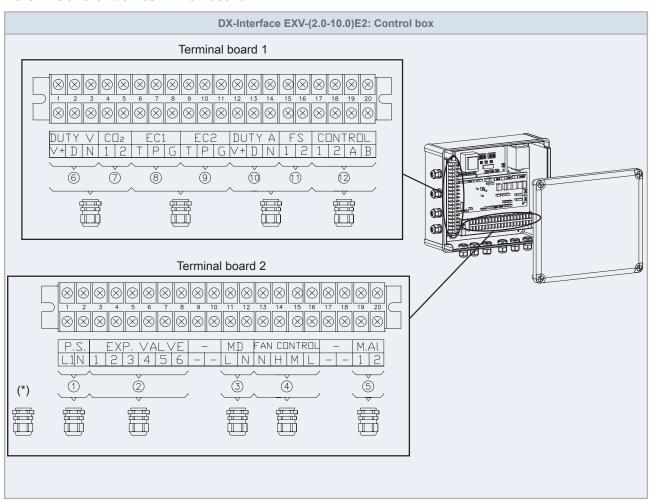

i NOTE

(\*): Packing gland for thermistor installation.

# 10.6.2 Expansion valve box terminal board

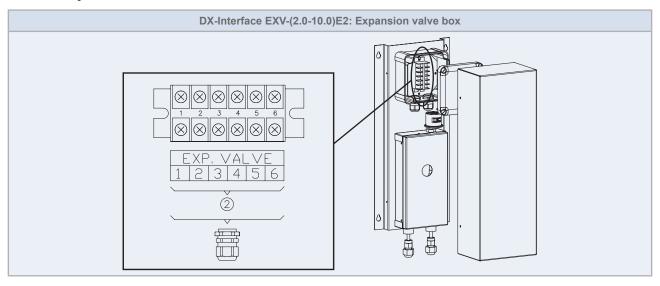

# 10.6.3 Terminal board connections and remarks

# **♦** Control box

# **Terminal board 1**

Mark	Item	Name	Description	Wire and maximum current specification (EN60335-1)		
	1	V+	DUTY V: Duty control by voltage (0~10V) (0~5V) (optional): V+: Output power to device (+24Vdc)	Wire section: 3x0,5 mm <sup>2</sup>		
6	2	D	D: Voltage input (0~10V) (0~5V)	i NOTE		
	3	N	N: GND	Maximum power by 24Vdc output: 3 W		
(7)	4	1	CO <sub>2</sub> signal (optional):	Wire acctions 2v0 E mm²		
	5	2	Free contact: By closing the signal, the fan speed is set to High mode.	Wire section: 2x0,5 mm <sup>2</sup>		
	6	Т	EC1: PWM Output control for EC FAN 1 (optional): T: Tach input signal (Hz)			
8	7	Р	P: PWM output signal (0-100%)	Wire section: 3x0,5 mm <sup>2(1)</sup>		
	8	G	G: GND			
	9	Т	EC2: PWM Output control for EC FAN 2 (optional): T: Tach input signal (Hz)			
9	10	Р	P: PWM output signal (0-100%)	Wire section: 3x0,5 mm <sup>2(1)</sup>		
	11	G	G: GND			
	12	V+	DUTY A: Duty control by current (4~20mA) (optional): V+: Output power to device (+24Vdc)	Wire section: 3x0,5 mm <sup>2</sup>		
10	13	D	D: Current input (4~20 mA)	NOTE		
	14	N	N: GND	Maximum power by 24Vdc output: 3 W		
(1)	15	1	FS: Float switch (optional):	Mine as ation, 200 5 mans?		
(1)	16	2	Free contact between terminals 1(15) and 2(16)	Wire section: 2x0,5 mm <sup>2</sup>		
	17	1	CONTROL: H-LINK and remote controller communication			
12	18	2	(Necessary): The H-LINK transmission between outdoor unit and indoor unit is 2 wired to terminals 1-2.	Wire section: 2x0,5mm²		
	19	Α	The Remote controller must be connected between pins A and B	Wire coetion: 2v0 5 mm²		
	20	В	(non polarity)	Wire section: 2x0,5 mm <sup>2</sup>		



(1): If fan wiring length is higher than 3 m, use shielded wires in compliance with local codes.

#### **Terminal board 2**

Mark	Item	Name	Description	Wire and maximum current specification (EN60335-1)		
	1	L1	P.S.: Power supply (necessary):	1~ 230V 50Hz, Max current. 5A		
1	2	N	The mains power supply connection (230Vac) is wired to terminals L1 and N.	Wire section: 3x0,75 mm <sup>2</sup>		
	3	1				
	4	2				
	5	3	EXP. VALVE: Expansion valve connection (necessary):	Wire coation, 6v0 F mm²		
2	6	4	Link to expansion valve assembly. Number links from 1 to 6 must match in e-box terminal board and expansion valve terminal board	Wire section: 6x0,5 mm <sup>2</sup>		
	7	5	'			
	8	6				
	9	-	Mat and			
-	10	-	Not used	-		
_	11	L	MD: Motor Drain discharge (optional):	1~ 230V 50Hz Max current: 1A		
3	12	N	A drain water pump (field supplied) can be connected to DX-kit interface	(output) Wire section: 2x0,75 mm <sup>2</sup>		
	13	N	FAN CONTROL: Fan tap speed control by Hitachi remote controller (optional): N-Neutral phase connection (common)	Maximum current allowed: 3,5A		
4	14	Н	H: High fan speed signal  Wire section: 4x0.75			
	15	М	M: Medium fan speed signal			
	16	L	L: Low fan speed signal			
	17	-	Not used			
_	18	-	Not used	-		
	19	1	M. AL: Motor alarm signal:			
5	20	2	Alarm input signal can be used for alarm link between the DX-Interface interface and the unit connected. If the jumper between terminal 1 (19) and 2 (20) is open, unit will be switched to alarm condition. Connect again to restart the system	Wire section: 2x0,75 mm <sup>2(2)</sup>		

# i NOTE

- (1): Locked rotor amperage (LRA) must be lower than 8 A.
- (2): Alarm signal with high power 1~ 230V 50Hz: In case of M. Al, connection is not necessary; the harness jumper provided inside the DX-Interface must be used.


# Expansion valve box

Mark	Item	Name	Description	Wire and maximum current specification (EN60335-1)	
	1	1			
	2	2	Control connection (necessary): Link to control assembly.  Number links from 1 to 6 must match in expansion valve terminal board and control terminal board 2 in the control box.		
	3	3		Wire section: 6x0,5 mm <sup>2</sup>	
2	4	4			
	5	5			
	6	6			

# 10.6.4 Remote temperature thermistor (THM-R2AE) for DX-Interface

The remote temperature thermistor THM-R2AE (7E299907) is available for the DX-Interface Series 2 (EXV-(2.0-10.0)E2).

When the remote temperature thermistor is connected to the THM4 socket on PCB1 of the DX-Interface series 2, it is automatically recognized and activated by the system control.

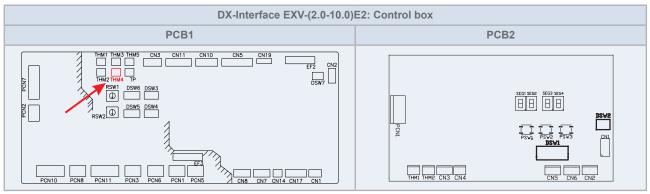


When the remote temperature thermistor is active, the system control can operate in different control temperatures according to the C8 setting in optional remote control functions.

Setting value	Without THM-R2AE	thermistor	With THM-R2AE thermistor		
00	Air inlet thermistor	Tin	Remote temperature thermistor	THM-R2AE	
01	Air temperature control using the remote control thermistor	RCS	Air temperature control using the remote control thermistor	RCS	
02	Air temperature control using the average value of the air inlet thermistor and the remote control thermistor	(Tin+RCS)/2	Air temperature control using the average value of the remote temperature thermistor and the remote control thermistor	(THMR2AE+RCS)/2	

# 10.6.5 Installation of the remote controller (PC-ARFP1E)

A dedicated remote controller (PC-ARFP1E) must be connected to the DX-Interface series 2. Only this remote control model (PC-ARFP1E) can be used and only one remote control can be connected to the DX-Interface series 2.






Central controllers are only compatible when the system is in control by Inlet temperature.

# 10.7 Econofresh electrical wiring connection

The electrical wiring connection, on the RPI indoor unit PCB, for a system with Econofresh unit is shown below.

Mount the outdoor thermistor (THM4) at a position near the outdoor air inlet. Pay attention to the position of the thermistor where the direct sunshine is not radiated or rain water is not touched.

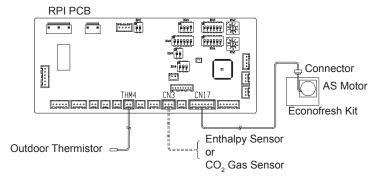



# DANGER

- Turn OFF the main power switch to the unit and wait for more than 3 minutes before electrical wiring work or a periodical check is performed.
- Check to ensure that the indoor unit's fan has stopped before electrical wiring work or a periodical check is performed.
- Protect the wires, electrical parts, etc. from rats or other small animals. If not protected, rats may gnaw at unprotected parts and at the worst, a fire will occur.



Wrap the accessory packing around the wires, and plug the wiring connection hole with the seal material to protect the products from any condensate water or insects.

#### 10.7.1 Input signal ports

The system has eight optional input signals programmed into the PCB using connector CN3 on the RPI indoor unit and using the remote control. Connector CN3 has two ports for configuring the optional input signals.

When on the PCB of RPI unit, DSW6 is set for connect the Econofresh, CN3 terminals 1 and 2 are locked for "Enthalpy sensor" or "CO2 sensor".


The outdoor cooling function E1, All Fresh operation, no requires CN3 connector setting.

#### 10.7.2 Optional sensor connection

When installing the field-supplied sensors, select and connect the sensors as follows.

- 1 The type of the sensor should be of ON/OFF switching type.
- 2 The switch rating should be DC12V.
- 3 Connect the wires to #1 and #2 of CN3 on the RPI PCB.
- 4 Lead the wires through the connecting hole for the control circuit.

Indication		Port setting on the RPI indoor unit PCB	Remarks	Outlet
Inlet	. 1	CN3 1-2	1 0 0 0 0 3 0	Contact (Optional Sensor (DC12V, 1 to 2mA))

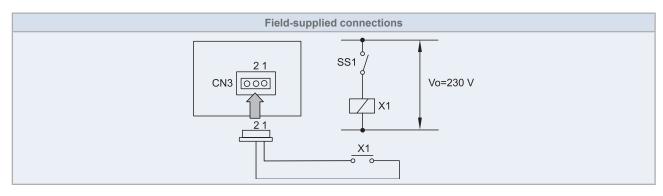


Comp	onent	Manufacturer or specifications	Remarks
Auxiliary	relay (X1)	Reduced power relay model OMRON: MY1F or equivalent	Voltage between the relay terminals 12 Vdc, 75 mA
Contact (SS1)	(x1) (example)	Manual type	Voltage between the contactor terminals 230 V, 5 mA
3-pin conn	ector cable	Optional part PCC-1A (capable of connecting the connector (JST XHP-3)	Five cables with connectors in one group
Cable (control) Voltage: 12 Vdc		0.5 mm <sup>2</sup>	
Cable (power) Voltage: 230 V		2.0 mm <sup>2</sup>	

Connectors CN3 is factory-set with the following optional functions.

	Connector no.	Connector terminal	Factory settings function	Remarks
Inlet		1–2	03	Function: Remote unit On/Off
	CN3	2–3	06	Cancellation of commands from the remote control after a forced stoppage

(\*) If the Econofresh is connected, CN3 terminals 1 and 2 are locked for the enthalpy sensor or the  $\rm CO_2$  sensor. Insure that inlet signal is set, for CN3 (pin1-2), at 03 function (remote unit ON/OFF).


# 10.7.3 RPI-(4.0-6.0)FSN6E-EF Printed circuit board details

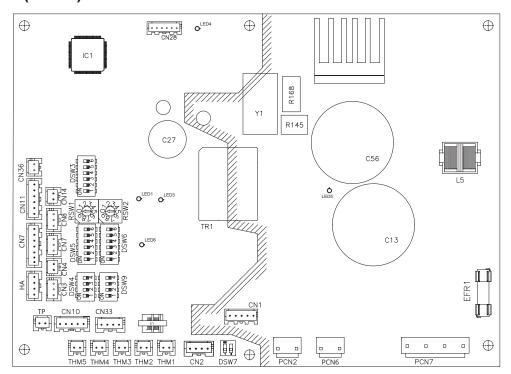

Connector indication				
THM4 Remote thermistor (Econofresh thermistor)				
CN3	Enthalpy Sensor or CO <sub>2</sub> Gas Sensor for Econofresh			
CN17 Econofresh connection for AS motor				

# 10.7.4 Sensors position

The figure below shows an example of system configuration

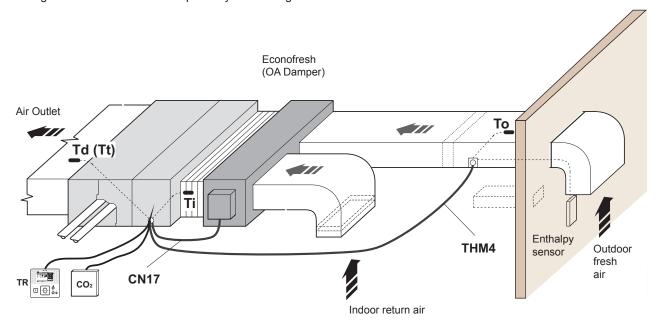



- To: Outdoor fresh air temperature
- Ti: Indoor return air temperature
- TR: Remote control switch setting temperature
- Td: Air outlet temperature
- Tt: Target air outlet temperature
- CO<sub>2</sub>: CO<sub>2</sub> gas sensor
- Enthalpy: Enthalpy sensor
- OA Damper: Outdoor air damper


# 10.8 Motion Sensor control conditions



# i NOTE

- 1 The motion sensor detects the human activity. However, if someone is in a room with a bit motion, the motion sensor may detect as absence.
- 2 The motion sensor may detect as human activity, if the indoor unit with the motion sensor is installed near a moving object which is different temperature against atmosphere.
- 3 The motion sensor may detect as absence in the case that the indoor unit with the motion sensor is installed to a high ceiling (higher than 4 m) even if someone is in a room.
- 4 The motion sensor may detect as absence and the operation may be stopped in the case of staying for long time with
- 5 In the case that the indoor units are operated by 2 remote control switches, the motion sensor setting is available only from the main remote control switch.


#### At normal operation



In the case that the individual installed three (3) indoor units to each room are connected to one (1) outdoor unit and operated them.



#### At motion sensor activated



In a specific room, the air flow volume and the air flow direction are adjusted when the human activity becomes few in the period of time.

The operation is stopped automatically if the activity is not detected in the period of time. It prevents to forget the turning off the switch.

#### 10.8.1 Motion sensor setting through PC-ARFP1E Remote Control switch

The motion sensor setting is easy by the remote control switch. The indication of "Motion sensor is activated" is displayed on the remote control switch LCD during controlling the motion sensor.

#### Sensor

- ON: The operating control function by the motion sensor is activated.
- OFF: The operating control function by the motion sensor is not


#### 2 If absent


- Stop: The operation is stopped by the remote control switch when all the indoor units with motion sensor detect absence which are connected with same remote control switch.
- Stand-by: The operation mode is the fan operation at "Slo" speed.
- Running: the operation continues with the same heating capacity even if absence is detected. (Default setting)

#### 3 Check interval

The motion sensor detects an absence at selected check interval time, the function "If absent" will be executed. The interval can be selected from 30, 60, 90, 120 or 180 minutes (The default setting is 30 minutes).

"Motion sensor is activated" or "Motion Sensor ON" is displayed on the remote control switch LCD during capacity saved operation or operation stopped by the motion sensor control.







If the function "Prohibiting operation by remote control switch" is used from the centralized controller, select the command "Running" or "Stand-by" in "If absent" at the motion sensor control setting. If "Stop" is selected, the motion sensor control can not be performed correctly as follows.

- In the case that "Stop" is selected in the motion sensor control setting and "Prohibiting operation by remote control switch" (for all items) is set by the centralized controller, the operation will not be stopped even if the motion sensor control function changes to the stoppage condition.
- In the case that "Stop" is selected in the motion sensor control setting and "Prohibiting operation by remote control switch" (for part of items) is set by the centralized controller, the indoor unit operation can not be restarted from the centralized controller although the operation can be stopped under the stoppage condition by the motion sensor control function.



# 10.8.2 Descriptions of Motion Sensor Control Condition

Motion sensor setting in the remote control is [ON]	->	Standard operation	Counter for judgement of absence	Motion sensor mode 1	Counter for judgement of absence	Motion sensor mode 2	Counter for judgement of absence	Motion sensor mode 3
---	----	--------------------	----------------------------------	----------------------------	----------------------------------	----------------------------	----------------------------------	----------------------------

When detection conditions for absence are no longer given, the mode changes as follows:

Mode 1 ---> Standard operation

Mode 2 ---> Standard operation

Mode 3 ---> Standard operation (if not changed to "stop operation" when "If Absent" is set as STOP)

					Adjustm	ent to Indoor un	it values
Condition					Temperature setting (1) (2)	Fan speed setting (2)	Air flow direction
Standard op	Standard operation					Setting fan speed	Setting air flow direction
MODE 1					1°C adjusting	Setting fan speed -1 (Min: Low)	Horizontal
MODE 2					2°C adjusting	Setting fan speed -1 (Min: Low)	Horizontal
	"If Absent" s	"If Absent" set as: Running				Setting fan speed -1 (Min: Low)	Horizontal
	"If Absent" s	sent" set as: Standby (3)			Forced Thermo-OFF	Slo	Horizontal
	"If Absent" set as: Stop	Simultaneous operation		When not all	All indoor units		
			All Indoor Units with motion sensor	indoor units are ABSENT	2°C adjusting	Setting fan speed -1 (Min: Low)	Horizontal
MODE 3				When all indoor units are ABSENT (4)	All inde	oor units stop ope	eration
			Not All Indoor Units with motion sensor (5)		All indoor units		
MENU "If Absent" on remote					2°C adjusting	Setting fan speed -1 (Min: Low)	Horizontal
switch		Individual operation (each unit has its own PC-ARFP1E control)		remote	Each indoor "Forces Thermo-OFF" according their individual detection status. All indoor uni stop operation when all the indoor units are i Thermo-OFF		All indoor units
		controlling several indoor units thought a RC transmission wiring connection	When not all Indoor units are ABSENT	Those indoor units are ABSENT	Forced Thermo-OFF	Slo	Horizontal
				Those indoor units are no ABSENT	2°C adjusting	Setting air flow volume-1 (Min: Low)	Horizontal
			When all indo	When all indoor units are ABSENT (6)		All indoor units stop operation	



- (1) The correction value of indoor unit setting temperature is not applied to room temperature control (It is transmitted to the outdoor unit and applied for capacity control only). The adjustment of temperature consists in the addition of 1 or 2°C in cooling operation mode and the subtraction of 1 or 2°C in heating operation mode.
- (2) When automatic cooling/heating is selected, the actual operation mode follows the table above. Therefore, the correction value of indoor unit setting temperature is also applied in automatic cooling/heating.
- (3) Standby mode is skipped in simultaneous operation and kept in Mode 2 because units perform batch operation. This means that if one IU with motion sensor entered in mode 3 (Standby), then the other units with motion sensor would be set to this mode regardless of their operation status. This would not be acceptable when persons are present in the room.
- (4) When all IU with motion sensor connected to the relevant remote control do not detect any presence and enter in motion sensor Mode 3 (if absent->Stop), all units stop operating after a time [Check interval] has passed from the last detection by any of the units. After operation stops in this manner, it will not restart until ON is set in the PC-ARFP1E remote control, even if presence is detected. Check interval: The units stop after a time has passed from the last motion detection by any of the units. This time can be set in PC-ARFP1E by [Check interval setting] as: 30, 60, 90, 120 and 180 min.
- (5) In case that one or more units without motion sensor are in simultaneous operation, the units will keep operating regardless of their operation status. Both Standby and Stop modes are skipped in this situation.
- (6) When all IU with motion sensor connected to the relevant remote control do not detect any presence and enter in motion sensor Mode 3 (if absent->Stop), all units stop operating after a time [Check interval] has passed from the last detection of any of the units. After operation stops in this manner, it will not restart until ON is set in the PC-ARFP1E remote control, even if presence is detected. In Individual operation, if IU with and without motion sensor are mixed together, the IU without motion sensor also stop when the IU with motion sensor are stopped.
- The PC-ARFP1E remote control switch forces the stop of operation when all the indoor units with motion sensor switch to "MODE 3". Once the operation is stopped by the remote control switch, it will not restart even if presence is detected. Indoor units with and without motion sensor can be mixed together.
- The Indoor units in "stop operation" remain in that status until ON is set in PC-ARFP1E remote controller.

#### 10.8.3 Detecting Area for Human Activity

#### **RCI-FSR**


Detecting Angle: Approx 123°

RCI-(1.0-3.0)FSR	RCI-(4.0-6.0)FSR
Detecting diameter: approx. 7 m <sup>(3)</sup> (0.8mheight from floor surface)	Detecting diameter: approx. 8.8 m <sup>(3)</sup> (0.8mheight from floor surface)



(9): The detecting area becomes smaller if the human motion is few such as stretching on a chair etc. The detecting diameter will be changed to approximately 6.0 m.


#### **Detecting area**

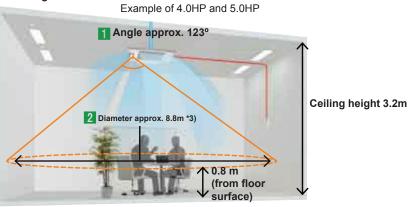

In the case of the ceiling height is 3.2m

#### **RCIM-FSRE**


The sensing area for the motion sensor is shown in the figure below when applying the motion sensor with the air panel:



Installation height of indoor unit: h (m)		2.7	3.2
Sensi	ng area for motion sensor: Ø a (m)	Approx. 5.0	Approx. 7.0

#### **RPC-FSR**

Detecting Diameter: Approx. 7.0m x 7.2m (0.8m...height from floor surface) The motion sensor may not detect the human activity at the space just under the indoor unit (1.8m x 7.0m).



# 10.8.4 Restrictions on the Connection of Motion Sensor and Indoor Units

1 Connection of Indoor Unit Supporting Motion Sensor

There are some restrictions on the use of the motion sensor depending on the connection of indoor units as shown in the table below.

O: Connectable X: Not Connectable △: Connectable (with Restriction)

Outdoor unit series	Connection of inde	oor unit	Motion sensor	Remarks
	Single		0	
	Multiple operation (Individ	ual Operation)	0	
DC Inverter UTOPIA	Multiple operation	with transmission Wire	<u>^</u> *1)~*3)	Transmission wire is required even when the indoor unit is in simultaneous operation.
	(Simultaneous Operation)	without transmission Wire	×	simultaneous operation.
SET FREE	Individual Opera	Individual Operation		

<sup>\*1):</sup> A motion sensor is required for each indoor unit.

<sup>\*2): &</sup>quot;Stand-by" cannot be set when in "If Absent" setting.

<sup>\*3):</sup> An Indoor unit with a motion sensor cannot be used together with an indoor unit without a motion sensor.

2 Combination of Indoor Unit and Outdoor Unit Supporting Motion Sensor

The motion sensor can be used only when the following indoor and outdoor units are used together.

INDOOR	RCI-FSR Using Motion Sensor Kit (PS-MSK2) (sold separately as an option)		
	RCIM-FSRE Using Motion Sensor Kit (SOR-NEC) (sold separately as an option)	Using wire remote control PC-ARFP1E (Required, sold separately as an option)	
UNITS	RPC-FSR Using Motion Sensor Kit (SOR-NEP) (sold separately as an option)		
	RPI(L/H)-FSRE Using Motion Sensor Kit (SOR-MSK) (sold separately as an option)		
UTOPIA	UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium series	From first production	
	FSN2 series	From ROM number P3852	
	FSXN series	From ROM number P3817	
	FSXNH(E) series	From ROM number P3880	
SET	FSXN1E and FSRE series	From ROM number P3880	
FREE	FSXNSE	From first production	
	FSNXPE	From first production	
	FS(V)NME	From first production	
	FSXNME	From first production	

#### 10.8.5 Restrictions on the Connection of Motion Sensor and Remote Control Switch

1 Connection of Remote Control Switch Supporting Motion Sensor

There are some restrictions on the use of the motion sensor depending on the connection of remote control switch as shown in the table below.

O: Connectable △: Connectable (with Restriction)

Connected Remote Control Switch	Motion Sensor
PC-ARFP1E x 1	0
PC-ARFP1E x 2	△*2)
PC-ARFP1E x 1 and Receiver Kit x 1 *1)	△*3)

<sup>\*1):</sup> The motion sensor cannot be used without PC-ARFP1E.

Setting and operation is possible only from PC- ARFP(1)E.

2 Connecting Multiple Indoor Units to One Remote Control Switch

When connecting multiple indoor units to one remote control switch, there are some restrictions on the use of the motion sensor as shown below.

O: Connectable X: Not Connectable △: Connectable (with Restriction)

Connected Indoor Units	Outdoor Unit Operation	Motion Sensor
Indoor Unit with Motion Sensor *1)	DC Inverter UTOPIA (Individual Operation), SET FREE (Multiple Operation)	△ *2)
mood one with motion ochool 1)	DC Inverter UTOPIA (Simultaneous Operation)	△ *2)
Combination of Indoor Unit with Motion Sensor	DC Inverter UTOPIA (Individual Operation), SET FREE (Multiple Operation)	△ *3)
and Indoor Unit without Motion Sensor *1)	DC Inverter UTOPIA (Simultaneous Operation)	×

<sup>\*1):</sup> Indoor Units with Motion Sensor: RCI-(1.0-6.0)FSR (with Motion Sensor Kit PS-MSK2), RCIM-FSRE (with Motion Sensor Kit SOR-NEC) and RPC-(1.5-6.0)FSR (with Motion Sensor Kit SOR-NEP) and RCD-(0.8-6.0)FSR (with Motion Sensor Kit SOR- NED).

<sup>\*2):</sup> Setting and operation is possible only from the main remote control switch.

<sup>\*3):</sup> Set PC-ARFP1E as a main remote control switch and the receiver kit as a sub remote control switch.


<sup>\*2):</sup> If "If Absent" setting is set to "Stop," the operation will stop only when motion sensors of all the connected indoor units detect

<sup>\*3):</sup> If "If Absent" setting is set to "Stop," the indoor unit without a motion sensor will stop when the indoor unit with a motion sensor stops. To allow continued operation of the indoor unit without a motion sensor, connect a remote control switch to each indoor unit.

# 10.9 System Control

# 10.9.1 Individual Operation


Example of installation with a wired controller for each indoor unit in individual operation settings.

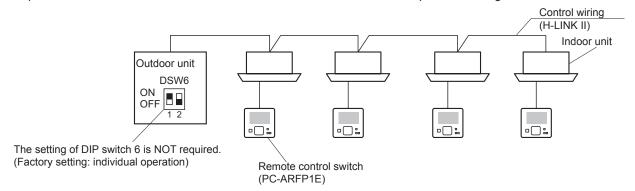

# ◆ Individual thermo ON/OFF operation

Single Wired Controller for an Individual Operation Setting

Example of installation with a single wired controller for multiple indoor units in individual thermo ON/OFF operation settings.

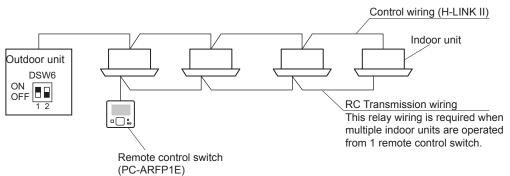


	Control Method	by each remote control switch
	Operation Method	by one group
ON/OFF	Available	
Setting of Operation Mode	Available	Cooling and heating can not be operated simultaneously.
Room Temperature Setting	Available	
Fan Speed Setting	Available	
Timer Setting	Available	
ON/OFF by Timer Control	Available	
Operation Indication	Available	
Alarm Indication	Available	
Self-Checking	Available	
Test Mode	Available	
Individual Louver Setting	Available	Only for RCI-FSR and RCIM-FSRE series with PC-ARFP1E
		Only for:
		RCI-FSR + PS-MSK2 + PC-ARFP1E
M 5 0 0 15		RCIM-FSRE + SOR-NEC + PC-ARFP1E
Motion Sensor Setting	ng Available	RPC-FSR + SOR-NEP + PC-ARFP1E
		RCD-FSR + SOR-NED + PC-ARFP1E
		RPI(L/H)-FSRE + SOR-MSK + PC-ARFP1E

# 10.9.2 Simultaneous Operation

No need for remote control relay wiring in UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium systems in simultaneous operation

In the case of systems comprising several indoor units (up to 4 indoor units of FSN2 series or later model types), the indoor units set to simultaneous operation can be controlled from a single remote controller, without the need to link them up with dedicated remote control relay wiring.


The indoor units must be H-LINK II compatible models

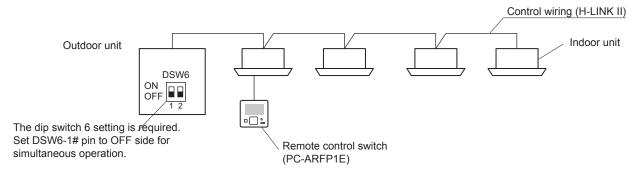


Control Method	by one optional Remote Control Switch				
Operation Method	by one group				
ON/OFF	Available				
Setting of Operation Mode	Available	Cooling and heating can not be operated simultaneously			
Room Temperature Setting	Available				
Fan Speed Setting	Available				
Timer Setting	Available				
ON/OFF by Timer Control	Available				
Operation Indication	Available				
Alarm Indication	Available				
Self-Checking	Available				
Test Mode	Available				
Individual Louver Setting	Available	Only for RCI-FSR series with PC-ARFP1E			
		Only for:			
		RCI-FSR + PS-MSK2 + PC-ARFP1E			
M 5 0 0 5 5		RCIM-FSRE + SOR-NEC + PC-ARFP1E			
Motion Sensor Setting	Available	RPC-FSR + SOR-NEP + PC-ARFP1E			
		RCD-FSR + SOR-NED + PC-ARFP1E			
		RPI(L/H)-FSRE + SOR-MSK + PC-ARFP1E			




UTOPIA Prime / UTOPIA IVX Prime and UTOPIA IVX Standard / Premium systems comprising several indoor units (up to 4 indoor units) in simultaneous operation setting can be controlled from a single wireless remote control (PC-AWR) using a wall-mounted receiver kit (PC-ALHZ1), without the need to link up the indoor units with dedicated remote control relay wiring, as shown in the figure below.

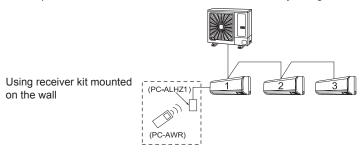

# 10.9.3 Different Refrigerant Cycles control

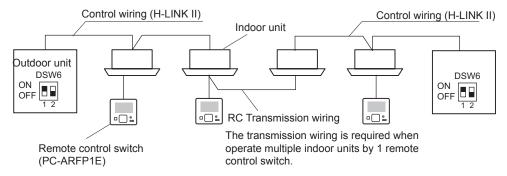


Different system groups can also be controlled from a single wireless remote control (PC-AWR) using a wall-mounted receiver kit (PC-ALHZ1). In such case, all the indoor units must be linked up with dedicated remote control relay wiring, and operation settings must be changed to individual operation (Not available in the UTOPIA ES series).

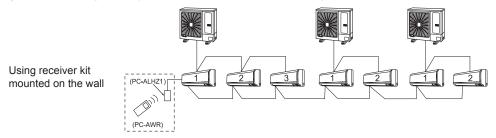


# 10.9.4 Wiring Examples

Basic combinations (example in the case of twin combination)

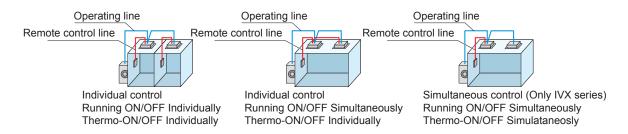

#### Flexible combinations for individual operation (Combination example by using individual operation function)

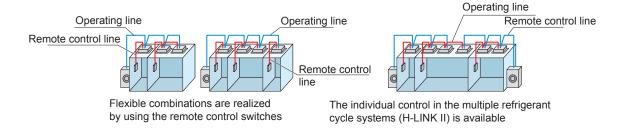

# 11 Optional functions

# Index

11.1	Main optional functions on indoor units	. 314
11.2	Main optional functions on KPI	. 315
11.3	Main optional functions on DX-Interface series 2	.316
	11.3.1 DX-Interface series 2 - Input / Output signals	316
	11.3.2 Thermo - On / Off control option	317
11.4	Optional remote control functions	.318
11.5	Econofresh signal control logic	. 338
	11.5.1 Econofresh enthalpy sensor – E2	338
	11.5.2 CO <sub>2</sub> gas sensor – E4	338
	11.5.3 Compatibilities between optional signals	338
11.6	Optional functions in the PSC-A64S central control	.339

# 11.1 Main optional functions on indoor units

The following table provides information on the optional functions available on indoor units. Consult the Service Manual for further information.

Optional function	Explanation	RCI(M)	RCD	RPC	RPI	RPK	RPF(I)	Econofresh kit
Remote on/off	This function controls the remote starting and stopping of the system. This optional function is extremely practical in hotels and office buildings to control the indoor units from the building management system.		•			•		
Cancellation of commands from the remote control after a forced stoppage	This function stops the indoor unit and cancels the commands from the remote control while it is enabled.		•		•			•
Operating mode setting for cooling or heating	This function remotely controls operating mode changes.	•	•	•	•	•	•	•
Control by room thermostat supplied by the fitter	This function manages the unit through an external thermostat. This function helps reduce problems caused by the stratification of air layers at different temperatures in the room.	•					•	*
Control by remote temperature sensor	Instead of using the information from the supply air thermistor on the indoor unit as a reference value for control purposes, the average value between this and the remote temperature sensor is used.							*
Signal capture	This function enables the unit to provide information to enable the necessary systems.	•	•	•	•			•
Automatic operating when the electricity supply is restored	This function stores the settings of the unit in the event of a cut in the electric power supply. The unit restarts when the electricity supply is restored.	•	•	•	•	•	•	•
Start-up function after a cut in the electricity supply.	This function stores the settings of the unit in the event of a cut in the electric power supply. The unit restarts when the electricity supply is restored if it was running before the cut in supply.							•
Optional sensor connection	This function activates the connection for an enthalpy sensor or a CO <sub>2</sub> concentration sensor (optional).	×	×	<b>×</b>	×	×	×	



Available.



Not available.

# 11.2 Main optional functions on KPI

Optional function	Explana	ition					
Thermo-off input	Thermo-off control will be drove by an input signal, not considering Tx temperature.						
		Fan stoppage: ventilation is stopped					
	It is possible to set the fan performance of the unit while the system is in defrost condition:	Fan at lowest speed: for installations where minimum ventilation rate must be kept					
	,	Fan speed kept: ventilation rate is not affected during the defrost time					
Defrost setting	<b>i</b> NOTE						
	During the defrost time, for those installations where the wather unit is set in heating mode it will supply cold air. The installations of defrost during this time is possible in SA section. From the will be turned on during the defrost time.	tallation of an auxiliary device to compensate the effect					
Filter sign	After a suitable number of hours of operation a servicing s centralised system advising the filters cleaning or replacer						
Remote on/off	It is possible to control the switching on and off of the unit	by an external input.					
Remote heat/cool	Setting of the mode operation is possible by an external in	put					
Operation delay	Considering the Active KPI as a ventilation unit, could be unthe A/C system. This setting of this time is available by the	, ,					
Electric heater application	The installation of an electric heater before the unit in OA section is necessary for installations working with outdoor temperature below -5 °C. Besides of having a control signal for this electric-heater control available from the KPI PCB, the unit stoppage will be delayed for three minutes after the switching off of the remote controller to cold down the heater element avoiding the installation damage by the remaining heat.						
	An additional air inlet thermistor (THM4) (optional accessory) must be installed before the electrical heater, in order to measure the temperature of the outdoor air to be heated.						
Fan stoppage delay	It is possible to set the time for which the Active KPI will re off. With this function it is possible to complete the air reno pollution and contamination. The installation will be complet this time the heat pump will be off to save energy.	vation of the installation, removing the remaining					
CO <sub>2</sub> sensor	Fan performance control is possible by the output of a CO output sensors are accepted. In case of on/off sensors, the was turned on to help reducing the CO <sub>2</sub> concentration on t sensors (0~10V or 4~20mA output) the fan speed will be a will help to keep low the CO <sub>2</sub> concentration on the air with	e fans will work at their highest speed when the signal he air. On the other hand, by proportional output outomatically adjusted by the CO <sub>2</sub> concentration, what					
		Automatic ventilation: The damper is driven by the KPI control, selecting if the damper must be open or closed looking for the highest efficiency based on the set temperature and indoors and outdoors temperatures.					
Fan high at starting	By the Remote Controller setting, it is possible to choose between three different ventilation modes:	Forced exchange: The damper is always closed, so the exchange between inlet and outlet air streams is always performed.					
		Bypass ventilation: The damper is always opened, what means that the heat exchanger is bypassed and the exchange between inlet and outlet air streams is never performed. (This option is not able in case of Active KPI units)					
Un-balanced ventilation	It is possible to set the fan speeds individually, promoting	Normal operation: Both fans working at same air flow, so the air flow rate supply is the same one than extracted.					
	a room pressurization to avoid the smoke and pollution transfer from one room to another:	Supply fan set: Supply fan rate is increased one step while exhaust fan keeps running at set air flow.					
		Exhaust fan set: Exhaust fan rate is increased one step while supply fan keeps running at set air flow					

# 11.3 Main optional functions on DX-Interface series 2

Optional function	Explanation
EC Fan or Tap Fan	The control of tap fans and EC fans is possible from the DX-Interface series 2.
Defrost signal	Output signal get from the DX-Interface when the system is in defrost mode.
Fan operation during defrost	During defrost operation three different fan speed settings are possible: fan speed kept as set, fan speed reduced to low speed and fan stoppage.
Thermo-on / Thermo-OFF by an external input	Instead of typical control logic.
Operation delay	Once the system is turned on, the unit is kept in off during an specific time. Useful for applications where the DX-Interface is focused in comfort and not room conditioning
Thermistor selection	Option to select between inlet thermistor, external thermistor or remote controller thermistor to perform the cycle control (as inlet temperature) (Only if demand control is based on inlet temperature).
Fan Stoppage delay	Once the system is switched off, the unit keeps running for a suitable period of time, to for example, perform the air renovation once the activity is conclude.
CO <sub>2</sub> sensor	By the action of an ON/OFF or a duty signal (0~10V / $4$ ~20mA) CO $_2$ sensor, the fan speed is controlled by the DX-Interface while the CO $_2$ concentration exceeds the sensor detection threshold

#### 11.3.1 DX-Interface series 2 - Input / Output signals

Input signal	Available from DX-Interface series 2
01	Control using the field-supplied room thermostat (cooling).
02	Control using the field-supplied room thermostat (heating).
03	Function 1 - remote ON/OFF of the unit (by contact).
04	Function 2 - turns unit ON (by pulse).
05	Function 2 - turns unit OFF (by pulse).
06	Cancellation of commands from remote control switch after forced stoppage.
07	Setting of the cooling mode or the heating mode.

Output signal	Available from DX-Interface series 2
01	Operation signal.
02	Alarm signal.
03	Cooling signal.
04	Thermo-ON signal.
05	Heating signal.
06	Defrost signal.

Input signal	Available from Outdoor unit
01	Control using the field-supplied room thermostat (cooling).
02	Control using the field-supplied room thermostat (heating).
03	Function 1 – remote ON/OFF of the unit (by contact).
04	Function 2 - turns unit ON (by pulse).
05	Function 2 - turns unit OFF (by pulse).
06	Cancellation of commands from remote control switch after forced stoppage.
07	Setting of the cooling mode or the heating mode.

Output signal	Available from Outdoor unit
01	Operation signal.
02	Alarm signal.
03	Cooling signal.
04	Thermo-ON signal.
05	Heating signal.
06	Defrost signal.

### 11.3.2 Thermo - On / Off control option

With DX-Interface series 2 it is possible to perform the thermo-On/thermo-Off control by three different ways.

Туре	Description
Standard thermo-On / thermo-Off	Suitable for installations controlled by suction or discharge temperature.
control (Default setting)	The thermo-On / thermo-Off logic is decided based on the difference between the inlet temperature to the coil and the set temperature on the remote controller or central controller.
	The thermo-On / thermo-Off control can be driven externally by an input signal connected to the CN3 socket of the PCB1 of the DX-Interface.
By an external input	Setting note: DIP Switch 1 – Pin 6 of DX-Interface PCB2 (small PCB) must be switched on (PCB2- DSW1#6 switched ON). Once the PCB DSW has been set, the input "i1" of CN3 is automatically set for thermo-On / thermo-Off control. The setting of input "i2" is kept as set on the remote controller.
	Please refer to Hitachi Indoor Units Service Manual for further information about the setting and connection of the auxiliary inputs to CN3 socket.
By the duty signal	For systems controlled by a duty signal it is possible to force the thermo-Off by the duty signal itself. When the duty signal becomes the minimum of its range (0 V or 4 mA) the system will be switched to thermo-Off condition. To be switched to Thermo-ON condition the duty must become higher than the 8% of its range.
	Setting note: No additional setting is required once the demand control setting has been set as Duty control.

## 11.4 Optional remote control functions

The next list refers to the optional functions available to indoor units from the remote control switch. Note that not all remote control switch have access to all the optional functions. Check the remote control switch technical documentation for detailed information.

Element	Optional function	Individual setting	Settings	Setting conditions	Description
	Heating temperature compensation  Models:  RCI-FSR		00	Normal (factory setting) (Setting Temperature + 4°C)	This function is used to adjust the temperature difference between the
			01	No compensation (Setting Temperature)	temperature read by the inlet sensor and the real room temperature.
	RCIM-FSRE RCD-FSR	0	02	Setting Temperature + 2°C	This is useful when the inlet air thermistor is not placed inside the indoor
b1	RPC-FSR RPI(L/H)-FSRE		03	Setting Temperature + 3°C	unit or due to uneven heat load.  Note:
51	RPI-FSN3(P)E(-f) RPK-FSR(H)M		04	Setting Temperature + 1°C	The "02", "03", "04" settings may not be available depending.
	Heating temperature		00	RPF(I)-FSN2E: Normal (factory setting) (Setting Temperature + 2°C)	on the type of indoor unit.  This setting shall be
	compensation  Models:	0	01	No compensation (Setting Temperature)	performed separately for each indoor unit, even in case that
	RPF(I)-FSN2E		02	Setting Temperature + 2°C	multiple indoor units are connected to one remote controller.
	Circulation function at		00	Function disabled (factory setting)	This function keeps the fan running during the Thermo-OFF sequence, at
b2	heating Thermo-OFF	0	01	Function enabled	the fan speed set on the remote control switch, to prevent the stratification of air in the room.
	Forced compressor operation for at least three	_	00	Function disabled (factory setting):  Forced compressor operation for at least three minutes can be enabled or disabled through C7 setting	This function is used to allow the setting of C7, to protect the compressor by preventing it from being started or stopped for periods of less than 3 minutes.
b3	b3 minutes (Not available for models KPI-E4)	O S	01	Function enabled: Forced compressor operation for at least three minutes always occurs independently of C7 setting	
			00	Standard (1200 hours)	This function is used to modify the period of
			01	100 hours	operation after which the air filter cleaning indication is shown in the remote
b4	Change of filter cleaning period	0	02	1200 hours (factory setting)	control.
			03	2500 hours	For RPK-FSR(H)M models, the factory setting
			04	No indication	is b4=00: Standard setting 200 hours.
b5	Locking of operation mode	X	00	Function disabled (factory setting)	This function prevents the modification of the operation mode of the unit
	(Not available for models KPI-E4)	^	01	Function enabled	from the remote controller and from central controls, once it has been selected.
b6	Locking of temperature setting	erature X	00	Function disabled (factory setting)	This function prevents the modification of the setting temperature of the unit
50		,,	01	Function enabled	from the remote controller and from central controls, once it has been selected.

Element	Optional function	Individual setting	Settings	Setting conditions	Description
b7	Setting operation mode as cooling only	X	00	Function disabled (factory setting)	This function is used to limit the operation mode
D7	(Not available for models KPI-E4)	*	01	Function enabled	to cooling only and to prevent heating mode from being enabled.
	Automatic COOL/HEAT operation		00	Function disabled (factory setting)	This function enables the selection of Auto cool/heat operation mode. If the
b8	(Not available for models KPI-E4)	Х	01	Function enabled	function is not activated, Auto cool/heat mode cannot be selected on the remote control switch.
b9	Locking of fan speed setting	X	00	Function disabled (factory setting)	This function prevents the modification of the fan speed of the unit from the
D9	(Not available for models KPI-E4)	^	01	Function enabled	remote controller and from central controls, once it has been selected.
bA	Not available	Χ	"" permanent	Not available	_
			00	No compensation (factory setting)	This function decreases
bb	Cooling setting temperature correction	0	01	Setting temperature decreased by 1°C	the setting temperature and is used to produce
			02	Setting temperature decreased by 2°C	longer cooling periods.
			00		
bC	Not used	_	01	-	Use at 00 conditions
			00		
bd	Not used	_	01	-	Use at 00 conditions
			00		
bE	Not used	_	01	-	Use at 00 conditions
04	Netword		00		11
C1	Not used	_	01	-	Use at 00 conditions
C2	Not available	_	"" permanent	-	-
	Not used		00	-	Use at 00 conditions
	Not useu		01		Ose at 00 conditions
C3	Only for DX-Interface, KPI- E4E and KPI-X4E:	-	00	Function disabled (factory setting)	This function keeps the fan in operation for 60
	Fan stoppage delay		01	60 minutes	minutes after stop of the KPI unit or DX- Interface.
C4	Drain pump operation in	0	00	Function disabled (factory setting)	This function is used to activate the drain pump
	heating mode		01	Function enabled	in heating mode. Only for models with drain pump.

Element	Optional fund	ction	Individual setting	Settings	Setting cor	nditions	Description	
	Static pressure selection			00	Standard static press (factory setting)	ure	This function is used to	
	Models RPI(L/H)-FSRE			01	High static pressure		change the static pressure of the RPI units from the	
	RPI-FSN3(P)E(-f)			02	Low static pressure		remote control.	
	Increase of fan sp during normal ope (not during heating	eration		00	Standard (factory setting)			
C5	Thermo-OFF)  Models  RCI-FSR  RCIM-FSRE		0	01	Hi Speed 1		This function is used to change the fan speed of indoor units installed in	
	RCD-FSR RPC-FSR RPK-FSR(H)M RPF(I)-FSN2E			02	Hi Speed 2	high ceilings.  Hi Speed 2		
	Fan speed setting on the remote controller							
	C5	High H		High	Medium	Low		
	0	Hi2		Hi	Me Lo			
	1	1	Hi2	Hi1	Hi	Me		
	2	I	Hi2	Hi2	Hi1	Hi		
	(This function C5	is not ava	ailable for DX	-Interface mode	<u> </u>		l=1 : 6 : 1 : 1 : 1 : 1 : 1 : 1 : 1 : 1 :	
	Increase of fan sp	crease of fan speed at		00	Function disabled (factory setting)		This function is used to increase the fan speed	
C6	heating Thermo-OFF		0	01	Function enabled		when the thermostat reaches the set temperature in heating according to the setting of function C5.	
C7	Cancellation of for	Cancellation of forced		00	Function disabled (factory setting)		This function is available	
	compressor operation for at least 3 minutes			01	Function enabled (Compressor operation minutes is no longer f	on during 3 forced)	depending on the setting of function b3.	
	Only for KPI-E4E KPI-X4E	Only for KPI-E4E and			00	Sensor non enabled (factory setting)		Via 7-segments display set the option Ct (00: ON/
	CO <sub>2</sub> sensor enabled			01	Sensor enabled/activa	ated	OFF Sensor (Default); 01: 4-20mA 02: 0-10V)	

Element	Optional function	Individual setting	Settings	Setting conditions	Description	
	Control by the temperature sensor of the remote control switch.		00	Control by the air inlet sensor of indoor units (factory setting)		
	NOTE		01	Control by the temperature sensor of the remote control switch		
	The remote control switch shall be installed in a proper place for the correct detection of room temperature by its temperature sensor.	0	02	Control by the average value of the air inlet sensor of indoor units and the temperature sensor of the remote control switch  (Air inlet + Remote control switch)/2		
	Control sensor when a remote sensor is connected to the THM4 connector in the indoor unit PCB.			When a remote sensor is connected to		
C8	The remote sensor shall be installed in a proper place for the correct detection of room temperature.  Model RPF(I)-FSN2E		00, 01, 02	THM4, this remote sensor is used as control sensor, whichever the setting for C8 (factory setting C8=00)	This function specifies the temperature sensor to be used as control sensor by the indoor unit.	
	Control sensor when a remote sensor is connected to the THM4 connector in the indoor unit PCB.	0	0	00, 02	Air temperature control using the average value of the air inlet thermistor and the remote sensor (factory setting C8=00)  (Air inlet + Remote sensor)/2	
	The remote sensor shall be installed in a proper place for the correct detection of room temperature.  Models RCI-FSR RCIM-FSRE RCD-FSR RPC-FSR RPI(L/H)-FSRE RPI-FSN3(P)E(-f) RPK-FSR(H)M		01	Air temperature control using the remote sensor		
C9	Not available	-	"" permanent	_	_	
CA	Not available	-	"" permanent	-	-	
Cb	Selection of forced	Х	00	Forced stoppage input: A contact, normally open contact (factory setting)	This function determines the logic operation for the	
	stoppage logic		01	Forced stoppage input: B contact, normally closed contact	forced stoppage contacts.	
	Not used		00	-	Use at 00 conditions	
СС	Only for DX-Interface,	-	01	Function disabled	This function sets the unit	
	KPI-E4E and KPI-X4E: High ventilation speed		01	(factory setting)  Function enabled	to run in high fan speed regardless the setting from remote control switch.	

Stop of Indoor unit fan during cooling Thermo-OFF conditions    I NOTE	Element	Optional function	Individual setting	Settings	Setting conditions	Description
Col. For model RPILIMI. RCO. FSR. this function is NOT available.  Stop of indoor unit fan during heating Thermo-OFF conditions (with remote control switch temperature sensor).  Stop of indoor unit fan during heating Thermo-OFF conditions (with remote control switch temperature).  Thermo-OFF conditions (with remote control switch temperature).  Modification of louver swing angle Models:  RPC-FSR RCD-FSR		during cooling Thermo-OFF conditions		00		indoor unit fan is stopped in cooling Thermo-OFF conditions when using
Stop of indoor unit fan during heating Thermo-OFF Conditions  CE  Stop of indoor unit fan during heating Thermo-OFF Conditions Thermo-OFF Conditions (with remote control switch temperature sensor)  Modification of louver swing angle  Models:  RCIM-FSR RCIM-FSR RCIM-FSR RCIM-FSR RPF-FSR	Cd	For model RPI(L/H)-FSRE(P)E and RCD-FSR, this function is NOT	0	01		THM-R2AE (connected to THM4) or the PC-ARFP1E temperature sensor.  C8 must be set to 01 to
CE   during heating   Thermo-OFF conditions (with remote control switch temperature sensor)   1		during heating Thermo-OFF conditions		00		PC-ARFP1E temperature sensor to monitor the room temperature when the fan is stopped (heating Thermo-OFF fan stop
switch temperature sensor)    Control by remote the louvers will keep operating in both Thermo-ON and Thermo-OF conditions)	CE	during heating Thermo-OFF conditions	0		heating Thermo-OFF	C8 must be set to 01 to
Modification of louver swing angle  Models: RCI-FSR RCIM-FSRE RCD-FSR RCM-FSR RPC-FSR  O  Standard (7 steps) (/5 steps for cooling / dry mode)  Management of indoor unit operation after a poption 1  Day of the available  D  Management of indoor unit operation after a poption 1  Management of indoor unit operation after a poption 1  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indo		switch temperature		01	the louvers will keep operating in both Thermo-ON and Thermo-OFF	temperature sensor connected to THM4 is not permitted (use E8 function
Models: RCI-FSR RCIM-FSRE RCD-FSR RPC-FSR  O  Standard (7 steps) (between 2 steps cut off)  High ceilings (5 steps)  O  Standard (7 steps) (between 2 steps cut off)  O  Standard (7 steps) (5 steps for cooling / dry mode)  Cold draft prevention (5 steps for heating and fan only) (Cannot be set to the lower two steps; lower 2 steps cut off)  Management of indoor unit operation after a power supply cut off - option 1  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  D  Cannot be set to the lower two steps; (Changes to the setting of this function are applied after turning the power supply is restored, the indoor units controlled by the wired remote control switch are turned on regardless of their ON/OFF status at the time of the last power cut off.  D  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  Management of indoor unit operation after a power supply cut off - option 2  D  Function enabled  Function enabled  Function enabled  Function enabled  Function after a power supply is restored, the indoor units controlled by the wired remote control switch are turned on automatically ONLY if they were already ON at the time of the last power cut off.  Function enabled  Function enabled  Function of isabled (factory setting)  Function enabled  Function of isabled (factory setting)  Function enabled  Function of isabled (factory setting)  Function of isable		Modification of louver		00		
RCD-FSR RPC-FSR Rpc-G-FS taltus when power is restored.    Output   Punction enabled   Puncti		Models: RCI-FSR RCIM-FSRE RCD-FSR	0	01	(Cannot be set to the lower two steps;	angle of the air outlet louver. (Changes to the setting of this function are applied after turning the power supply off and on again, or after the automatic louver has made a full cycle in
Models:  RPK-FSR(H)M  Models:  RPK-FSR(H)M  Models:  RPK-FSR(H)M  Management of indoor unit operation after a power supply cut off-option 1  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option after a power supply cut off-opti	CF			02	(Cannot be set the upper two steps;	
Models: RPK-FSR(H)M    Cold draft prevention (5 steps for heating and fan only) (Cannot be set to the lower two steps, lower 2 steps cut off)   O2				00		
Management of indoor unit operation after a power supply cut off option 1  Management of indoor unit operation after a power supply cut off option 1  Management of indoor unit operation after a power supply cut off option 1  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off on the indoor units controlled by the wired remote control switch are turned on automatically ONLY if they were already ON at the time of the last power cut off.  If indoor units were OFF when power was turned OFF, they remain in OFF status when power is restored.  Management of indoor units operation after a power supply cut off on the indoor units operation of the last power cut off.  Use at 00 conditions				01	(5 steps for heating and fan only) (Cannot be set to the lower two steps,	
Management of indoor unit operation after a power supply cut off option 1  Management of indoor unit operation after a power supply cut off option 1  Management of indoor unit operation after a power supply cut off option 1  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation disabled (factory setting)  Management of indoor unit operation after a power supply cut off on a unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply cut off option 2  Management of indoor unit operation after a power supply is restored, the indoor units controlled by the wired remote control switch are turned on automatically ONLY if they were already ON at the time of the last power cut off.  If indoor units were OFF when power was turned OFF, they remain in OFF status when power is restored.				02	Not used	
d1 unit operation after a power supply cut off - option 1  D1 Function enabled remote control switch are turned on regardless of their ON/OFF status at the time of the last power cut off.  D2 Not available - "" permanent		unit operation after a power supply cut off -		00		restored, the indoor units
Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  Management of indoor unit operation after a power supply cut off-option 2  O  The function disabled (factory setting)  Function disabled (factory setting)  ONLY if they were already ON at the time of the last power cut off.  If indoor units were OFF when power was turned OFF, they remain in OFF status when power is restored.  O  O  O  O  O  O  O  O  Use at 00 conditions	d1		0	01	Function enabled	remote control switch are turned on regardless of their ON/OFF status at the time of the last power
Management of indoor unit operation after a power supply cut off-option 2  O  Function disabled (factory setting)  Function disabled (factory setting)  Function disabled (restored, the indoor units controlled by the wired remote control switch are turned on automatically ONLY if they were already ON at the time of the last power cut off.  If indoor units were OFF when power was turned OFF, they remain in OFF status when power is restored.  D  O  O  O  Use at 00 conditions	d2	Not available	-	"" permanent	-	_
Management of indoor unit operation after a power supply cut off-option 2  ONLY if they were already ON at the time of the last power cut off.  If indoor units were OFF when power was turned OFF, they remain in OFF status when power is restored.  DNLY if they were already ON at the time of the last power cut off.  If indoor units were OFF when power was turned OFF, they remain in OFF status when power is restored.  Use at 00 conditions	d3	unit operation after a power supply cut off -		00		restored, the indoor units controlled by the wired remote control switch are
d4 Not used 0 Conditions			a	01	Function enabled	ONLY if they were already ON at the time of the last power cut off. If indoor units were OFF when power was turned OFF, they remain in OFF status when power is
. VI	d4	Not used	0	00 01	-	Use at 00 conditions

Element	Optional function	Individual setting	Settings	Setting conditions	Description				
d5	Prevention of low air d5 outlet temperature in	0	00	Function disabled (factory setting)	This function prevents the occurrence of an excessively cold air flow in heating mode by				
uo	heating mode	0	01	Function enabled	decreasing the fan speed during heating operation, also taking into account the setting of function C5				
			00	Function disabled (factory setting)	This function saves energy when the outdoor temperature is lower than the air conditioning load.				
d6	Room temperature control for energy saving	O	01	Function activated	The indoor unit is set to cooling Thermo-OFF when:  Tout (outside ambient temperature - out of the building) - Tip				
			00	CO (footom: cottion)	building) < Tin				
			00	6º (factory setting)					
			01	120					
	Econofresh: Minimum		02	18° 24°	This function is used to				
d7	opening angle of the	0	03	30°	set the minimum opening angle of the damper for				
	outdoor air (OA) damper	}	05	36°	fresh outdoor air.				
		-		42°					
			06 07	48°					
			07		This function allows the				
			00	Automatic ventilation (factory setting)	outdoor air damper to be opened in All Fresh				
	KPI: Ventilation mode		01	Ventilation with total heat exchanger	operation mode. This mode allows the full opening of the outdoor air				
			,	02	Ventilation with bypass (no total heat exchange)	damper (according to the control system).			
	DX-Interface:								00
	"A" Offset for		01	2°C					
E1	Thermo- OFF in control by outlet for DX-Interface	0	0		02	4°C			
			00	Standard process (factory setting)	This function allows the outdoor air damper to be opened in All Fresh operation mode. This				
	Econofresh: cooling mode		01/02	All Fresh	mode allows to fully open the outdoor air damper (according to the control system).				
			00	Disabled function (factory setting)	This function is used to make the room pressure higher or lower than the surrounded room. One				
E2	KPI: Increase of air supply volume	ply	01	Enabled function	of the fans Increases its speed while the other runs according the remote controller. Hi/Me/Lo change to Hi/				
	Econofresh enthalpy		00	Disabled function (factory setting)	Hi/Me.  This function selects the				
	sensor		01	Enabled function	enthalpy sensor input for Econofresh.				

Element	Optional function	Individual setting	Settings	Setting conditions	Description
	Not used	-	00	-	Use at 00 conditions
E3	Only for KPI-E4E and KPI-X4E:		00	Activated for supply fan	This function selects which fan will increase the
	Selection of the fan for function E2	-	01	Activated for exhaust fan	speed (when E2 enables this function).
			00	Disabled (factory setting)	This function delays
	KPI: Pre-cooling / pre- heating period		01	30 minutes	unit startup with energy
E4	neating period	0	02	60 minutes	recovery
L <del>4</del>			00	Disabled (factory setting)	This function selects the
	Econofresh: CO <sub>2</sub> sensor		01/02	CO <sub>2</sub> sensor (required setting E1=00)	CO <sub>2</sub> gas sensor input for Econofresh.
			00		
	Not used	-	01	-	Use at 00 conditions
E5	Only for DX-Interface, KPI-E4E and KPI-X4E:		00	Disabled (factory setting)	This function forces that the unit will operate in high speed during 60
	High ventilation after switch ON	-	01	60 minutes	minutes after fan start. After this time the fan will be changed to setting value.
			00	Disabled function	This function provents the
E6	Period of indoor fan operation after cooling	0	01	(factory setting) 60 minutes	This function prevents the condensation in the unit by keeping the fan running after the unit operation has been turned OFF.
	operation stoppage		02	120 minutes	
			00		
E7	Not used	-	01	-	Use at 00 conditions
	Control for stop of the	ontrol for stop of the	00	Fan operation in Low speed	This function stops the fan to prevent cold draughts or overheating.  C8 must be set to 01 to use the E8=01 setting.  The connection of a THM- R2AE remote
E8	indoor unit fan during heating Thermo-OFF conditions (with remote sensor THM-R2AE connected to the THM4 connector in the indoor unit PCB)	0			temperature sensor to the THM4 port in the indoor unit PCB is required. The remote sensor shall be installed in a proper place for the correct detection of
		01	Fan stop in Thermo-OFF conditions.	room temperature.  (In case that automatic louver is set, the louver will keep operating in both Thermo- ON and Thermo- OFF condition.)	
E9	Intermittent fan operation in heating stop	ng stop	00	Function disabled (factory setting)	In case that indoor unit operation is set OFF by the remote control switch, under certain conditions the fan is operated in cycles consisting of 3 minutes of operation at SLow speed and 30 minutes of stoppage.
La	Not available for models: RPF(I)-FSN2E	0	01	Function enabled	
					30 minutes of stoppage.
EA	Not used		00 01		Use at 00 conditions

Element	Optional function	Individual setting	Settings	Setting conditions	Description
			00	Function disabled (factory setting)	This function decreases speed of the indoor
Eb	Indoor unit fan control during cooling Thermo-	0	01	Low	unit fan during cooling Thermo-OFF, to reduce
	or r conditions		02	Slow	the spread of smells and humidity.
EC	Forced Thermo-ON when stopping in cooling	0	00	Function disabled (factory setting)	This function is used to force Thermo-ON during 6
	operation		01	Enabled	minutes when stopping in cooling operation.
Ed	Not used	0	00	_	Use at 00 conditions
Lu	Not used		01		Osc at 00 conditions
EE	Control in "Automatic"		00	Function disabled (factory setting)	This function limits the speed of the indoor fan
EE	indoor fan speed mode	0	01	Enabled	when room temperature is close to the setting temperature.
	Control in "Automatic" indoor fan speed mode (supporting High H) Models: RCI-FSR		00	Function disabled	This function limits the speed of the indoor fan when room temperature
EF	RCIM-FSRE RCD-FSR RPC-FSR RPI(L/H)-FSRE RPI-FSN3(P)E(-f) RPK-FSR(H)M	0	01	Function enabled	temperature, allowing to reach High H speed.
F0	Not available	-	"" permanent	-	_
			00	Function disabled (Factory setting)	This function sets an automatic OFF timer to switch OFF the indoor
			01	1 hour	
	Automatic OFF timer setting		02	2 hours	
	Models:		03	3 hours	units controlled by the remote control switch
	RCI-FSR		04-24	(04-24) hours	(when the units have been
	RPC-FSR RPK-FSRM	X	0A	30 minutes	started by remote control).
	RPI(L/H)-FSRE		0B	90 minutes	Do not set the values
	RCD-FSR RCIM-FSRE		0C	40 minutes  Do not set these	"0C"-"0F" when two
F1	RPI-FSN3(P)E(-f)		0D	45 minutes when two wired controllers are used.	remote control switches are used in the same
			0E	50 minutes	remote control group).
			0F	55 minutes	
			00	Function disabled (Factory setting)	
	Automatic OFF timer		01	1 hour	This function is used to
	Automatic OFF timer setting  Models: RPF(I)-FSN2E		02	2 hours	set the automatic timer
		X	03	3 hours	to switch off when the unit has been started by
			04-24	(04-24) hours	remote control.
			0A	30 minutes	
			0B	90 minutes	
F0	Remote control main-sub	V	00	Main (main remote control) (Factory setting)	This function is used to define which remote control switch is used as
F2	setting	X	01	Sub (sub remote control)	main or sub, when two remote controllers are connected to one indoor unit.

Element	Optional function	Individual setting	Settings	Setting conditions	Description
	F3 Automatic reset of setting temperature		00	Function disabled (Factory setting)	This function is used to limit unit operation and save energy.  The setting temperature is automatically set to the value defined with functions "F5" or "F6",
F3		х	01	Function enabled	according to the current operation mode, after the time set with function "F4" has passed since the last manual change of setting temperature.  In case that the values of
					"F5" or "F6" are out of the limits set with functions "FC" and "Fd", limitations set by "FC" and "Fd" have priority.
			00	30 minutes (factory setting)	
			01	15 minutes	This function sets the
F4	Automatic reset time	X	02	60 minutes	automatic reset time delay for function F3.
			03	90 minutes	Ior function F3.
			19	19°C	
			20	20°C	_
			21	21°C	
			•		This function defines the
	Automotic recet		24	24°C	default temperature set
F5	Automatic reset temperature for cooling	X	25	25°C (factory setting)	point for the automatic
	tomporatare for econing		26	26°C	reset function F3 in FAN/ COOL/DRY modes.
				:	COOL/DRT Illodes.
				.	
			28	28°C	_
			29	29°C	
			30	30°C	
			17	17°C	
			18	18°C	
			•		
					This function defines the
			20	20°C	default temperature set
F6	Automatic reset temperature for heating	X	21 25	21°C (factory setting)	point for the automatic
	temperature for fleating				reset function F3 in HEAT
					mode.
			•		
			28	28°C	
			29	29°C	
			30	30°C	
F7	Prevention of operation stoppage due to wrong	x	00	Function disabled (factory setting)	Operation is stopped by pressing the run/stop
operation of the remote controller	^	01	Function enabled	switch for 3 seconds.	
F8	Lock function for	X	00	Function disabled	This function is used to prevent changes to the
operation mode selection	,	01	Function enabled (factory setting)	operation mode.	

Element	Optional function	Individual setting	Settings	Setting conditions	Description
F0	Lock function for	.,	00	Function disabled	This function is used to
F9	temperature setting	X	01	Function enabled (factory setting)	prevent changes to the temperature setting.
- A	Lock function for fan	.,	00	Function disabled	This function is used to
FA	speed selection	X	01	Function enabled (factory setting)	prevent changes to the fan speed.
<u>-</u> .	Lock function for swing	.,	00	Function disabled	This function is used to prevent changes to
Fb	louver operation	X	01	Function enabled (factory setting)	the automatic louver operation.
			00	Function disabled 19°C is the standard minimum set point (factory setting)	
			01	+1°C (Lower limit 20°C)	
	Lower limit of setting		02	+2°C (Lower limit 21°C)	
F0	temperature for cooling		03	+3°C (Lower limit 22°C)	This function defines the lowest temperature setting
FC	(Minimum value of setting temperature allowed in cooling)	X	· ·		value for FAN/COOL/DRY modes.
			08	+8°C (Lower limit 27°C)	
			09	+9°C (Lower limit 28°C)	
			10	+10°C (Lower limit 29°C)	
			00	Function disabled 30°C is the standard maximum set point. (factory setting)	This function defines the highest temperature setting value for HEATING mode.  Models:  RPF(I)-FSN2E up to 20°C (FC=10)
		or heating	01	-1°C (Upper limit 29°C)	
	Upper limit of setting		02	-2°C (Upper limit 28°C)	
<b>.</b>	emperature for heating		03	-3°C (Upper limit 27°C)	
Fd	(Maximum value of setting temperature allowed in	X	:		
	heating)				
			10	-10°C (Upper limit 20°C)	
			11	-11°C (Upper limit 19°C)	
			12	-12°C (Upper limit 18°C)	
			00		
FE	Not used	-	01	-	Use at 00 conditions
			02		
FF	Not Used	0	00	_	Use as 00 conditions
			01		
Ц1	H1 No indication of maintenance alarm		00	Displayed	This function is used to display or hide the
- 111		_	01	Hidden	maintenance alarm indication.
Un	Indication of hot start	X	00	Displayed	This function is used to display or hide the automatic control indication.
П	H2 (No Indication of operation limitation)	^	01	Hidden	Models: RPF(I)-FSN2E Not available, use at 00 conditions

Element	Optional function	Individual setting	Settings	Setting conditions	Description
			00		
H3	Not used	_	01 / 02	_	Use at 00 conditions
			00	-	
	Not Used	-	01	-	Use at 00 conditions
H4	KPI: Operation modes for		00	Air conditioning only (factory setting)	This function is only
	the ventilation unit with	0	01	Ventilation only	available for ventilation
	energy recovery		02	Air conditioning + ventilation	units with energy recovery.
			00		
J1	Not used	-	01	-	Use at 00 conditions
			00		
J2	Not used	-	01	-	Use at 00 conditions
J3	Colour of the run indicator	Х	00	Green (factory setting)	_
33	Colour of the full indicator	^	01	Red	
			00	Start/Stop allowed (Factory setting)	When there is a remote control prohibition from a central control device,
J4	Override of Start/Stop prohibition at the remote controller	X	01	Start/Stop not allowed  DANGER  Blocking of Start/Stop shall never be	this function overrides this prohibition allowing the operation of the Run/ Stop button of the remote control switch.
				set due to safety concerns.	Models:
			02	Only Stop allowed	RPF(I)-FSN2E Not used. Use at 00 conditions
			00		
J5	Not used	-	01	-	Use at 00 conditions
J6	Not used		00		Use at 00 conditions
	Not used	-	01	-	Ose at 00 conditions
17	Enabling steps 6 and 7 for the air louver in COOLING		00	Function disabled (factory setting)	When a RPK unit is stopped in louver
J7	or DRY mode	0	01	Function enabled	positions 6 or 7, the louver is set to position 5.
			00	Function disabled (factory setting)	When the unit is restarted by the remote control switch, the temperature automatically changes to the setting temperature of
J8	Eco-operation	Х	01	Function enabled	"F5" or "F6".  Models: RPF(I)-FSN2E Not available, use at 00 conditions
J9	Not used		00	-	Use at 00 conditions
			01		223 41 00 00.141110110

Element	Optional function	Individual setting	Settings	Setting conditions	Description
	Display of "Simple		00	Function disabled (factory setting)	Enables the "Simple maintenance display" menu.  Menu 1510(rt.)  Roon Name Registration Usage Mount Display Oct Structure Chick Control of Structure Chick
JA	maintenance display" menu	0	01	Function enabled	Value   Valu
Jb	Enable automatic fan speed setting	0	00	Function disabled (factory setting)	Models: RPF(I)-FSN2E Not available, use at 00
	op our outling		01	Function enabled	conditions
K1	Not used	_	00		Use at 00 conditions
13.1			01		COO at 00 conditions
K2	Not used	_	00		Use at 00 conditions
			01		
K3	Not used	-	00		Use at 00 conditions
			01		
			00	_	
K4	Not used	-	01	-	Use at 00 conditions
			02		
			03	Standard (factory setting)	Models: RPF(I)-FSN2E Not available, use at 00 conditions.
K5	Detection level of the motion sensor kit	0	01	High	This parameter defines the sensitiveness of the motion sensor. The amount of activity in the room is assessed according to a different scale based on this setting.
			02	Low	Detailed information about the operation of the motion sensor can be found in the technical documentation of the indoor units.
			00	All modes allowed	This function is used
	Selection of allowed operation modes when		01	Only cooling/dry allowed	to select the operation modes in which the setting
K6	the control sensor of the indoor unit is set by C8 function	0	02	Only heating allowed	of C8 (use of remote control switch sensor or remote sensor on THM4
	TO TO TO		03	All modes allowed	to control the indoor unit) is enabled.
			00		
			01		
K7	Not used	-	02	-	Use at 00 conditions
			03		

Element	Optional function	Individual setting	Settings	Setting conditions	Description
			00	Function disabled (factory setting)	Condensation may occur around air outlet during COOL/DRY operation with horizontal air flow or downward air flow for long periods.  This function is used to
K8	Control for the prevention of condensation on the louvers.	0	01	Function enabled	prevent condensation by moving the louver swing angle to the third step automatically for 30 minutes every 1 hour.  (In RPK units, this function is activated by means of DSW2-4 instead of the K8
			00		optional function)
K9	Not used	-	00	-	Use at 00 conditions
			01		
KA	Not used	-	00	-	Use at 00 conditions
			00		
			01	-	
L1	Not used	-	02	-	Use at 00 conditions
			03	-	
			00		
			01	- - -	
L2	Not used	-	02		Use at 00 conditions
			03	-	
			00	Direct air blow Low (factory setting)	Power save must be ON in order to use this function (L5 must be set to 01).
			01	Direct air blow Medium	This function is used to establish louver swinging operation ranging from
L3	Operation of the louvers in energy-saving	0	02	Direct air blow High	continuous swing to static operation.  Low: Continuous louver
	Thermo- OFF (Cooling / Dry mode)				swing.
			03	Disabled	Medium: Louver swing with intermittent stops for 20/40 seconds.
					High: Louver stopped at full opening position, according to the setting of CF.
L4	Fan acceleration in energy-saving	0	00	Function disabled (factory setting)	This function increases fan speed by one step to prevent the loss of comfort due to the forced
LT	Thermo- OFF (cooling mode)	J	01	Function enabled	Thermo- OFF for energy saving during cooling operation.
L5	Louver swing operation during energy-saving	o	00	Function disabled (factory setting)	This function is used to enabled the setting of
	forced Thermo-OFF		01	Function enabled	function L3.
L6	Not used	_	00	_	Use at 00 conditions
LU	1.01 0000		01		COC at CO CONTAINONS

Element	Optional function	Individual setting	Settings	Setting conditions	Description
L7	Not available	-	"" permanent	_	-
L8	Not used	_	00	  -	Use at 00 conditions
	1101 0000		01		Coo at oo contaitions
L9	Not used	_	00	  -	Use at 00 conditions
	THO CUSCU		01		OSC at OS CONTAILIONS
LA	Not used	_	00	  -	Use at 00 conditions
	THO CUSCU		01		OSC at 00 contaitions
Lb	Not used	_	00	  -	Use at 00 conditions
	THO CUSCU		01		Osc at 00 containons
			00	Enabled (0.5°C steps) (factory setting)	This function is used to define whether setting temperature is adjusted in 0.5°C steps (when set to "00") or in 1°C steps (when set to "01").
P1	Setting temperature in 0.5°C steps	X	01	Disabled (1°C steps)	This setting also determines whether the resolution of temperature differential of the thermistor is 0.5°C (when set to "00") or 1°C (when set to "01").
P2	Not used	_	00	  -	Use at 00 conditions
	THO CUSCU		01		OSC at OS CONTAILIONS
		X	00	Inlet air thermistor (Tin)	This function is used
P3	Temperature sensor		01	Outdoor air thermistor (Tout)	to select the thermistor whose temperature is
	displayed		02	Remote controller thermistor (RCS)	shown when function P4
			03	Remote sensor (THM4)	is set to 01.
P4	Display of sensor	X	00	Hidden	This function is used to display the temperature of
	temperature		01	Shown	the sensor selected with function P3.
D.E.	Display of setting		00	Shown	This function is used to hide the display of setting
P5	temperature when operation mode is Fan	X	01	Hidden	temperature during operation in fan mode.
P6	Operation of the ECO	X	00	ECO button enabled (factory setting)	The operation of ECO button is disabled when
F 0	button	^	01	ECO button disabled	P6 is set to 01
D.T.	Prohibition of menu		00	Function disabled (factory setting)	This function is used to prohibit the access to the menu screens.
P7	screen transition	X	01	Function enabled	The text "Display disabled" appears on screen instead.
Do	Network		00		Her et 00
P8	Not used	-	01	-	Use at 00 conditions
DO	Netword		00		Han at 00 and 197
P9	Not used	-	01	-	Use at 00 conditions
			00	1 hour	This function is used
PA	Daylight saving time	Х	01	2 hours	to set the amount of adjustment when daylight saving time is applied.
Pb	Not used	_	00	-	Use at 00 conditions
			01		200 00 00 10110110
PC	Not used	_	00	-	Use at 00 conditions
			01		

Element	Optional function	Individual setting	Settings	Setting conditions	Description
q1	Not used		00		Use at 00 conditions
٩'	Not uoca		01		occ at oc contaitions
q2	Not used	-	-	-	Not used
q3	Not used	-	-	-	Not used
q4	Not used	-	-	-	Not used
q5	Not used	-	-	-	Not used
q6	Not used	_	00		Use at 00 conditions
			01		
q7	Not used	_	00		Use at 00 conditions
			01		
q8	Not used	_	00		Use at 00 conditions
			01		
q9	Not used	_	00		Use at 00 conditions
			01		
qA	Not used		00		Use at 00 conditions
			01		
			00	Disabled	Operation modes in which setback operation
ah	Operation mode with	X	01	Cooling	is activated to keep a
qb	setback	_ ^ [	02	Heating	minimum comfort in the room while it is not
			03	Cooling/Heating	occupied.
			00	2.0°C	Target temperatures for both cooling and heating operation are determined versus a temperature to start setback operation (rE, rF)  Target temperature calculation:  Target temperature in
			01	3.0°C	
qC	Temperature differential for the setback function	x	02	4.0°C	
			03	5.0°C	
			04	1.0°C	cooling mode: rF - qC (°C) Target temperature in heating mode: rE + qC (°C)
			00	10 minutes	
			01	20 minutes	To avoid the frequent
			02	30 minutes	activation of setback operation, a minimum off-
			03	40 minutes	time shall pass from the
qd Minimum stop time of setback			04	50 minutes	end of setback operation until the beginning of
	Minimum stop time of	,,	05	60 minutes	the following setback
		X	06	70 minutes	operation.
			07	80 minutes	Even if room temperature
			08	90 minutes	reaches the setpoint to start setback operation,
			09	100 minutes	setback operation does
			10	110 minutes	not start until the minimum off-time has expired.
			11	120 minutes	

Element	Optional function	Individual setting	Settings	Setting conditions	Description
			00	Always	When selecting "01: Input", it is necessary to set up one input
			01	Input	contact (i1 or i2) with the setback function "09". This operation has to be done
qE	Setback mode	Х	02	Schedule	in the input/output setting menu of the remote controller.
			03	Manual	When selecting "02: Schedule" or "03: Manual", additional settings are required.
			00	Stop	
_	Operation state after the		01	Run	Operation state to switch
qF	end of setback operation	Х	02	Operation state before the beginning of setback	to upon the end of setback duration.
				Function disabled	This function allows the
			00	(factory setting)	setting of independent
r1	Dual setpoint	Х	01	Function enabled	setpoints for cooling and heating in the automatic cooling/heating mode.
			0.5	0.5°C	
	0.46		1.0	1.0°C	This function can only be set when function r1 is set
r2	Setting of temperature differential for switching	Х	1.5	1.5°C	
12	cooling and heating	^	2.0	2.0°C	to 01.
			2.5	2.5°C	
			3.0	3.0°C	
			0.5		
			1.0		
			1.5		
			2.0		
			2.5	-	
r3	Not used	-	3.0	-	Not used
			3.5	_	
			4.0	_	
			4.5	-	
			5.0	-	
			5.5		
r4	Not used	-	00	-	Use at 00 conditions
			00		
r5	Not used	-	01	-	Use at 00 conditions
			00		
r6	Not used	-	01	-	Use at 00 conditions
			00		
r7	Not used	-	01	-	Use at 00 conditions
			00		
r8	Not used	-	01	-	Use at 00 conditions
			00	Start/Stop allowed (Factory setting)	Manual run/stop from the
r9	Remote control prohibition during setback operation		01	Start/Stop not allowed  DANGER	remote controller can be disabled during setback operation.
				Blocking of Start/Stop shall never be set due to safety concerns.	This function is fixed to 00 (Disabled) when function qE is set to 00 (Always).
			02	Only Stop allowed	

Element	Optional function	Individual setting	Settings	Setting conditions	Description
			00		
			01		
			02		
. A	Matrical		03		11
rA	Not used	- [	04		Use at 00 conditions
			05		
			06	1	
			07	1	
			00	Disabled	
			01	10 minutes	This function is used to
			02	20 minutes	define a minimum time
			03	30 minutes	of operation in a given
			04	40 minutes	mode, in order to avoid
	Minimum operation time		05	50 minutes	too frequent changes of operation mode.
rb	to allow the change of operation mode in auto	x	06	60 minutes	
10	cooling/heating mode with	^	07	70 minutes	Operation mode does not change until the
	dual set point	-	08	80 minutes	minimum transition time
			09	90 minutes	passes, even if the room
		-			temperature reaches the
			10	100 minutes	setpoint to shift to the other operation mode.
			11	110 minutes	
			12	120 minutes	
			00	Disabled	If outdoor ambient
			01	20.0°C	
			02	21.0°C	
			03	22.0°C	
					temperature is higher than rC, there is no mode
	Maximum outdoor temperature to allow	to X		.	transition to heating in automatic cooling/heating operation mode, even if room temperature reache the setpoint to switch
rC	operation mode switch to		21	40.0°C	
	heating in auto cooling/		22	0.0°C	
	heating with dual set point		23	1.0°C	
			24	2.0°C	operation mode from
					cooling to heating.
			41	19.0°C	
			00	Disabled	
			01	10.0°C	
			02	11.0°C	
			03	12.0°C	If outdoor ambient
					temperature is lower
	Minimum outdoor				than rd, there is no mode transition to cooling in
	temperature to allow operation mode switch to	X	31	40.0°C	automatic cooling/heating
rd	cooling in auto cooling/	^		-20.0°C	operation mode, even if
	heating with dual set point		32		room temperature reacher the setpoint to switch
			33	-19.0°C	operation mode from
			34	-18.0°C	heating to cooling.
				:	
			61	9.0°C	

Element	Optional function	Individual setting	Settings	Setting conditions	Description
			00	15.0°C	
			01	16.0°C	
			02	17.0°C	
Т			03	18.0°C	If room temperature becomes lower than
	Temperature for the		04	19.0°C	this setting, indoor unit
rE	beginning of heating in setback	X	05	10.0°C	operation is resumed
			06	11.0°C	in heating mode by the setback function.
			07	12.0°C	Selback fullclion.
			08	13.0°C	
			09	14.0°C	
			00	26.0°C	
			01	27.0°C	
			02	28.0°C	
			03	29.0°C	If room temperature
	Temperature for the		04	30.0°C	becomes higher than
rF	beginning of cooling in	X	05	31.0°C	this setting, indoor unit
	setback		06	32.0°C	operation is resumed in cooling mode by the
			07	33.0°C	setback function.
			08	34.0°C	
			09	35.0°C	
			10	25.0°C	
0.4			00		
S1	Not used	-	01	T-	Use at 00 conditions
			00		
S2	Not used	-	01	-	Use at 00 conditions
			00		
S3	Not used	-	01	-	Use at 00 conditions
0.4			00		11 100 111
S4	Not used	-	01	T-	Use at 00 conditions
C.F.	Netwood		00		Line at 00 conditions
S5	Not used	_	01	-	Use at 00 conditions
			00		
S6	Not used	- [	01	-	Use at 00 conditions
			02		
			00		
			01		
S7			02		
	Not used		03	-	Use at 00 conditions
			04		
			05		
			06		
			07		

Element	Optional function	Individual setting	Settings	Setting conditions	Description
			00		
			01		
			02		
			03		
			04		
			05		
			06		
S8	Not used		07	  -	Use at 00 conditions
30	Not used	-	08	-	Use at 00 conditions
			09		
			10		
			11		
			12		
			13		
			14		
			15		



- O: allows for individual setting.
- X: the setting is made for all outdoor units.
- -: not used.
- (1)

	Fan speed setting on Remote Controller						
<i>[</i> 5	High 2 High Medium Low						
0	Hi2	Hi	Me	Lo			
1	Hi2	Hi1	Hi	Me			
2	Hi2	Hi2	Hi1	Hi			

- (2) When J1 is set as activated function, the room temperature indication is the sensor value set at "C8".
- (3) The Remote Control Switch shall be installed in a proper place for the correct detection of room temperature by its temperature
- (4) The Remote Sensor shall be installed in a proper place for the correct detection of room temperature.
- (5) In case that automatic louver is set, the louver will keep operating in both thermo-ON and thermo-OFF condition.
- (6) 00 standard (7-step operation); 01 draft prevention (cannot be set to the lower two steps); 02 High ceilings (cannot be set the upper two steps).
- (7) In case that the set temperature is changed and kept within the set time at "F4", the temperature is automatically changed to "F5" and "F6". In case that the set temperature is out of range at "F5" and "F6", it is applied within upper and lower limit for the set
- (8) When the unit is restarted by the remote control switch, the temperature automatically changes to the setting temperature of "F5" or "F6".

# i NOTE

- On modifying the "LF" (air outlet louver angle change) setting, restore the power supply or allow the automatic louver to make a full cycle in automatic mode to apply the optional setting.
- The changes to the optional function settings must be done after 3 minutes have passed after startup.
- It is recommended to keep track of the changes made to optional function settings, for further reference.
- The optional settings are different according to the indoor and outdoor unit models. Check to ensure that the unit has the optional setting or not.
- The optional functions with "X" mark at the individual setting column can change the condition only when "All Rooms" is set.
- The following optional functions are disable when RPI Unit with Econofresh are installed: b7, bA, bd, bE, C1, C2, C3, C9, CA, Cd, CF, d6, E3, E5, E7, E9, EA, FE, FF, H1, H3, H4, J2, J4, J7, J8, J9, JA, JB, K1, K2, K3, K4, K5.

#### ♦ Input and Output Number Display and Connectors

Input number display	Dout	Factory setting			
Input/Output indication	Port	Setting item	Indication		
Input 1	CN3 1-2	Remote ON/OFF 1 (Level)	03		
Input 2	CN3 2-3	Prohibiting Remote Control after Manual Stoppage	06		
Output 1	CN7 1-2	Operation	01		
Output 2	CN7 1-3	Alarm	02		
Output 3	CN8 1-2	Thermo-ON for Heating	06		

#### ♦ Input and Output Settings and Display Codes

Indication	Input	Output
00	Not set	Not set
01	Room Thermostat (for Cooling)	Operation
02	Room Thermostat (for Heating)	Alarm
03	Remote ON/OFF 1 (Level)	Cooling
04	Remote ON/OFF 2 (Operation)	Thermo-ON for Cooling
05	Remote ON/OFF 2 (Stoppage)	Heating
06	Forbidding Remote Control after Manual Stoppage	Thermo-ON for Heating
07	Remote Cooling / Heating Change	Total Heat Exchanger
08	Elevating grille input	Elevating grille output
09	Setback operation	



After at least 3 minutes from the power ON, change the optional setting.

#### 11.5 Econofresh signal control logic

#### 11.5.1 Econofresh enthalpy sensor - E2

The signal opens and closes the air inlet and the outlet damper, mixing the outdoor air and the return air of the Econofresh. This function is based on the air quality parameters that provide precise control of the air quality.

Connect the cables in the connector CN3. Only contacts 1 and 2 of CN3 can be used for connection.

The signal has the following control logic:

Connector	Contact number	X1	Damper
	1, 2	ON	(to activate free cooling)
CN3	1 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0	OFF	Enabled (to activate mechanical cooling Thermo ON)

#### **11.5.2 CO**<sub>2</sub> gas sensor – **E4**

This signal controls the inlet of outdoor air according to the concentration of  ${\rm CO_2}$  inside the room.

Connect the cables in the connector CN3. Only contacts 1 and 2 of CN3 can be used for connection.

The signal has the following control logic:

Connector	Contact number	X1	Damper
	1, 2	ON	(for increasing the outdoor air)
CN3	200	OFF	Enabled (for decreasing the outdoor air)

#### 11.5.3 Compatibilities between optional signals

The following table shows the compatibility between the different optional signals:

	PC-ARFPE optional functions	Room thermostat	Remote control thermistor	Remote thermistor	Wireless remote control	Outdoor cooling mode	Enthalpy sensor	CO <sub>2</sub> sensor
Room thermostat	-		-	_	-	-	-	-
Remote control thermistor	£8	-		-	-	0	0	0
Remote thermistor	-	-	-		-	-	-	-
Wireless remote control	-	-	-	_		0	0	0
Outdoor cooling mode	E I	-	0	_	0		-	-
Enthalpy sensor	E2	-	0	_	0	-		-
CO <sub>2</sub> sensor	EY	-	0	_	0	-	_	

Not available: -Available: O

# 11.6 Optional functions in the PSC-A64S central control

Element	Optional function	Option	Settings	Description
			Available	This function eliminates the possibility of modifying
R	Operating mode setting	Setting "not displayed"	Not available	the operating mode. The same optional function must be selected on the remote control. This option also affects the settings made with the PSC-5S.
			Available	This function eliminates the possibility of modifying
ь	Temperature setting	Setting "not displayed"	Not available	the temperature setting. The same optional function must be selected on the remote control. This option also affects the settings made with the PSC-5S.
		Setting "not	Available	The same optional function must be selected on
Ë	Cooling only setting	displayed"	Not available	the remote control. This option also affects the settings made with the PSC-5S.
	Setting "not	Setting "not	Available	The same optional function must be selected on
d	ਰ Fan speed setting		Not available	the remote control. This option also affects the settings made with the PSC-5S.
	Automatic cooling/heating	Setting "not	Available	This function automatically switches from cooling
Ε	operation	displayed"	Not available	to heating. This function cannot be used if it is not available on the remote control.





Hitachi certifies that our products have met EU consumer safety, health and environmental requirements.





GA-1999/0044

Johnson Controls-Hitachi Air Conditioning Spain, S.A.U. is certified with: ISO 9001 of AENOR, Spain for its Quality Management accordance with the standard. ISO 14001 of AENOR Spain for its Environmental Management systems accordance with the standard.





Hitachi air conditioning products are manufactured according to: ISO 9001 of JQA, Japan for its Quality Management accordance with the standard. ISO 14001 of JACO, Japan for its Environmental Management accordance with the standard.



Hitachi air conditioning products are manufactured according to: ISO 9001 of Malaysia, for its Quality Management accordance with the standard. ISO 14001 of Malaysia, for its Environmental Management systems accordance with the standard.



Hitachi participates in the Eurovent Certification Programme; the certified data of certified models are listed in the Eurovent Certification Online Directory (www.eurovent-certification.com).

## Cooling & Heating

Johnson Controls-Hitachi Air Conditioning Spain, S.A.U. Ronda Shimizu, 1 - Políg. Ind. Can Torrella 08233 Vacarisses (Barcelona) Spain

© Copyright 2021 Johnson Controls-Hitachi Air Conditioning Spain, S.A.U. – All rights reserved.

TCGB0137 rev.1 - 07/2021 **Printed in Spain**